


PROBLEM SUMMARY

Sample Rating Trend





WATER

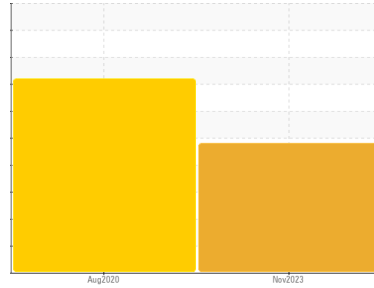

Machine Id
KAESER AIRCENTER SX 5 7190093 (S/N 1267)
Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

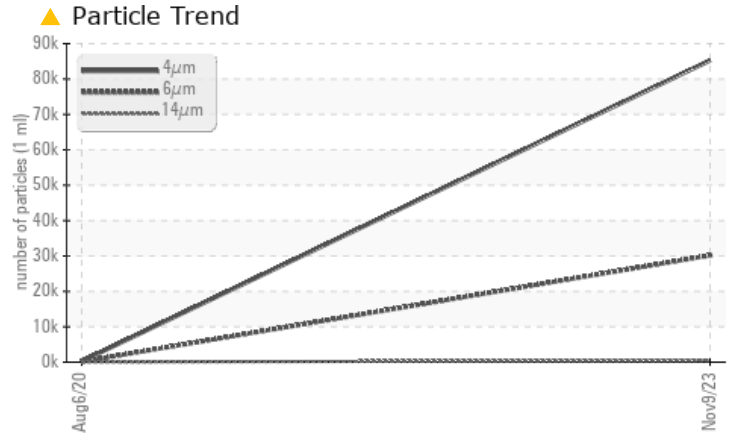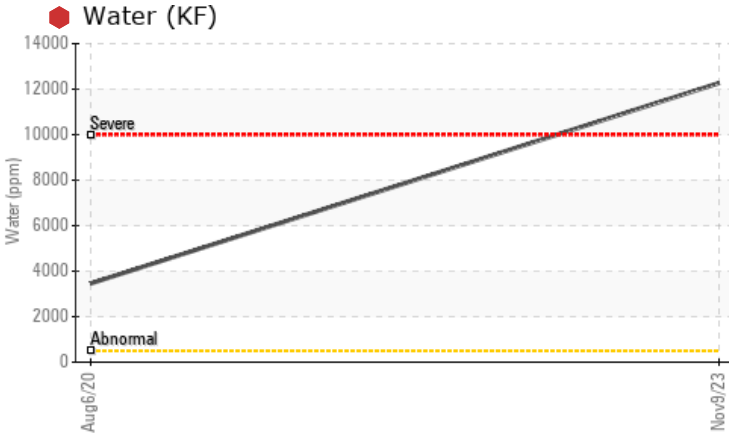

RECOMMENDATION

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status				SEVERE	SEVERE	---
Water	%	ASTM D6304	>0.05	🔴 1.226	🟡 0.346	---
ppm Water	ppm	ASTM D6304	>500	🔴 12269.4	🟡 3460	---
Particles >6µm		ASTM D7647	>1300	🟡 30141	126	---
Particles >14µm		ASTM D7647	>80	🟡 461	21	---
Particles >21µm		ASTM D7647	>20	🟡 45	7	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	🟡 24/22/16	14/12	---

Customer Id: AMASHE
Sample No.: KCPA009002
Lab Number: 06013371
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

06 Aug 2020 Diag: Angela Borella

WATER




Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition. All component wear rates are normal. Appearance is unacceptable. There is a light concentration of water present in the oil. Excessive free water present. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

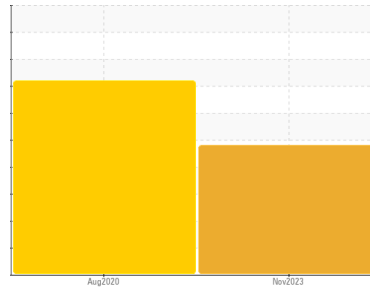

WATER



Machine Id
KAESER AIRCENTER SX 5 7190093 (S/N 1267)

Component

Compressor

Fluid

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil. There is a high concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA009002	KCP24922	---
Sample Date	Client Info		09 Nov 2023	06 Aug 2020	---
Machine Age	hrs	Client Info	2444	359	---
Oil Age	hrs	Client Info	0	359	---
Oil Changed	Client Info		N/A	Changed	---
Sample Status			SEVERE	SEVERE	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	<1	---
Chromium	ppm	ASTM D5185m >10	0	0	---
Nickel	ppm	ASTM D5185m >3	<1	0	---
Titanium	ppm	ASTM D5185m >3	0	0	---
Silver	ppm	ASTM D5185m >2	0	0	---
Aluminum	ppm	ASTM D5185m >10	<1	0	---
Lead	ppm	ASTM D5185m >10	0	<1	---
Copper	ppm	ASTM D5185m >50	0	1	---
Tin	ppm	ASTM D5185m >10	2	0	---
Antimony	ppm	ASTM D5185m	---	0	---
Vanadium	ppm	ASTM D5185m	0	0	---
Cadmium	ppm	ASTM D5185m	0	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	7	16	---
Barium	ppm	ASTM D5185m 90	114	7	---
Molybdenum	ppm	ASTM D5185m 0	0	0	---
Manganese	ppm	ASTM D5185m	0	1	---
Magnesium	ppm	ASTM D5185m 100	6	6	---
Calcium	ppm	ASTM D5185m 0	8	1	---
Phosphorus	ppm	ASTM D5185m 0	3	7	---
Zinc	ppm	ASTM D5185m 0	4	45	---
Sulfur	ppm	ASTM D5185m 23500	3100	15808	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	2	2	---
Sodium	ppm	ASTM D5185m	77	0	---
Potassium	ppm	ASTM D5185m >20	19	0	---
Water	%	ASTM D6304 >0.05	1.226	0.346	---
ppm Water	ppm	ASTM D6304 >500	12269.4	3460	---






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		85261	231	---
Particles >6µm	ASTM D7647	>1300	30141	126	---
Particles >14µm	ASTM D7647	>80	461	21	---
Particles >21µm	ASTM D7647	>20	45	7	---
Particles >38µm	ASTM D7647	>4	3	1	---
Particles >71µm	ASTM D7647	>3	0	0	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	24/22/16	14/12	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.27	0.170	---


OIL ANALYSIS REPORT

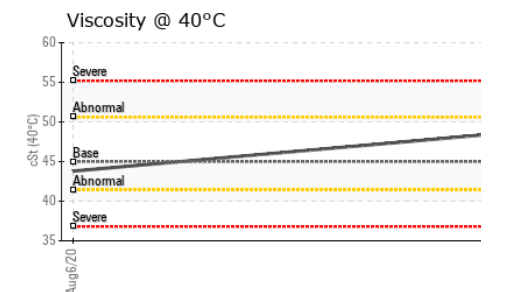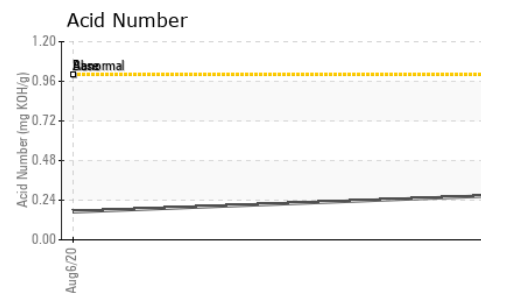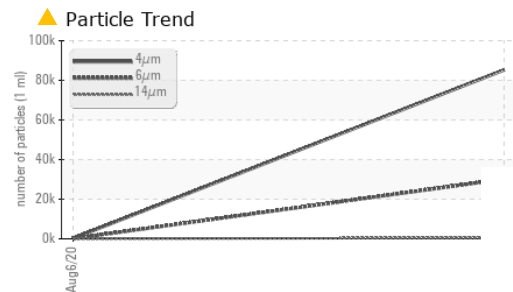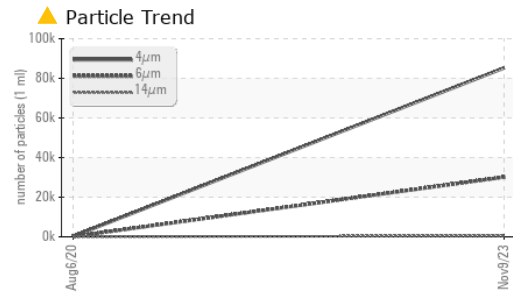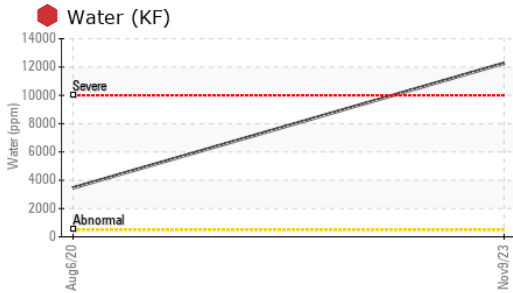





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	▲ LAYRD
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	0.2%
Free Water	scalar	*Visual		NEG	5.0

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	48.6	43.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

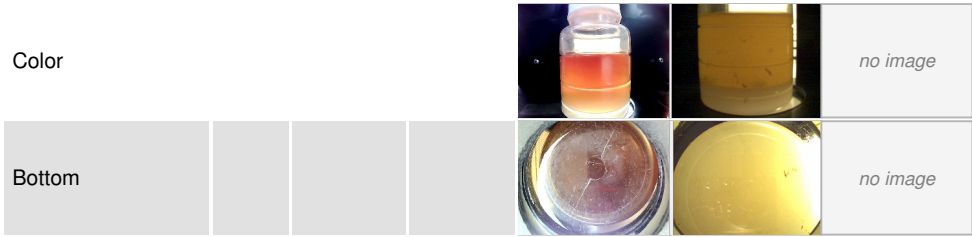

GRAPHS

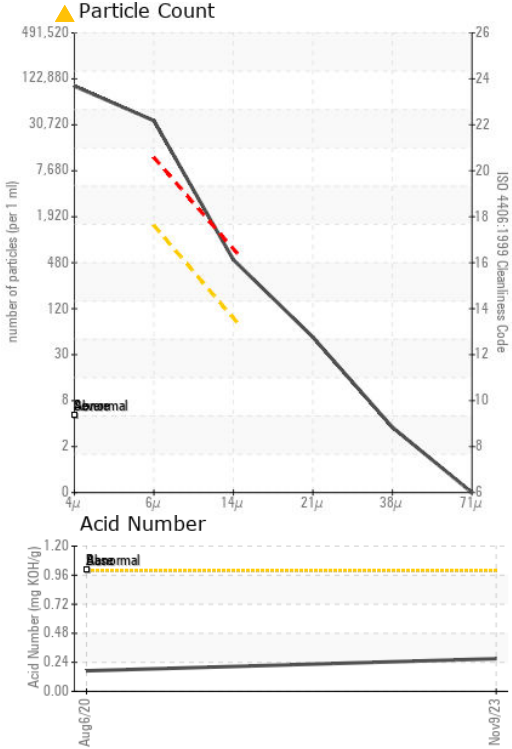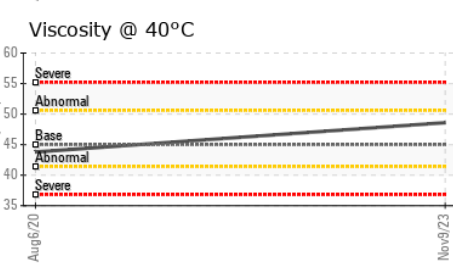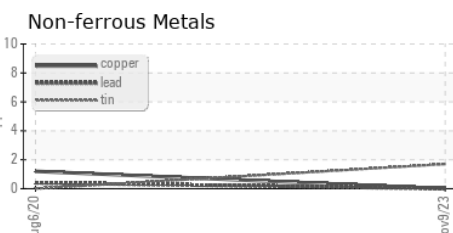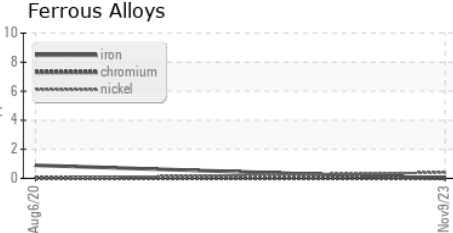

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA009002 **Received** : 20 Nov 2023
Lab Number : 06013371 **Diagnosed** : 22 Nov 2023
Unique Number : 10752515 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

AMAZON
 100 W THOMAS P ECHOLS LN
 SHEPHERDSVILLE, KY
 US 40165
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: