


PROBLEM SUMMARY

Sample Rating Trend



WATER

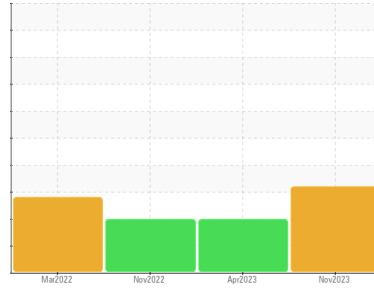


Machine Id
KAESER 7965386

Component
Compressor


Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

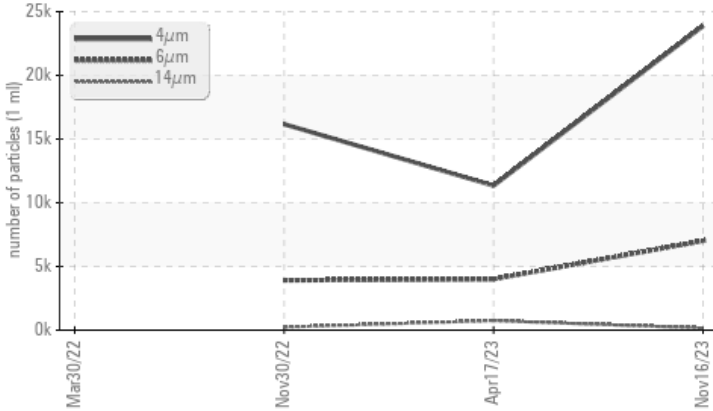

▲ Water (KF)

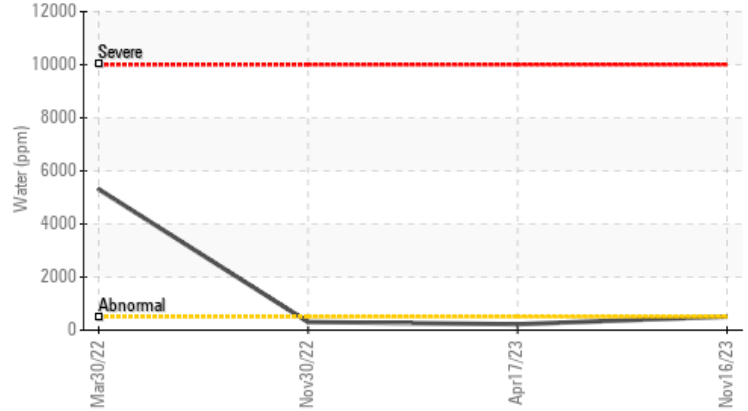

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
Water	%	ASTM D6304	>0.05	▲ 0.051	0.022	0.030
ppm Water	ppm	ASTM D6304	>500	▲ 510.6	221.0	304.7
Particles >6µm		ASTM D7647	>1300	▲ 7009	▲ 4002	▲ 3910
Particles >14µm		ASTM D7647	>80	▲ 161	▲ 747	▲ 234
Particles >21µm		ASTM D7647	>20	▲ 28	▲ 310	▲ 56
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 22/20/15	▲ 21/19/17	▲ 21/19/15

Customer Id: AMAMAD
Sample No.: KCPA011296
Lab Number: 06013382
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.

HISTORICAL DIAGNOSIS

17 Apr 2023 Diag: Jonathan Hester

ISO



Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



30 Nov 2022 Diag: Don Baldrige

ISO



Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



30 Mar 2022 Diag: Don Baldrige

WATER




The filter change at the time of sampling has been noted. We were unable to perform a particle count due to a high concentration of particles present in this sample. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. There is a moderate concentration of water present in the oil. The AN level is acceptable for this fluid.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

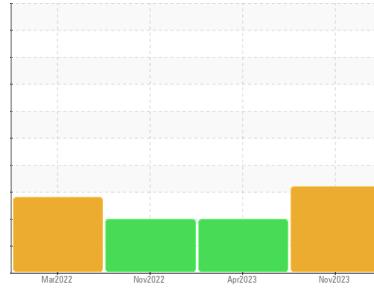

WATER



Machine Id
KAESER 7965386

Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil. There is a trace of moisture present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA011296	KCPA001140	KCP47775D
Sample Date	Client Info		16 Nov 2023	17 Apr 2023	30 Nov 2022
Machine Age	hrs	Client Info	7200	7195	6091
Oil Age	hrs	Client Info	0	0	6091
Oil Changed	Client Info		N/A	Changed	Changed
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	0	<1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	<1	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	<1	<1	<1
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	0	<1	9
Tin	ppm	ASTM D5185m >10	<1	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	0
Barium	ppm	ASTM D5185m 90	79	47	19
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m	0	0	<1
Magnesium	ppm	ASTM D5185m 100	89	81	68
Calcium	ppm	ASTM D5185m 0	3	2	0
Phosphorus	ppm	ASTM D5185m 0	1	3	30
Zinc	ppm	ASTM D5185m 0	0	0	0
Sulfur	ppm	ASTM D5185m 23500	18427	19711	23551

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	0	<1
Sodium	ppm	ASTM D5185m	4	15	21
Potassium	ppm	ASTM D5185m >20	0	<1	2
Water	%	ASTM D6304 >0.05	▲ 0.051	0.022	0.030
ppm Water	ppm	ASTM D6304 >500	▲ 510.6	221.0	304.7






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		23875	11344	16168
Particles >6µm	ASTM D7647	>1300	▲ 7009	▲ 4002	▲ 3910
Particles >14µm	ASTM D7647	>80	▲ 161	▲ 747	▲ 234
Particles >21µm	ASTM D7647	>20	▲ 28	▲ 310	▲ 56
Particles >38µm	ASTM D7647	>4	1	▲ 5	▲ 11
Particles >71µm	ASTM D7647	>3	0	0	1
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 22/20/15	▲ 21/19/17	▲ 21/19/15

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.37	0.32	0.36


OIL ANALYSIS REPORT

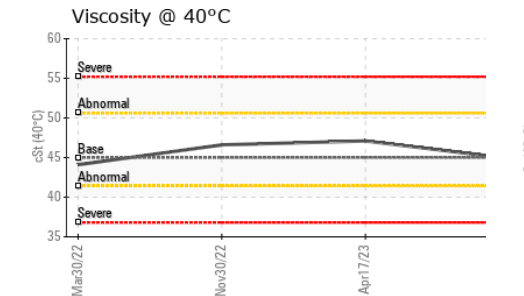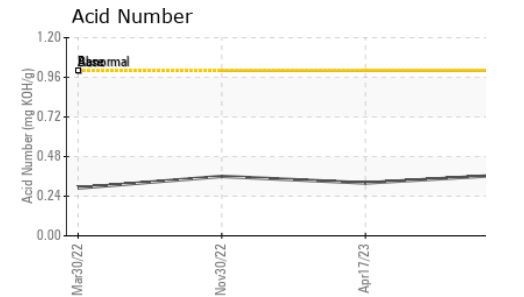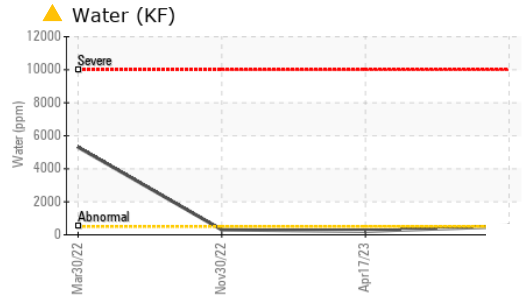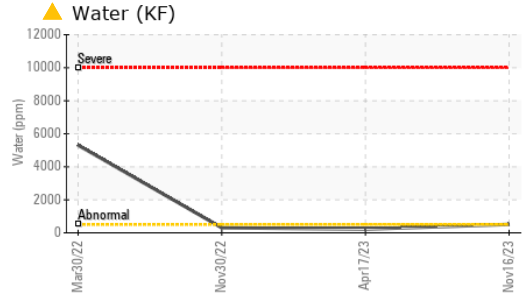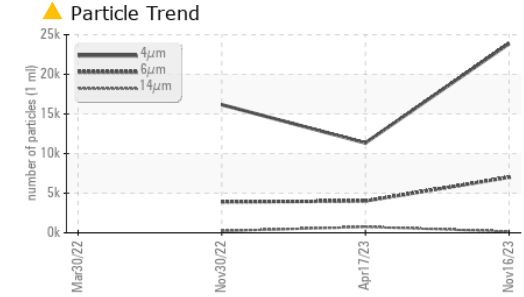






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	44.9	47.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

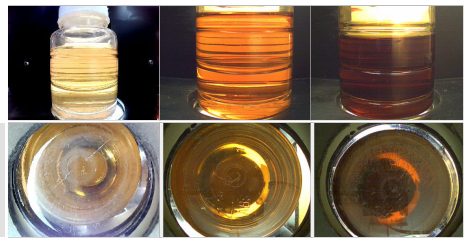

GRAPHS

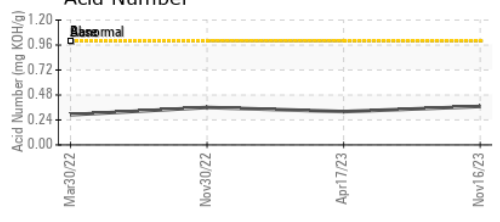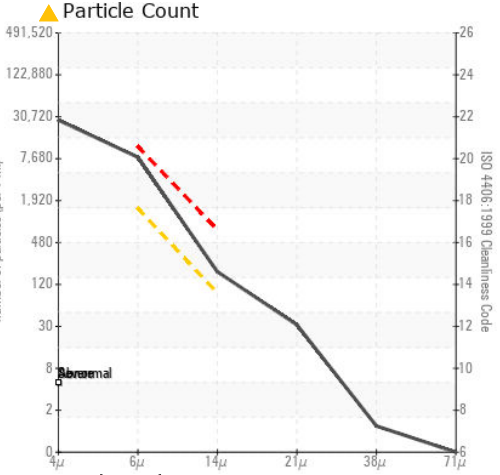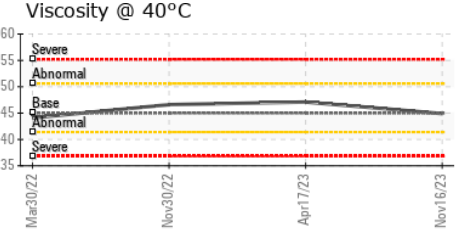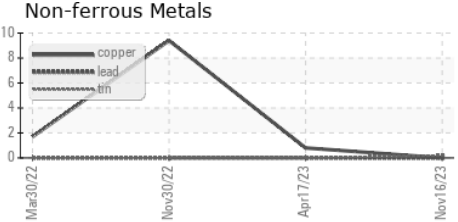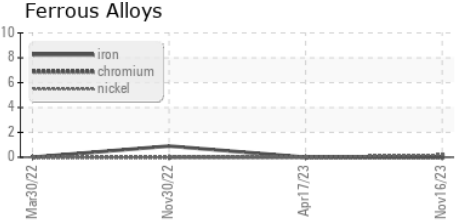

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA011296 **Received** : 20 Nov 2023
Lab Number : 06013382 **Diagnosed** : 22 Nov 2023
Unique Number : 10752526 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

AMAZON.COM SERVICES
 7817 GREENBRIAR RD
 MADISON, AL
 US 35756
 Contact: Service Manager

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: