




# OIL ANALYSIS REPORT

Sample Rating Trend

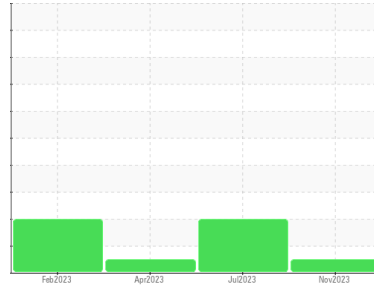

**NORMAL**



Machine Id  
**27248**  
 Component  
**Diesel Engine**  
 Fluid  
**NOT GIVEN (--- QTS)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KL0012076</b>	KL0012053	KLM2339466
Sample Date	Client Info		<b>10 Nov 2023</b>	28 Jul 2023	08 Apr 2023
Machine Age	mls	Client Info	<b>104052</b>	102793	100170
Oil Age	mls	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	ABNORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>5	<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method	>0.2	<b>NEG</b>	NEG	NEG
Glycol	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >100	<b>21</b>	14	48
Chromium	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	2
Nickel	ppm	ASTM D5185m >4	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Silver	ppm	ASTM D5185m >3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >20	<b>3</b>	2	8
Lead	ppm	ASTM D5185m >40	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m >330	<b>&lt;1</b>	0	1
Tin	ppm	ASTM D5185m >15	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>37</b>	72	49
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>63</b>	68	61
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m	<b>1121</b>	1127	1057
Calcium	ppm	ASTM D5185m	<b>992</b>	1030	1007
Phosphorus	ppm	ASTM D5185m	<b>1117</b>	1098	1077
Zinc	ppm	ASTM D5185m	<b>1361</b>	1336	1336
Sulfur	ppm	ASTM D5185m	<b>3573</b>	4199	3933

## CONTAMINANTS





	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>6</b>	4	8
Sodium	ppm	ASTM D5185m	<b>12</b>	3	5
Potassium	ppm	ASTM D5185m >20	<b>21</b>	3	13

## INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844 >3	<b>0.6</b>	0.4	0.8
Nitration	Abs/cm	*ASTM D7624 >20	<b>10.0</b>	8.1	11.3
Sulfation	Abs./1mm	*ASTM D7415 >30	<b>23.2</b>	20.9	25.4



# OIL ANALYSIS REPORT

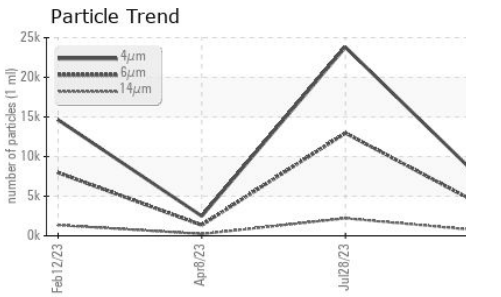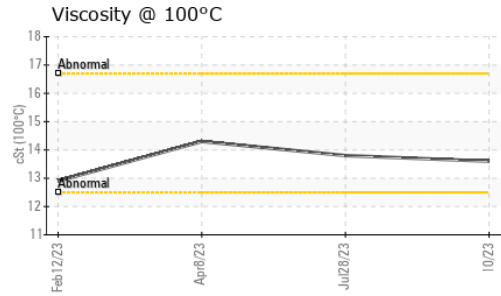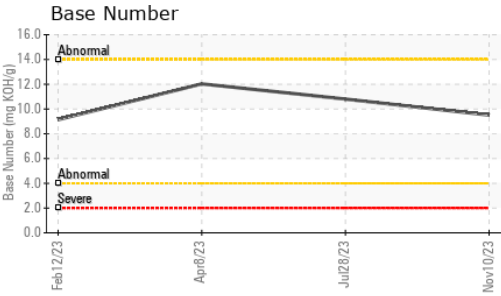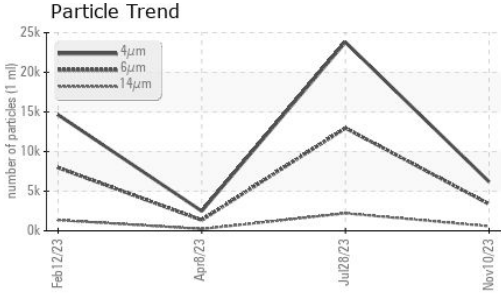






FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>6186</b>	23802	2488
Particles >6µm	ASTM D7647	>5000	<b>3370</b>	▲ 12966	1355
Particles >14µm	ASTM D7647	>640	<b>573</b>	▲ 2207	231
Particles >21µm	ASTM D7647	>160	<b>193</b>	▲ 743	78
Particles >38µm	ASTM D7647	>40	<b>30</b>	▲ 115	12
Particles >71µm	ASTM D7647	>10	<b>3</b>	12	1
Oil Cleanliness	ISO 4406 (c)	>19/16	<b>19/16</b>	▲ 21/18	18/15

FLUID DEGRADATION	method	limit/base	current	history1	history2	
Oxidation	Abs./1mm	*ASTM D7414	>25	<b>22.0</b>	18.2	23.4
Base Number (BN)	mg KOH/g	ASTM D2896		<b>9.51</b>	10.80	12.03

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	<b>13.6</b>	13.8	14.3

## GRAPHS

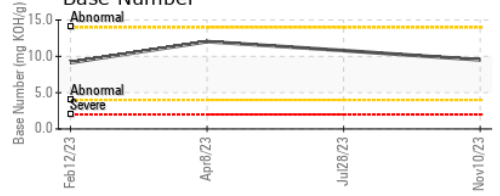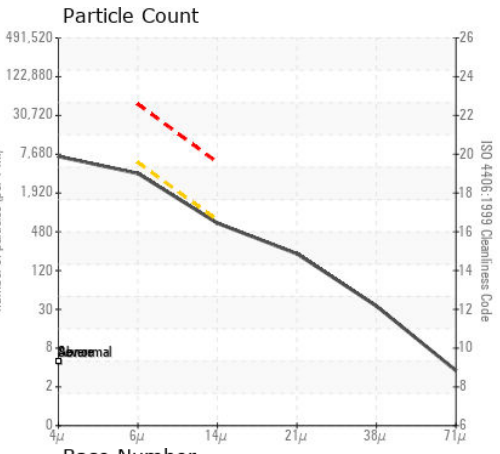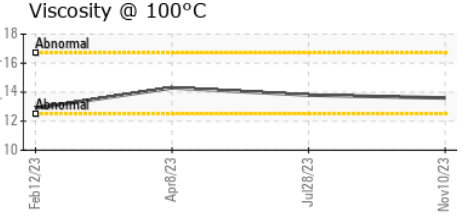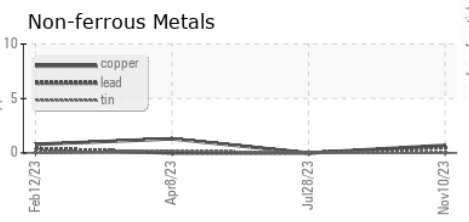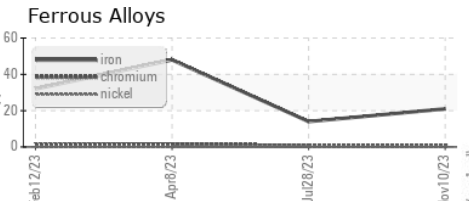

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KL0012076 **Received** : 20 Nov 2023  
**Lab Number** : 06013440 **Diagnosed** : 23 Nov 2023  
**Unique Number** : 10752584 **Diagnostician** : Don Baldrige  
**Test Package** : MOB 2 ( Additional Tests: PrtCount )

**CITY & COUNTY HONOLULU**  
 99-999 IWAENA RD  
 AIEA, HI  
 US 96701  
 Contact: CLYDE OMIJA  
 comija@honolulu.gov  
 T: (575)623-9952  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)