




# OIL ANALYSIS REPORT

Sample Rating Trend

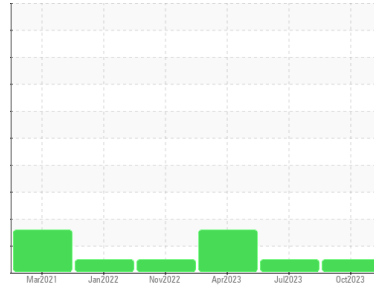

**NORMAL**



Machine Id  
**35163**  
 Component  
**Diesel Engine**  
 Fluid  
**NOT GIVEN (--- QTS)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KL0012069</b>	KL0012064	KLM2339396
Sample Date	Client Info		<b>31 Oct 2023</b>	27 Jul 2023	10 Apr 2023
Machine Age	mls	Client Info	<b>288215</b>	285196	275602
Oil Age	mls	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	ATTENTION

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method	>0.1	<b>NEG</b>	NEG	NEG
Glycol	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >80	<b>3</b>	14	42
Chromium	ppm	ASTM D5185m >6	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185m >2	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m >2	<b>&lt;1</b>	<1	<1
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >20	<b>2</b>	3	9
Lead	ppm	ASTM D5185m >95	<b>&lt;1</b>	0	4
Copper	ppm	ASTM D5185m >85	<b>2</b>	3	11
Tin	ppm	ASTM D5185m >9	<b>0</b>	<1	<1
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>130</b>	40	13
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>62</b>	65	51
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	1
Magnesium	ppm	ASTM D5185m	<b>1169</b>	1142	927
Calcium	ppm	ASTM D5185m	<b>989</b>	1061	1219
Phosphorus	ppm	ASTM D5185m	<b>1148</b>	1058	981
Zinc	ppm	ASTM D5185m	<b>1378</b>	1334	1277
Sulfur	ppm	ASTM D5185m	<b>3767</b>	3905	3498

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>5</b>	6	19
Sodium	ppm	ASTM D5185m	<b>2</b>	5	9
Potassium	ppm	ASTM D5185m >20	<b>3</b>	1	5


## INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	<b>0.1</b>	0.4	0.8
Nitration	Abs/cm	*ASTM D7624 >20	<b>5.9</b>	8.4	11.3
Sulfation	Abs./1mm	*ASTM D7415 >30	<b>19.2</b>	20.8	25.1




# OIL ANALYSIS REPORT


### Particle Trend

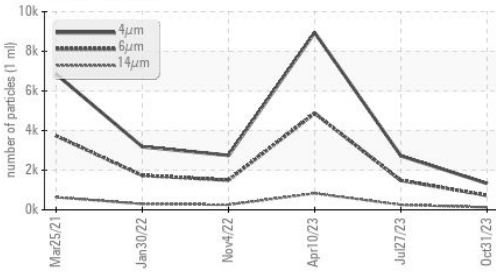


### Base Number

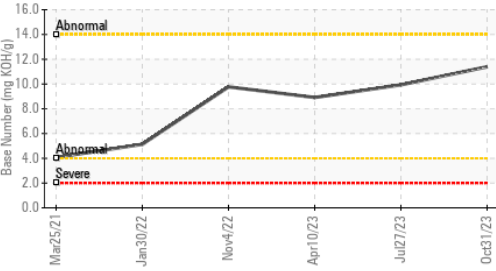

### Viscosity @ 100°C

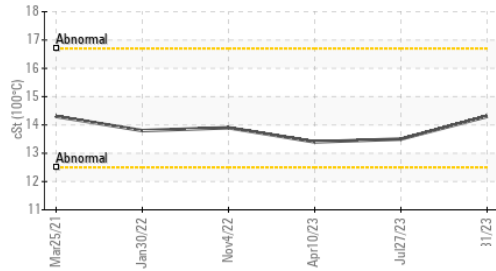

### Particle Trend

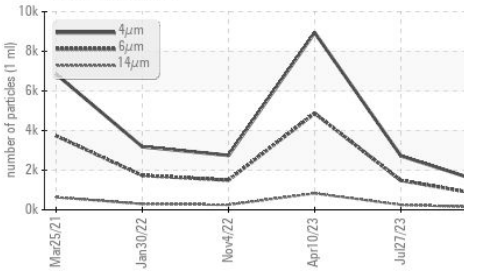

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>1331</b>	2723	8943
Particles >6µm	ASTM D7647	>5000	<b>725</b>	1483	4872
Particles >14µm	ASTM D7647	>640	<b>123</b>	252	▲ 829
Particles >21µm	ASTM D7647	>160	<b>42</b>	85	▲ 279
Particles >38µm	ASTM D7647	>40	<b>6</b>	13	▲ 43
Particles >71µm	ASTM D7647	>10	<b>1</b>	1	4
Oil Cleanliness	ISO 4406 (c)	>19/16	<b>17/14</b>	18/15	▲ 19/17


FLUID DEGRADATION	method	limit/base	current	history1	history2	
Oxidation	Abs./1mm	*ASTM D7414	>25	<b>15.0</b>	17.8	21.0
Base Number (BN)	mg KOH/g	ASTM D2896		<b>11.39</b>	9.93	8.91

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	NEG	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	<b>14.3</b>	13.5	13.4

### GRAPHS


#### Ferrous Alloys

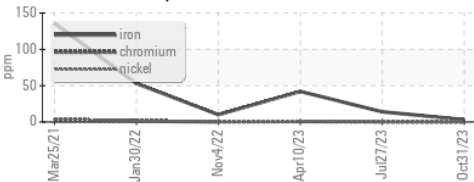


#### Non-ferrous Metals

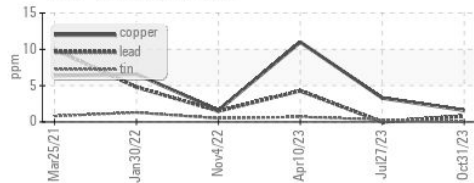


#### Viscosity @ 100°C

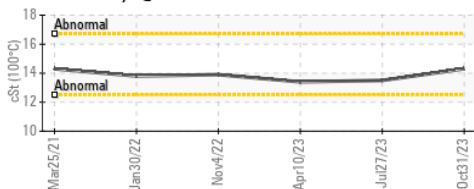

#### Particle Count

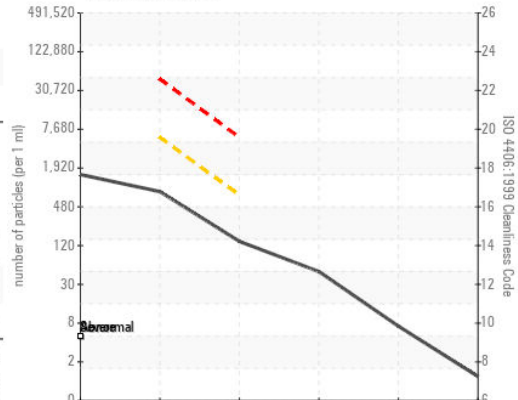

#### Base Number

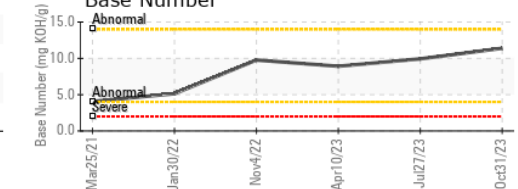

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KL0012069 **Received** : 20 Nov 2023  
**Lab Number** : 06013472 **Diagnosed** : 23 Nov 2023  
**Unique Number** : 10752616 **Diagnostician** : Don Baldrige  
**Test Package** : MOB 2 ( Additional Tests: PrtCount )

**CITY & COUNTY HONOLULU**  
 99-999 IWAENA RD  
 AIEA, HI  
 US 96701  
 Contact: CLYDE OMIJA  
 comija@honolulu.gov  
 T: (575)623-9952  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)