




OIL ANALYSIS REPORT

Sample Rating Trend

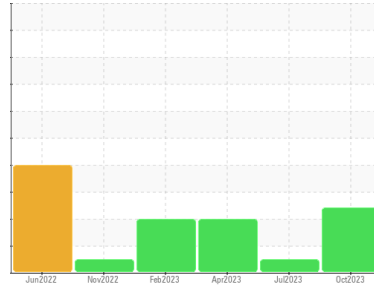

ISO



Machine Id
27329
 Component
Diesel Engine
 Fluid
NOT GIVEN (--- GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KL0012082	KL0012016	KLM2339438
Sample Date	Client Info		31 Oct 2023	27 Jul 2023	09 Apr 2023
Machine Age	mls	Client Info	30552	27527	25157
Oil Age	mls	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	NORMAL	ATTENTION

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>5	<1.0	<1.0	<1.0
Water	WC Method	>0.2	NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >100	13	46	28
Chromium	ppm	ASTM D5185m >20	<1	1	<1
Nickel	ppm	ASTM D5185m >4	0	0	0
Titanium	ppm	ASTM D5185m	<1	<1	<1
Silver	ppm	ASTM D5185m >3	0	<1	<1
Aluminum	ppm	ASTM D5185m >20	4	18	15
Lead	ppm	ASTM D5185m >40	<1	0	0
Copper	ppm	ASTM D5185m >330	6	30	26
Tin	ppm	ASTM D5185m >15	0	<1	<1
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	77	30	57
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	60	64	61
Manganese	ppm	ASTM D5185m	<1	<1	<1
Magnesium	ppm	ASTM D5185m	1130	1136	1146
Calcium	ppm	ASTM D5185m	1000	1036	1018
Phosphorus	ppm	ASTM D5185m	1122	1020	1071
Zinc	ppm	ASTM D5185m	1359	1342	1352
Sulfur	ppm	ASTM D5185m	3557	3573	3893

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	4	7	6
Sodium	ppm	ASTM D5185m	3	6	4
Potassium	ppm	ASTM D5185m >20	8	40	38


INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844 >3	0.4	1	0.7
Nitration	Abs/cm	*ASTM D7624 >20	7.2	10.5	9.0
Sulfation	Abs/.1mm	*ASTM D7415 >30	21.0	24.6	24.1




OIL ANALYSIS REPORT


▲ Particle Trend

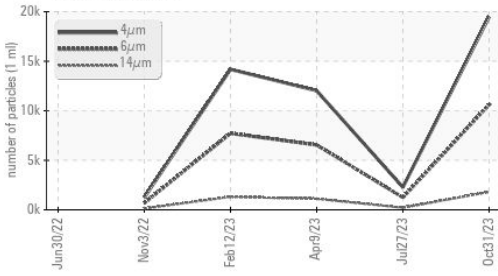


▲ Particle Trend

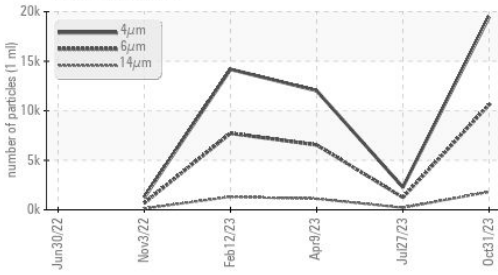

Base Number

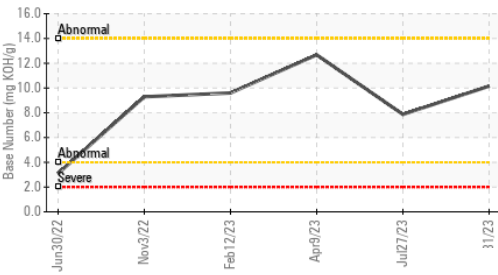

Viscosity @ 100°C

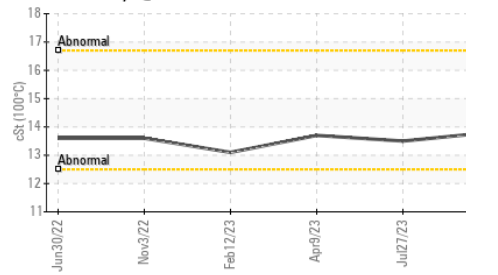

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		19479	2279	12023
Particles >6µm	ASTM D7647	>5000	▲ 10611	1242	▲ 6550
Particles >14µm	ASTM D7647	>640	▲ 1806	211	▲ 1115
Particles >21µm	ASTM D7647	>160	▲ 608	71	▲ 375
Particles >38µm	ASTM D7647	>40	▲ 94	11	▲ 58
Particles >71µm	ASTM D7647	>10	▲ 10	1	6
Oil Cleanliness	ISO 4406 (c)	>19/16	▲ 21/18	17/15	▲ 20/17


FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs./1mm *ASTM D7414	>25	18.3	25.1	22.2
Base Number (BN)	mg KOH/g ASTM D2896		10.15	7.87	12.68

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar *Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar *Visual	NONE	NONE	NONE	NONE
Precipitate	scalar *Visual	NONE	NONE	NONE	NONE
Silt	scalar *Visual	NONE	NONE	NONE	NONE
Debris	scalar *Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar *Visual	NONE	NONE	NONE	NONE
Appearance	scalar *Visual	NORML	NORML	NORML	NORML
Odor	scalar *Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar *Visual	>0.2	NEG	NEG	NEG
Free Water	scalar *Visual		NEG	NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt ASTM D445		13.8	13.5	13.7

GRAPHS


Ferrous Alloys

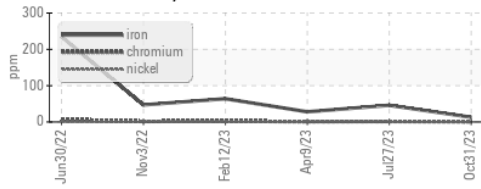


Non-ferrous Metals

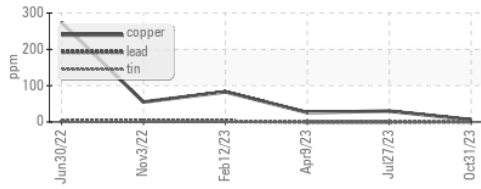


Viscosity @ 100°C

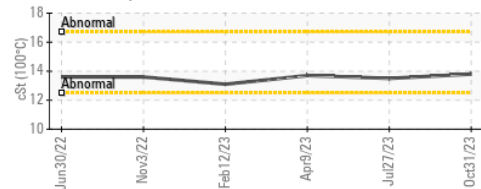

▲ Particle Count

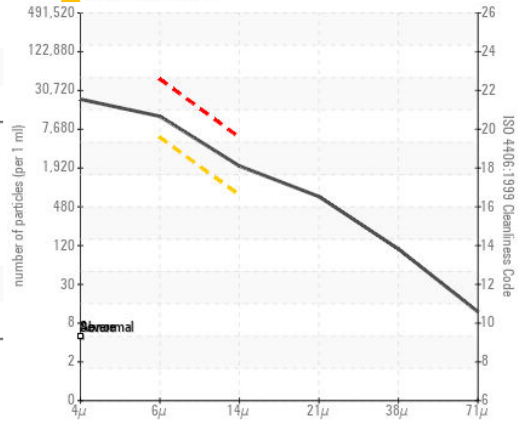

Base Number

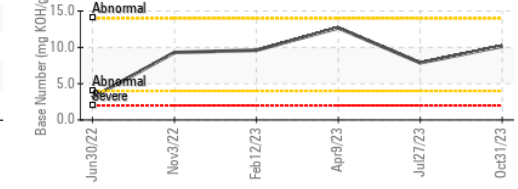

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KL0012082 **Received** : 20 Nov 2023
Lab Number : 06013475 **Diagnosed** : 23 Nov 2023
Unique Number : 10752619 **Diagnostician** : Don Baldrige
Test Package : MOB 2 (Additional Tests: PrtCount)

CITY & COUNTY HONOLULU
 99-999 IWAENA RD
 AIEA, HI
 US 96701
 Contact: CLYDE OMIJA
 comija@honolulu.gov
 T: (575)623-9952
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)