




# OIL ANALYSIS REPORT

Sample Rating Trend

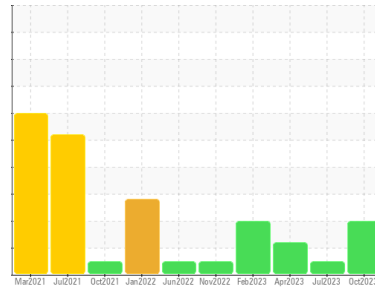

ISO



Machine Id  
**27306**  
 Component  
**Diesel Engine**  
 Fluid  
**NOT GIVEN (--- GAL)**

## DIAGNOSIS

### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>KL0012079</b>	KL0011946	KLM2339303
Sample Date	Client Info	<b>31 Oct 2023</b>	27 Jul 2023	10 Apr 2023
Machine Age	hrs	<b>47600</b>	43845	40256
Oil Age	hrs	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>ABNORMAL</b>	NORMAL	ATTENTION

## CONTAMINATION

method	limit/base	current	history1	history2
Fuel	WC Method >5	<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method >0.2	<b>NEG</b>	NEG	NEG
Glycol	WC Method	<b>NEG</b>	NEG	NEG

## WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >100	<b>25</b>	63	33
Chromium	ppm ASTM D5185m >20	<b>1</b>	2	1
Nickel	ppm ASTM D5185m >4	<b>0</b>	0	0
Titanium	ppm ASTM D5185m	<b>&lt;1</b>	<1	<1
Silver	ppm ASTM D5185m >3	<b>0</b>	<1	<1
Aluminum	ppm ASTM D5185m >20	<b>4</b>	11	9
Lead	ppm ASTM D5185m >40	<b>&lt;1</b>	0	<1
Copper	ppm ASTM D5185m >330	<b>2</b>	6	7
Tin	ppm ASTM D5185m >15	<b>&lt;1</b>	<1	<1
Vanadium	ppm ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	<b>38</b>	20	30
Barium	ppm ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm ASTM D5185m	<b>62</b>	61	52
Manganese	ppm ASTM D5185m	<b>&lt;1</b>	<1	<1
Magnesium	ppm ASTM D5185m	<b>1147</b>	1045	969
Calcium	ppm ASTM D5185m	<b>1018</b>	1213	1122
Phosphorus	ppm ASTM D5185m	<b>1122</b>	1087	999
Zinc	ppm ASTM D5185m	<b>1377</b>	1399	1328
Sulfur	ppm ASTM D5185m	<b>3556</b>	4105	3838

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >25	<b>6</b>	9	7
Sodium	ppm ASTM D5185m	<b>5</b>	7	4
Potassium	ppm ASTM D5185m >20	<b>6</b>	12	12


## INFRA-RED

method	limit/base	current	history1	history2
Soot %	% *ASTM D7844 >3	<b>0.7</b>	1.3	0.9
Nitration	Abs/cm *ASTM D7624 >20	<b>10.4</b>	12.4	10.6
Sulfation	Abs/.1mm *ASTM D7415 >30	<b>24.5</b>	28.7	25.1




# OIL ANALYSIS REPORT


▲ Particle Trend

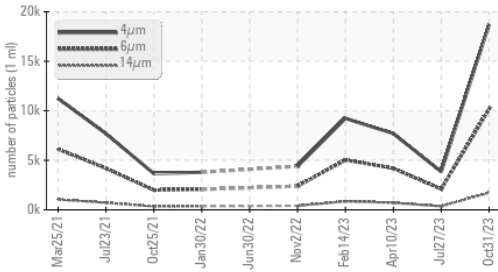


▲ Particle Trend

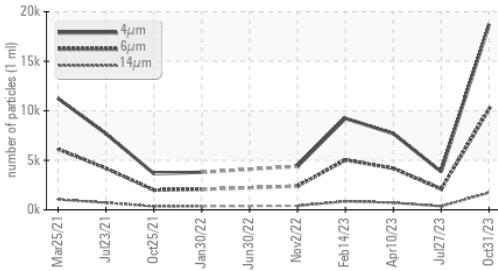

Base Number

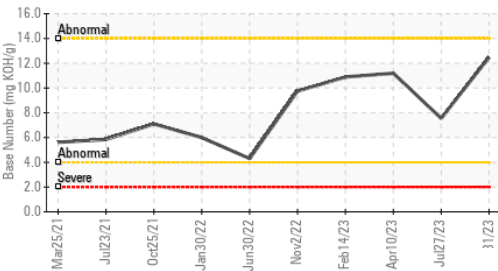

Viscosity @ 100°C

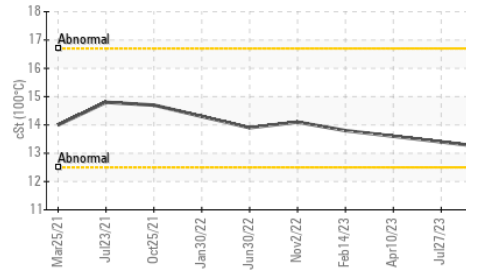

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>18696</b>	3845	7699
Particles >6µm	ASTM D7647	>5000	▲ <b>10185</b>	2095	4194
Particles >14µm	ASTM D7647	>640	▲ <b>1733</b>	356	▲ 714
Particles >21µm	ASTM D7647	>160	▲ <b>584</b>	120	▲ 240
Particles >38µm	ASTM D7647	>40	▲ <b>90</b>	19	37
Particles >71µm	ASTM D7647	>10	<b>9</b>	2	4
Oil Cleanliness	ISO 4406 (c)	>19/16	▲ <b>21/18</b>	18/16	▲ 19/17


FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm *ASTM D7414	>25	<b>24.8</b>	29.8	23.7
Base Number (BN)	mg KOH/g ASTM D2896		<b>12.48</b>	7.55	11.19

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar *Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar *Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar *Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar *Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar *Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar *Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar *Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar *Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar *Visual	>0.2	<b>NEG</b>	NEG	NEG
Free Water	scalar *Visual		<b>NEG</b>	NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt ASTM D445		<b>13.2</b>	13.4	13.6

## GRAPHS


Ferrous Alloys

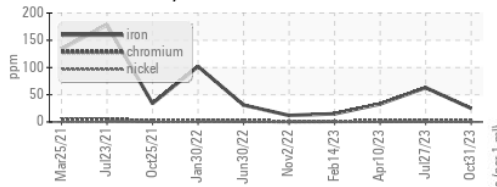


Non-ferrous Metals

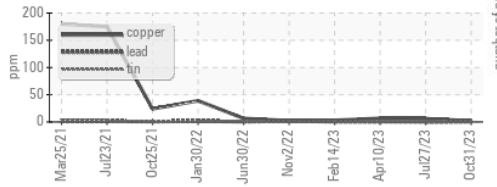


Viscosity @ 100°C

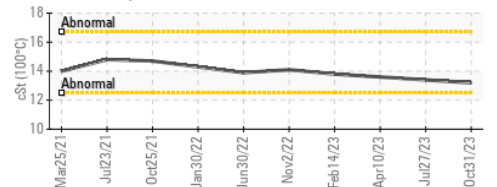

▲ Particle Count

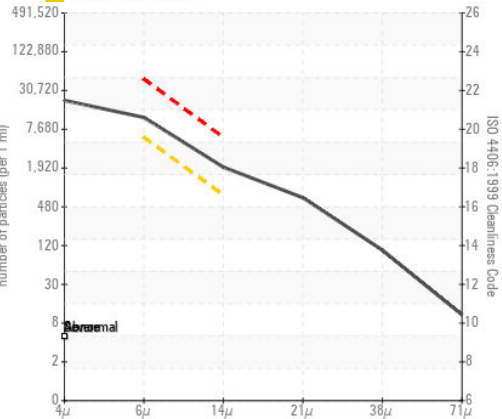

Base Number

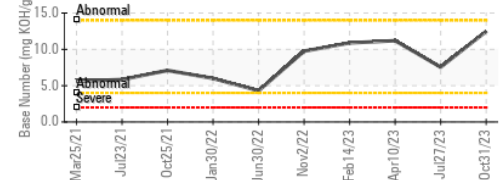

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : KL0012079 Received : 20 Nov 2023  
 Lab Number : 06013478 Diagnosed : 23 Nov 2023  
 Unique Number : 10752622 Diagnostician : Don Baldrige  
 Test Package : MOB 2 ( Additional Tests: PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

CITY & COUNTY HONOLULU

99-999 IWAENA RD  
 AIEA, HI  
 US 96701

Contact: CLYDE OMIJA  
 comija@honolulu.gov

T: (575)623-9952

F: