




OIL ANALYSIS REPORT



Machine Id
Westchester def hutch 6ej01191
 Component
Diesel Engine
 Fluid
DIESEL ENGINE OIL SAE 15W40 (--- GAL)

Sample Rating Trend

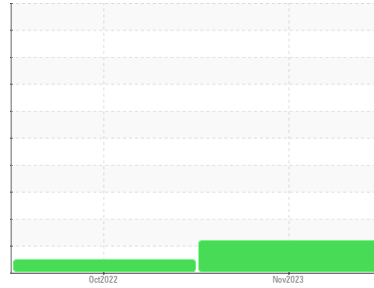

FUEL



DIAGNOSIS

Recommendation

We recommend that you drain the oil from the component if this has not already been done. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of fuel present in the oil. Tests confirm the presence of fuel in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. Fuel is present in the oil and is lowering the viscosity. The oil is no longer serviceable due to the presence of contaminants.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0878316	WC0748986	---
Sample Date	Client Info		20 Nov 2023	31 Oct 2022	---
Machine Age	hrs	Client Info	0	666	---
Oil Age	hrs	Client Info	0	10	---
Oil Changed	Client Info		N/A	Changed	---
Sample Status			ABNORMAL	NORMAL	---

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.2	NEG	NEG	---
Glycol	WC Method		NEG	NEG	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >100	<1	<1	---
Chromium	ppm	ASTM D5185m >20	0	0	---
Nickel	ppm	ASTM D5185m >2	<1	0	---
Titanium	ppm	ASTM D5185m >2	<1	2	---
Silver	ppm	ASTM D5185m >2	0	<1	---
Aluminum	ppm	ASTM D5185m >25	1	<1	---
Lead	ppm	ASTM D5185m >40	<1	<1	---
Copper	ppm	ASTM D5185m >330	<1	<1	---
Tin	ppm	ASTM D5185m >15	<1	<1	---
Vanadium	ppm	ASTM D5185m	0	0	---
Cadmium	ppm	ASTM D5185m	0	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 250	12	35	---
Barium	ppm	ASTM D5185m 10	0	0	---
Molybdenum	ppm	ASTM D5185m 100	54	53	---
Manganese	ppm	ASTM D5185m	<1	<1	---
Magnesium	ppm	ASTM D5185m 450	896	758	---
Calcium	ppm	ASTM D5185m 3000	993	1230	---
Phosphorus	ppm	ASTM D5185m 1150	919	934	---
Zinc	ppm	ASTM D5185m 1350	1154	1119	---
Sulfur	ppm	ASTM D5185m 4250	2930	3616	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	3	3	---
Sodium	ppm	ASTM D5185m >158	0	2	---
Potassium	ppm	ASTM D5185m >20	2	0	---
Fuel	%	ASTM D3524 >5	▲ 6.8	<1.0	---

INFRA-RED


	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844 >3	0	0.1	---
Nitration	Abs/cm	*ASTM D7624 >20	5.0	6.1	---
Sulfation	Abs/.1mm	*ASTM D7415 >30	17.1	19.3	---

FLUID DEGRADATION


	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	12.8	14.5	---
Base Number (BN)	mg KOH/g	ASTM D2896 8.5	9.7	10.6	---




OIL ANALYSIS REPORT

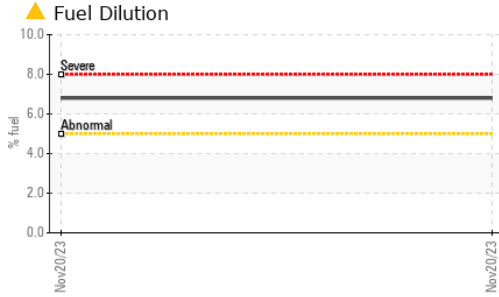









VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---
Free Water	scalar	*Visual		NEG	---

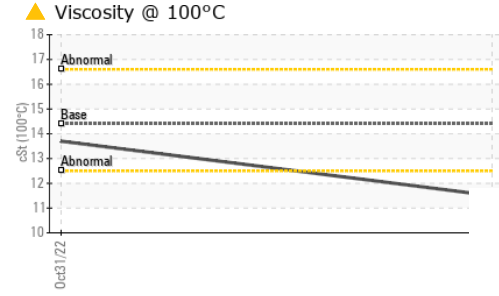

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	14.4	▲ 11.5	13.7	---

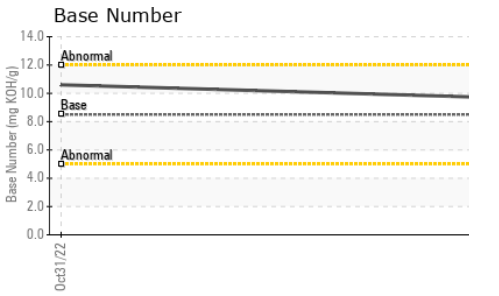

GRAPHS

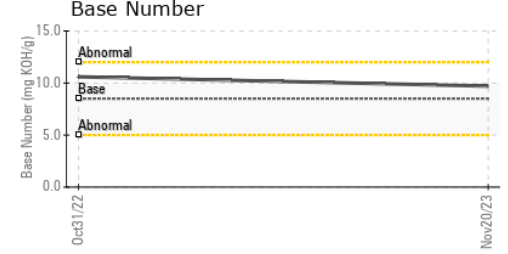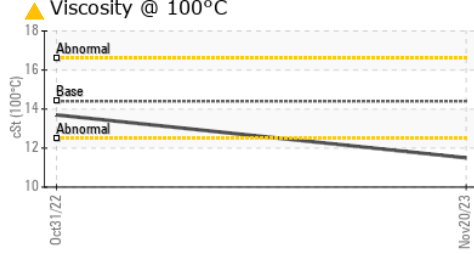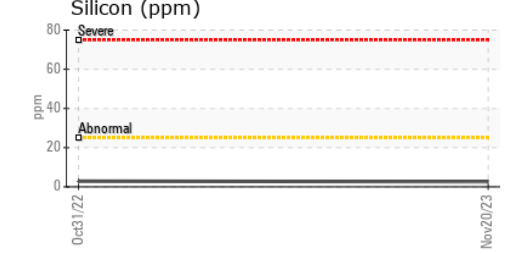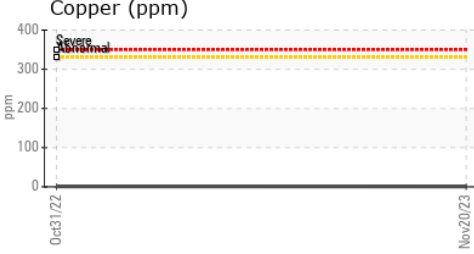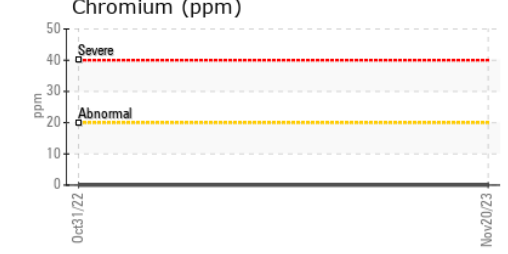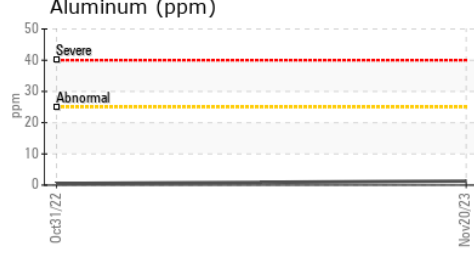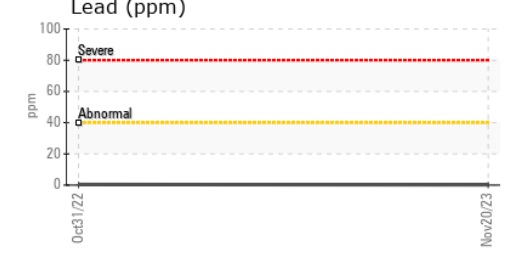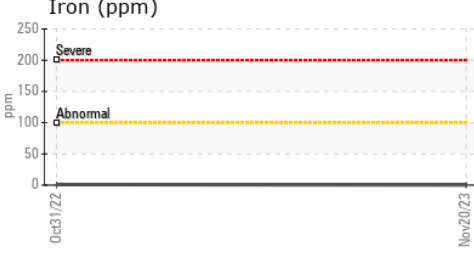

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0878316 **Received** : 21 Nov 2023
Lab Number : 06013716 **Diagnosed** : 24 Nov 2023
Unique Number : 10752860 **Diagnostician** : Wes Davis
Test Package : MOB 1 (Additional Tests: FuelDilution, PercentFuel, TBN)

GEN TECH LTD
 3017 RT 9W
 NEW WINDSOR, NY
 US 12553
 Contact: JOE SAYEGH
 joe@gentechltd.com
 T: (845)568-0500
 F: (845)568-3073

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)