




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

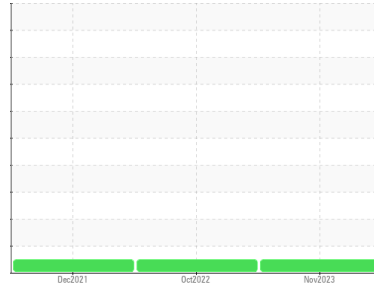

Machine Id  
**Westchester def bradhurst water tower 3005498294**

Component  
**Diesel Engine**

Fluid  
**DIESEL ENGINE OIL SAE 15W40 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

Metal levels are typical for a new component breaking in.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0834510</b>	WC0699398	WC0612446
Sample Date	Client Info		<b>13 Nov 2023</b>	20 Oct 2022	06 Dec 2021
Machine Age	hrs	Client Info	<b>168</b>	0	130
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	Changed	Changed
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>5	<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method	>0.2	<b>NEG</b>	NEG	NEG
Glycol	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >100	<b>0</b>	1	3
Chromium	ppm	ASTM D5185m >20	<b>0</b>	<1	<1
Nickel	ppm	ASTM D5185m >4	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >20	<b>2</b>	<1	2
Lead	ppm	ASTM D5185m >40	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m >330	<b>0</b>	<1	2
Tin	ppm	ASTM D5185m >15	<b>&lt;1</b>	0	0
Antimony	ppm	ASTM D5185m	<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 250	<b>15</b>	30	6
Barium	ppm	ASTM D5185m 10	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 100	<b>59</b>	61	60
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m 450	<b>914</b>	761	911
Calcium	ppm	ASTM D5185m 3000	<b>1107</b>	1254	1254
Phosphorus	ppm	ASTM D5185m 1150	<b>977</b>	989	1104
Zinc	ppm	ASTM D5185m 1350	<b>1234</b>	1194	1360
Sulfur	ppm	ASTM D5185m 4250	<b>3155</b>	3845	3377

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>4</b>	4	4
Sodium	ppm	ASTM D5185m >158	<b>0</b>	1	1
Potassium	ppm	ASTM D5185m >20	<b>1</b>	0	1

## INFRA-RED



	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844 >3	<b>0.1</b>	0.1	0.1
Nitration	Abs/cm	*ASTM D7624 >20	<b>4.8</b>	5.6	5
Sulfation	Abs/.1mm	*ASTM D7415 >30	<b>17.4</b>	18.9	19.6

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	<b>12.9</b>	13.8	14.6
Base Number (BN)	mg KOH/g	ASTM D2896 8.5	<b>9.5</b>	10.5	11











# OIL ANALYSIS REPORT

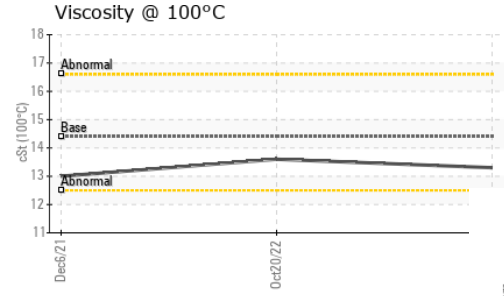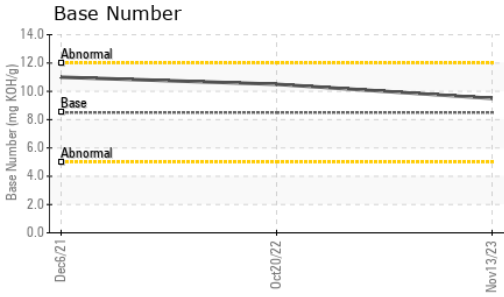

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	14.4	<b>13.3</b>	13.6	13.0

### GRAPHS

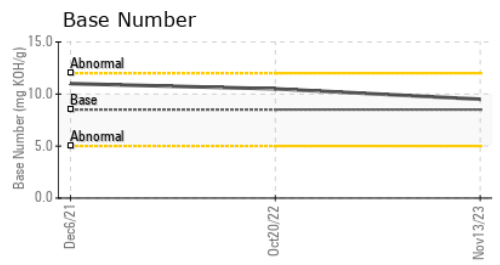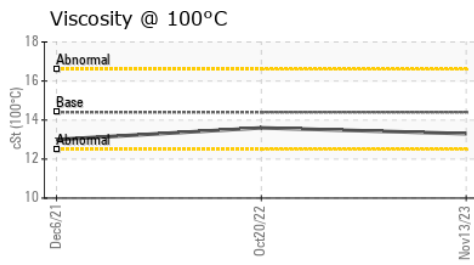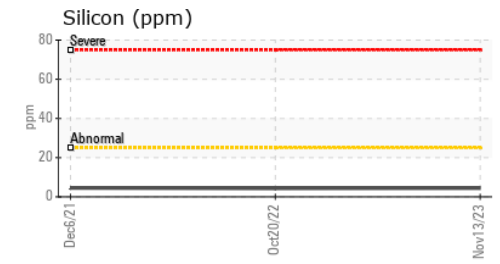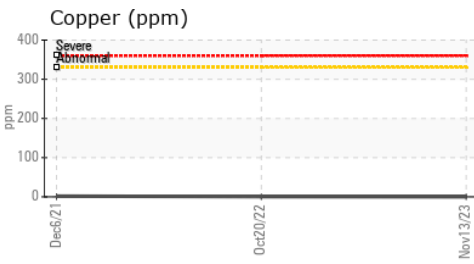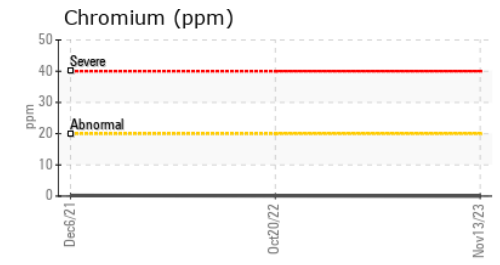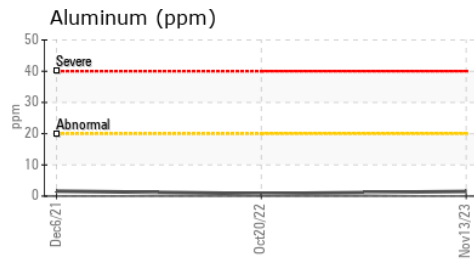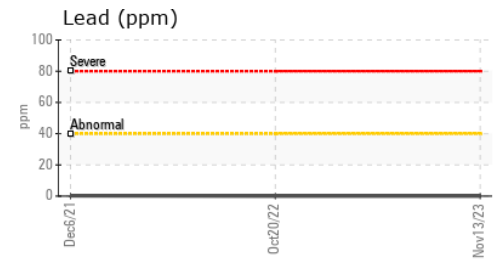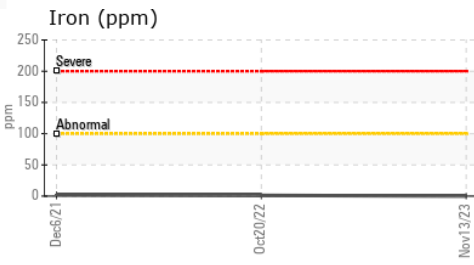

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0834510 **Received** : 21 Nov 2023  
**Lab Number** : **06013718** **Diagnosed** : 22 Nov 2023  
**Unique Number** : 10752862 **Diagnostician** : Wes Davis  
**Test Package** : MOB 1 ( Additional Tests: TBN )

**GEN TECH LTD**  
 3017 RT 9W  
 NEW WINDSOR, NY  
 US 12553  
 Contact: JOE SAYEGH  
 joe@gentechltd.com  
 T: (845)568-0500  
 F: (845)568-3073

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)