




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

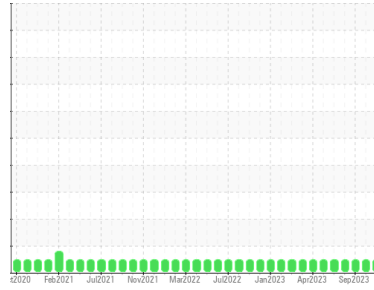

Machine Id  
**TURBO EXPANDER**

Component  
**Hydraulic System**

Fluid  
**MOBIL DTE OIL LIGHT (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.  
NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

### Wear

All component wear rates are normal.

### Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0820269</b>	WC0820268	WC0820285
Sample Date	Client Info			<b>14 Nov 2023</b>	03 Oct 2023	07 Sep 2023
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed		Client Info		<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	1
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>20	<b>2</b>	0	0
Lead	ppm	ASTM D5185m	>20	<b>0</b>	<1	<1
Copper	ppm	ASTM D5185m	>20	<b>9</b>	8	7
Tin	ppm	ASTM D5185m	>20	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	<1	0
Molybdenum	ppm	ASTM D5185m		<b>2</b>	2	<1
Manganese	ppm	ASTM D5185m		<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m		<b>1</b>	1	3
Calcium	ppm	ASTM D5185m		<b>5</b>	5	4
Phosphorus	ppm	ASTM D5185m		<b>119</b>	103	112
Zinc	ppm	ASTM D5185m		<b>68</b>	73	70
Sulfur	ppm	ASTM D5185m		<b>432</b>	464	563






CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	<1
Sodium	ppm	ASTM D5185m		<b>0</b>	0	1
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	<1
Water	%	ASTM D6304	>0.05	<b>0.005</b>	0.001	0.004
ppm Water	ppm	ASTM D6304	>500	<b>55</b>	14.3	48.4

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	<b>675</b>	459	349
Particles >6µm		ASTM D7647	>1300	<b>203</b>	124	85
Particles >14µm		ASTM D7647	>160	<b>18</b>	13	4
Particles >21µm		ASTM D7647	>40	<b>5</b>	4	1
Particles >38µm		ASTM D7647	>10	<b>0</b>	1	0
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>19/17/14	<b>17/15/11</b>	16/14/11	16/14/9

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.12</b>	0.14	0.13




# OIL ANALYSIS REPORT

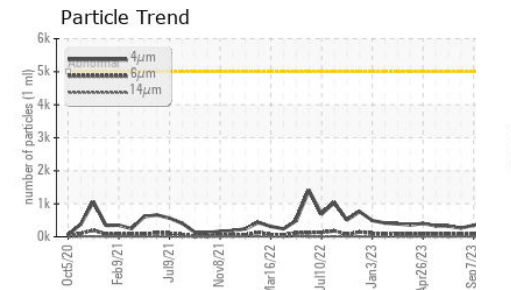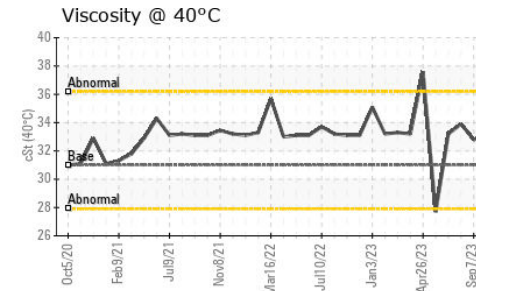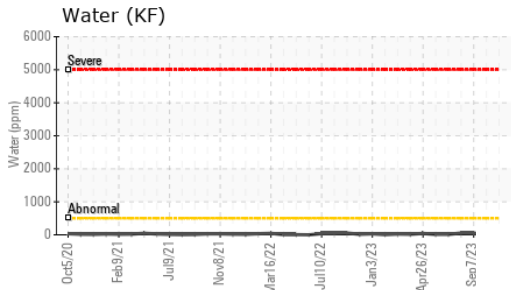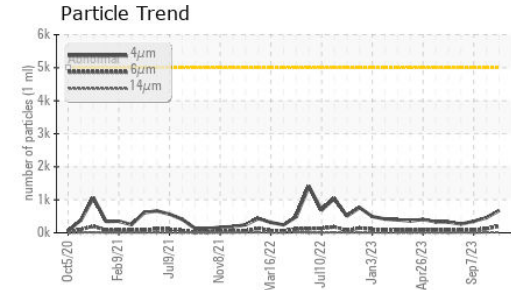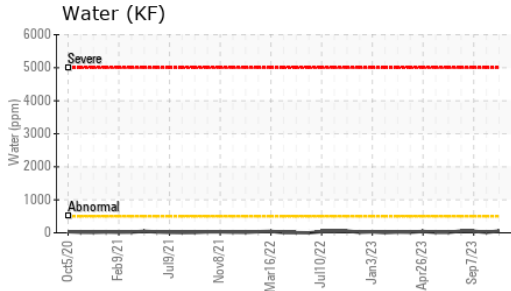






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 31	<b>34.8</b>	33.1	32.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

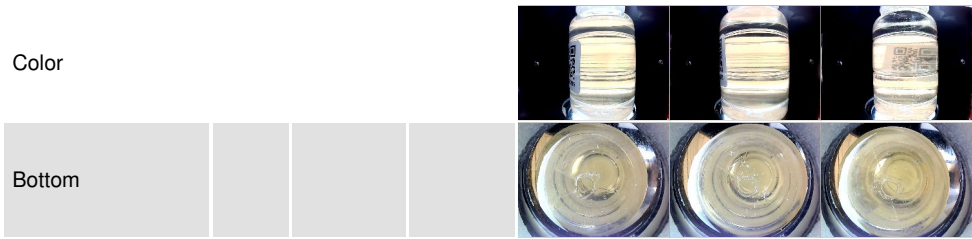

## GRAPHS

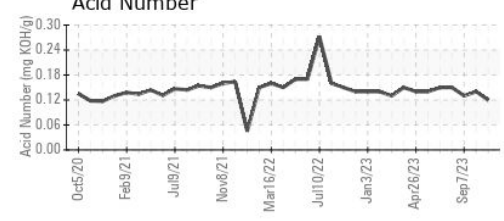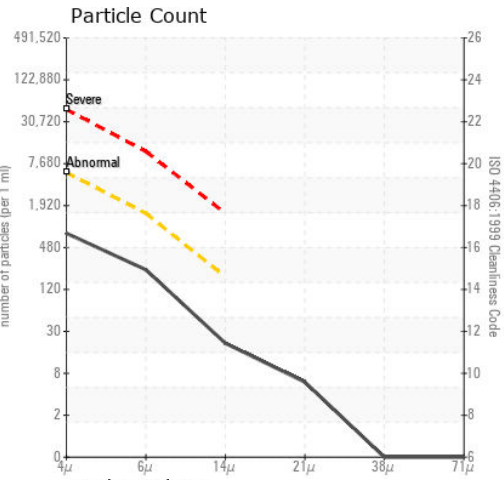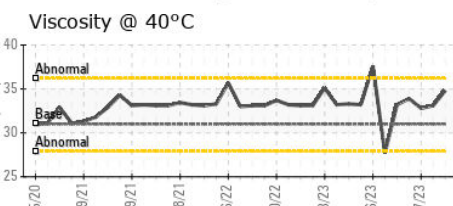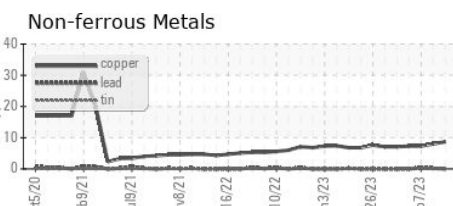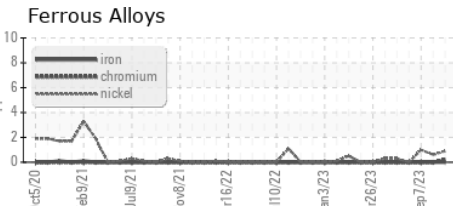

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0820269 **Received** : 21 Nov 2023  
**Lab Number** : 06014049 **Diagnosed** : 22 Nov 2023  
**Unique Number** : 10753193 **Diagnostician** : Wes Davis  
**Test Package** : IND 2 ( Additional Tests: KF )

**UGI ENERGY SERVICES - LNG FACILITY**  
 80 ENERGY LN  
 MESHOPPEN, PA  
 US 18630  
 Contact: JOE BARRETT  
 jbarrett@ugies.com  
 T:  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)