

No relevant graphs to display

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

PROBLEMATIC TEST RESULTS							
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL	
Silt	scalar	*Visual	NONE	🔺 MODER	A MODER	A MODER	

Customer Id: CAREMP Sample No.: USP242293 Lab Number: 06014051 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 dougb@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS						
Action	Status	Date	Done By	Description		
Change Filter			?	We recommend you service the filters on this component.		
Alert			?	We were unable to perform a particle count due to a high concentration of particles present in this sample.		

#### HISTORICAL DIAGNOSIS



#### 22 Oct 2023 Diag: Doug Bogart

We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.All component wear rates are normal. There is a moderate amount of visible silt present in the sample. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



view report

#### 17 Jul 2023 Diag: Doug Bogart



We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.All component wear rates are normal. There is a moderate amount of visible silt present in the sample. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

#### 13 Mar 2023 Diag: Doug Bogart





Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.







### **OIL ANALYSIS REPORT**

# Sample Rating Trend SEDIMENT

**F-103 (S/N FF2271U01311)** 

Air Compressor Fluid USPI MAX FG AIR 46 (--- GAL)

#### DIAGNOSIS

#### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

#### Wear

All component wear rates are normal.

#### Contamination

There is a moderate amount of visible silt present in the sample.

#### Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP242293	USPM23252	USPM17563
Sample Date		Client Info		14 Nov 2023	22 Oct 2023	17 Jul 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>4	<1	0	0
Nickel	ppm	ASTM D5185m	>4	<1	<1	0
Titanium	ppm	ASTM D5185m		<1	0	<1
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	0	<1
Lead	ppm	ASTM D5185m	>20	0	0	0
Copper	ppm	ASTM D5185m	>40	<1	0	<1
Tin	ppm	ASTM D5185m	>5	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	<1
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	0	5	0	0
Molybdenum	ppm	ASTM D5185m	0	<1	0	0
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m	0	0	0	<1
Calcium	ppm	ASTM D5185m	0	0	1	0
Phosphorus	ppm	ASTM D5185m	0	1	<1	<1
Zinc	ppm	ASTM D5185m	0	0	0	0
Sulfur	ppm	ASTM D5185m	0	0	0	0
CONTAMINANTS	6	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	<1	<1
Sodium	ppm	ASTM D5185m		0	0	0
Potassium	ppm	ASTM D5185m	>20	<1	<1	0
Water	%	ASTM D6304	>0.6	0.020	0.015	0.018
ppm Water	ppm	ASTM D6304	>6000	202	150.9	182.8
FLUID CLEANLIN	NESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000			
Particles >6µm		ASTM D7647	>2500			
Particles >14µm		ASTM D7647	>320			
Particles >21µm		ASTM D7647				
Particles >38µm		ASTM D7647	>20			
Particles >71µm		ASTM D7647	>4			
Oil Cleanliness		ISO 4406 (c)	>20/18/15			
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.16	0.16	0.15	0.17


Contact/Location: SHAWN ANDERS - CAREMP



## **OIL ANALYSIS REPORT**








VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	A MODER	🔺 MODER	A MODER
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.6	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45.8	47.4	50.3	46.9
SAMPLE IMAGES		method	limit/base	current	history1	history2

Color



Bottom

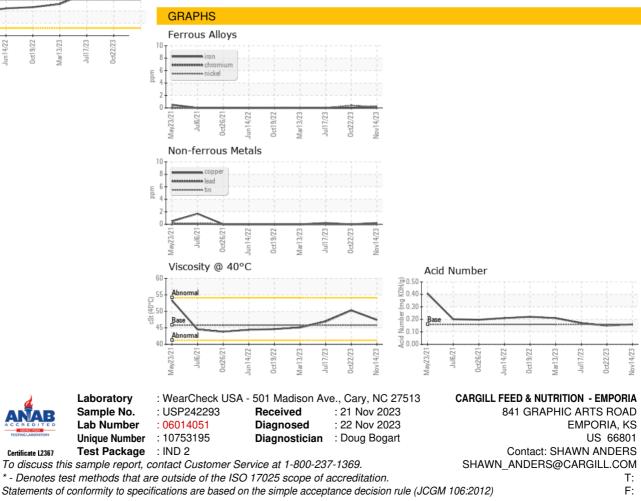

Report Id: CAREMP [WUSCAR] 06014051 (Generated: 11/22/2023 16:14:04) Rev: 1

Certificate L2367

Contact/Location: SHAWN ANDERS - CAREMP