




# PROBLEM SUMMARY

Sample Rating Trend

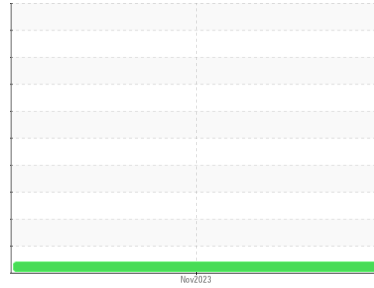

## VISCOSITY



Area  
**PATTONS 4010-5**  
Machine Id  
**ELGI MSG1061260 - PLASTEK GROUP**  
Component  
**Compressor**

### COMPONENT CONDITION SUMMARY

▲ Viscosity @ 40°C



### RECOMMENDATION

No corrective action is recommended at this time.  
Resample at the next service interval to monitor.

### PROBLEMATIC TEST RESULTS

Sample Status				ATTENTION	---	---
Visc @ 40°C	cSt	ASTM D445	41.57	▲ 71.52	---	---

Customer Id: UCLEWCHA  
Sample No.: UCH06014106  
Lab Number: 06014106  
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Jonathan Hester +1 919-379-4092 x4092  
[jhester@wearcheckusa.com](mailto:jhester@wearcheckusa.com)

To change component or sample information:  
Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS




# OIL ANALYSIS REPORT

Sample Rating Trend

VISCOSITY

Area  
**PATTONS 4010-5**  
 Machine Id  
**ELGI MSG1061260 - PLASTEK GROUP**  
 Component  
**Compressor**

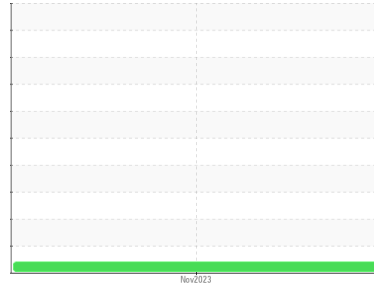

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The oil viscosity is higher than normal. Confirm oil type. The AN level is acceptable for this fluid.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCH06014106</b>	---	---
Sample Date	Client Info		<b>15 Nov 2023</b>	---	---
Machine Age	hrs	Client Info	<b>24447</b>	---	---
Oil Age	hrs	Client Info	<b>8000</b>	---	---
Oil Changed	Client Info		<b>N/A</b>	---	---
Sample Status			<b>ATTENTION</b>	---	---

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	<b>NEG</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>5</b>	---	---
Chromium	ppm	ASTM D5185m >10	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Silver	ppm	ASTM D5185m	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >25	<b>2</b>	---	---
Lead	ppm	ASTM D5185m >25	<b>0</b>	---	---
Copper	ppm	ASTM D5185m >50	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185m >15	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	---	---
Barium	ppm	ASTM D5185m 0.4	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m 0.5	<b>&lt;1</b>	---	---
Manganese	ppm	ASTM D5185m 0.4	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m 0	<b>&lt;1</b>	---	---
Calcium	ppm	ASTM D5185m 0.3	<b>0</b>	---	---
Phosphorus	ppm	ASTM D5185m 1376	<b>414</b>	---	---
Zinc	ppm	ASTM D5185m 0	<b>0</b>	---	---
Sulfur	ppm	ASTM D5185m 320	<b>79</b>	---	---

## CONTAMINANTS


	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	---	---
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>1</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.573	<b>1.27</b>	---	---



# OIL ANALYSIS REPORT

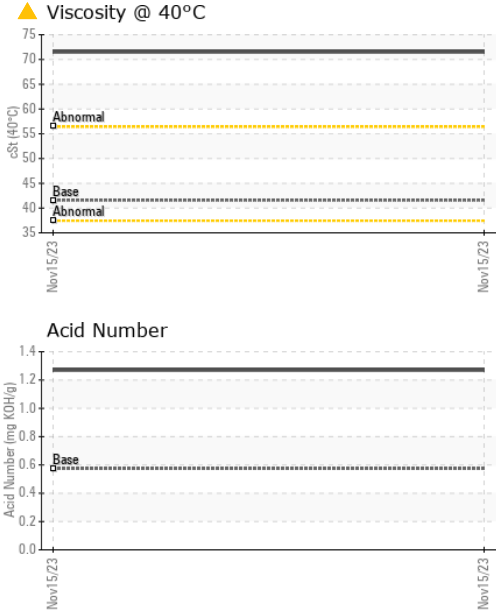





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	41.57	▲ 71.52	---	---

### SAMPLE IMAGES

	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

### GRAPHS

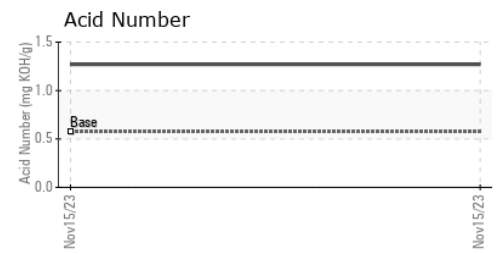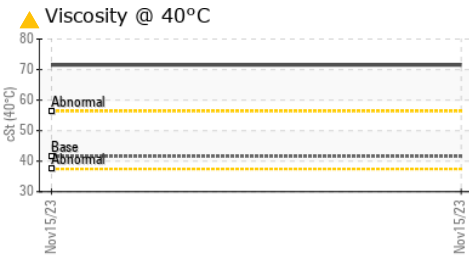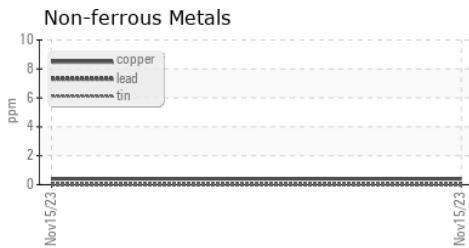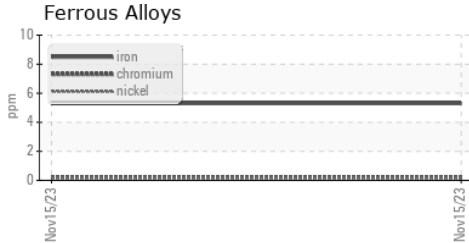

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06014106 **Received** : 21 Nov 2023  
**Lab Number** : 06014106 **Diagnosed** : 30 Nov 2023  
**Unique Number** : 10753250 **Diagnostician** : Jonathan Hester  
**Test Package** : IND 2

**LEWIS SYSTEMS & SERVICE CO INC**  
 9300 STOCKPORT PL  
 CHARLOTTE, NC  
 US 28273  
 Contact: JOE KERLEY  
 jkerley@lewisystemsinc.com  
 T: (704)588-2299  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)