




FUEL REPORT

Sample Rating Trend

NORMAL

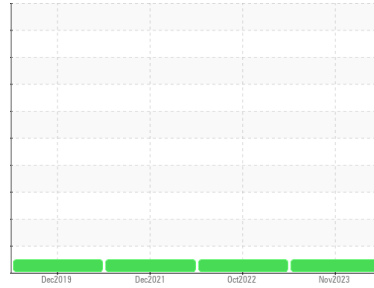

Machine Id
CUMMINS/ONAN GATES OF HEAVEN

Component
Diesel Fuel
Fluid
NOT GIVEN (37 GAL)

DIAGNOSIS

Recommendation

This is a baseline read-out on the submitted sample.

Corrosion

All metal levels are normal indicating no corrosion in the system.


SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0834436	WC0748962	WC0612369
Sample Date	Client Info			03 Nov 2023	20 Oct 2022	06 Dec 2021
Machine Age	hrs	Client Info		757	715	967
Sample Status				NORMAL	NORMAL	NORMAL

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m		0	22	0

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	0	0	0
Sodium	ppm	ASTM D5185m	<0.1	<1	0	0
Potassium	ppm	ASTM D5185m	<0.1	0	1	0

HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	0	<1	0
Nickel	ppm	ASTM D5185m	<0.1	0	0	0
Lead	ppm	ASTM D5185m	<0.1	0	0	0
Vanadium	ppm	ASTM D5185m	<0.1	0	0	0
Iron	ppm	ASTM D5185m	<0.1	0	<1	<1
Calcium	ppm	ASTM D5185m	<0.1	0	6	<1
Magnesium	ppm	ASTM D5185m	<0.1	0	1	0
Phosphorus	ppm	ASTM D5185m	<0.1	0	8	<1
Zinc	ppm	ASTM D5185m	<0.1	0	4	0

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

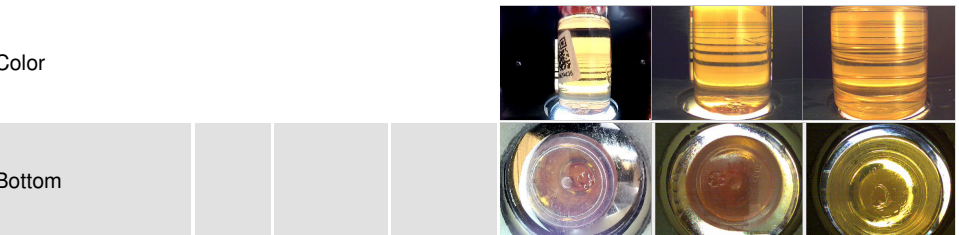



FUEL REPORT

GRAPHS



Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0834436 **Received** : 21 Nov 2023
Lab Number : 06014393 **Diagnosed** : 27 Nov 2023
Unique Number : 10753537 **Diagnostician** : Jonathan Hester
Test Package : MOB 1 (Additional Tests: KF)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

GEN TECH LTD
 3017 RT 9W
 NEW WINDSOR, NY
 US 12553
 Contact: JOE SAYEGH
 joe@gentechltd.com
 T: (845)568-0500
 F: (845)568-3073