


PROBLEM SUMMARY

Area
EBAY
Machine Id
SB13MGB
Component
Gearbox
Fluid
GEAR OIL ISO 320 (--- GAL)

Sample Rating Trend

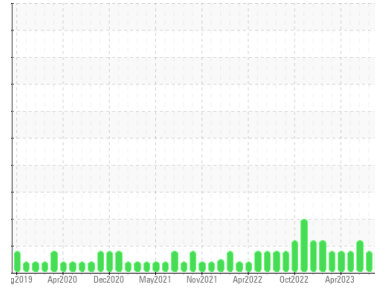


ISO



COMPONENT CONDITION SUMMARY

▲ Particle Trend

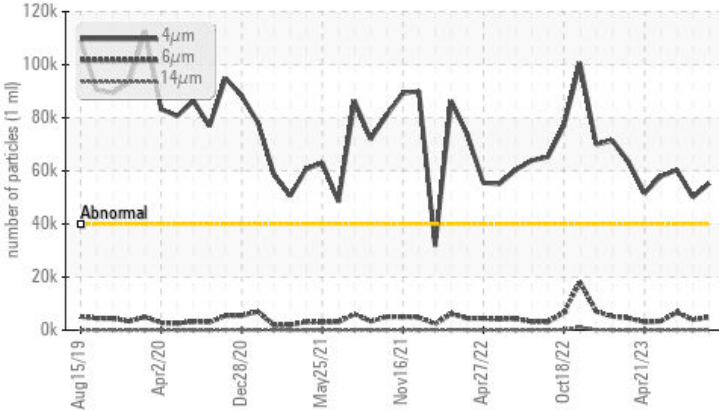

RECOMMENDATION

Resample at the next service interval to monitor.
Due to an abnormal test result it is recommended to contact Stauff Corp at (201)-444-7800 for help resolving the issue.

PROBLEMATIC TEST RESULTS

Sample Status		ATTENTION	ATTENTION	ATTENTION
Particles >4µm	ASTM D7647 >40000	▲ 55288	▲ 50069	▲ 60333
Oil Cleanliness	ISO 4406 (c) >22/19/16	▲ 23/19/13	▲ 23/19/13	▲ 23/20/14

Customer Id: KOBPIN
Sample No.: ST46008
Lab Number: 06014538
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Contact Required	---	---	?	Due to an abnormal test result it is recommended to contact Stauff Corp at (201)-444-7800 for help resolving the issue.

HISTORICAL DIAGNOSIS

03 Nov 2023 Diag: Don Baldrige

ISO



Resample at the next service interval to monitor. Due to an abnormal test result it is recommended to contact Stauff Corp at (201)-444-7800 for help resolving the issue. All component wear rates are normal. There is a moderate amount of silt (particulates < 6 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



22 Jun 2023 Diag: Doug Bogart

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. Due to an abnormal test result it is recommended to contact Stauff Corp at (201)-444-7800 for help resolving the issue. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



23 May 2023 Diag: Jonathan Hester

ISO




Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample. Due to an abnormal test result it is recommended to contact Stauff Corp at (201)-444-7800 for help resolving the issue. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



Area
EBAY
Machine Id
SB13MGB
Component
Gearbox
Fluid
GEAR OIL ISO 320 (--- GAL)

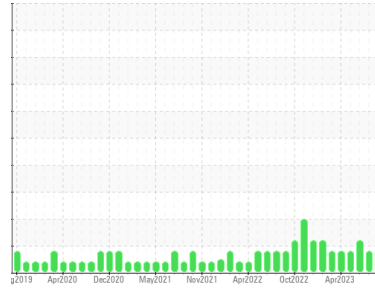

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. Due to an abnormal test result it is recommended to contact Stauff Corp at (201)-444-7800 for help resolving the issue.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 6 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		ST46008	ST46007	ST44487
Sample Date	Client Info		16 Nov 2023	03 Nov 2023	22 Jun 2023
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	Changed
Sample Status			ATTENTION	ATTENTION	ATTENTION

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >200	13	13	10
Chromium	ppm	ASTM D5185m >15	<1	0	<1
Nickel	ppm	ASTM D5185m >15	<1	0	<1
Titanium	ppm	ASTM D5185m	1	<1	2
Silver	ppm	ASTM D5185m	0	0	<1
Aluminum	ppm	ASTM D5185m >25	2	0	0
Lead	ppm	ASTM D5185m >100	<1	0	2
Copper	ppm	ASTM D5185m >200	<1	0	<1
Tin	ppm	ASTM D5185m >25	0	0	<1
Vanadium	ppm	ASTM D5185m	0	0	<1
Cadmium	ppm	ASTM D5185m	<1	0	<1

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 50	17	13	12
Barium	ppm	ASTM D5185m 15	0	0	0
Molybdenum	ppm	ASTM D5185m 15	<1	0	<1
Manganese	ppm	ASTM D5185m	<1	0	<1
Magnesium	ppm	ASTM D5185m 50	<1	0	<1
Calcium	ppm	ASTM D5185m 50	27	28	20
Phosphorus	ppm	ASTM D5185m 350	310	300	210
Zinc	ppm	ASTM D5185m 100	0	12	0
Sulfur	ppm	ASTM D5185m 12500	19976	17620	15801

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	1	0	<1
Sodium	ppm	ASTM D5185m	0	0	<1
Potassium	ppm	ASTM D5185m >20	2	<1	3
Water	%	ASTM D6304 >0.2	0.013	0.007	0.006
ppm Water	ppm	ASTM D6304 >2000	138	77.8	61.1






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>40000	▲ 55288	▲ 50069	▲ 60333
Particles >6µm	ASTM D7647	>5000	4818	3914	▲ 6681
Particles >14µm	ASTM D7647	>640	76	43	119
Particles >21µm	ASTM D7647	>160	16	9	18
Particles >38µm	ASTM D7647	>40	1	0	0
Particles >71µm	ASTM D7647	>10	0	0	0
Oil Cleanliness	ISO 4406 (c)	>22/19/16	▲ 23/19/13	▲ 23/19/13	▲ 23/20/14

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.85	0.59	0.66	0.71


OIL ANALYSIS REPORT

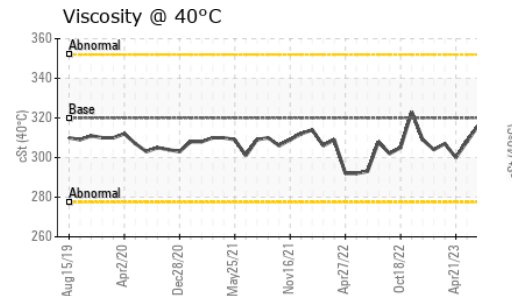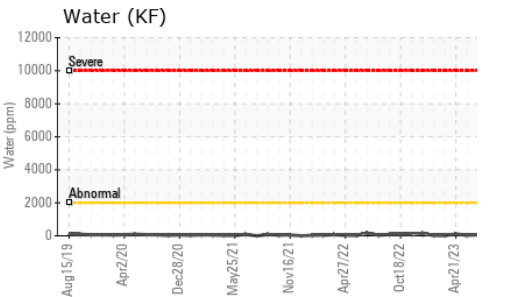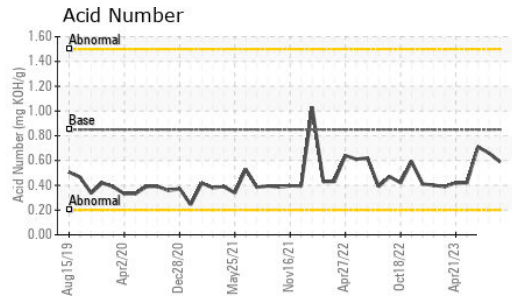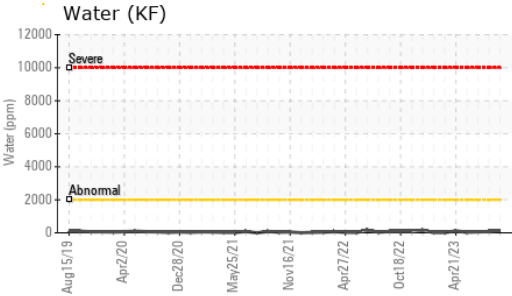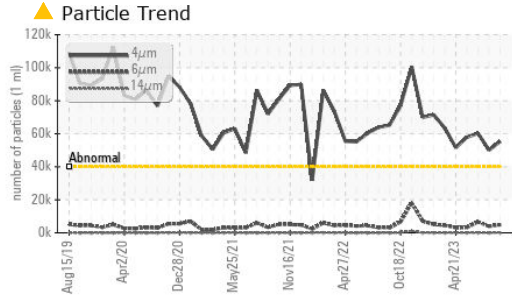






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 320	314	316	316

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

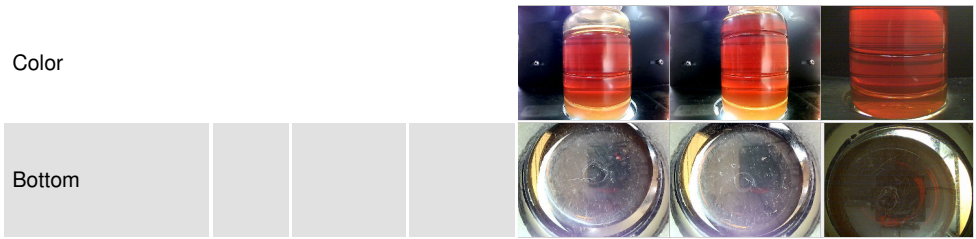

GRAPHS

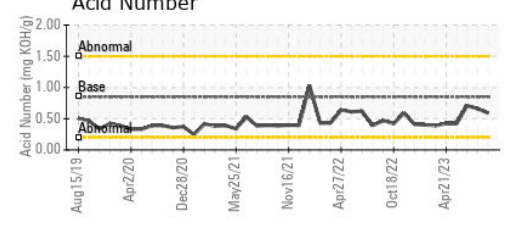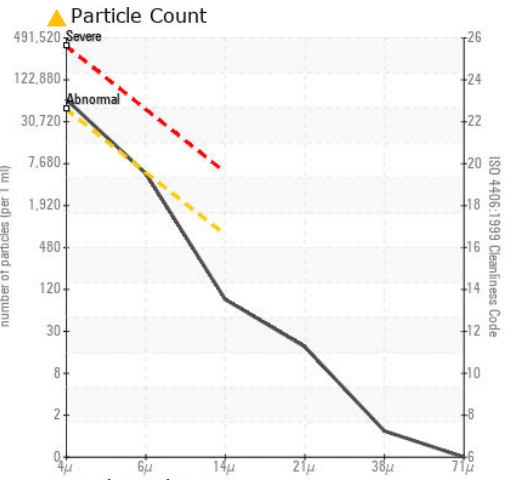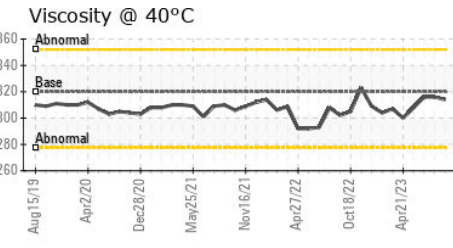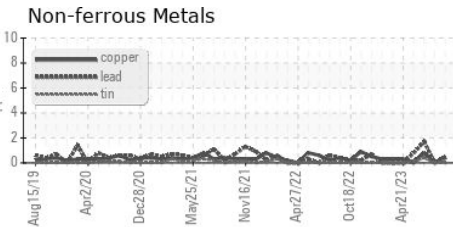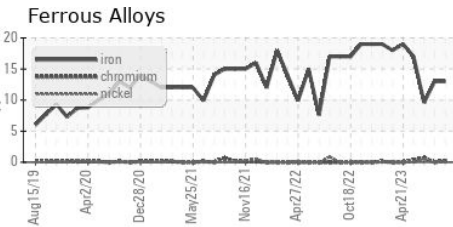

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : ST46008 **Received** : 21 Nov 2023
Lab Number : 06014538 **Diagnosed** : 24 Nov 2023
Unique Number : 10753682 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

KOBE WIELAND COPPER PRODUCTS
 3990 HWY. 311
 PINE HALL, NC
 US 27042
 Contact: NEAL SHINAULT
 NEAL.SHINAULT@WIELAND.COM
 T: (336)604-1498
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)