



# PROBLEM SUMMARY

Sample Rating Trend



**SEDIMENT**



Machine Id  
**SULLAIR 1100**  
 Component  
**Compressor**  
 Fluid  
**SULLAIR SULLUBE (--- GAL)**

## COMPONENT CONDITION SUMMARY

No relevant graphs to display

## RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status				<b>ABNORMAL</b>	---	---
Silt	scalar	*Visual	NONE	<b>▲ MODER</b>	---	---

**Customer Id:** SULLAP  
**Sample No.:** RP0033660  
**Lab Number:** 06014565  
**Test Package:** IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:

Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.

## HISTORICAL DIAGNOSIS



# OIL ANALYSIS REPORT

Sample Rating Trend



**SEDIMENT**



Machine Id  
**SULLAIR 1100**  
 Component  
**Compressor**  
 Fluid  
**SULLAIR SULLUBE (--- GAL)**

**DIAGNOSIS**

**▲ Recommendation**

We recommend you service the filters on this component. Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**▲ Contamination**

There is a moderate amount of visible silt present in the sample.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>RP0033660</b>	---	---
Sample Date	Client Info			<b>28 Aug 2023</b>	---	---
Machine Age	hrs	Client Info		<b>56638</b>	---	---
Oil Age	hrs	Client Info		<b>5370</b>	---	---
Oil Changed	Client Info			<b>N/A</b>	---	---
Sample Status				<b>ABNORMAL</b>	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	---	---
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Silver	ppm	ASTM D5185m		<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>25	<b>2</b>	---	---
Lead	ppm	ASTM D5185m	>25	<b>0</b>	---	---
Copper	ppm	ASTM D5185m	>50	<b>7</b>	---	---
Tin	ppm	ASTM D5185m	>15	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	---	---
Barium	ppm	ASTM D5185m	745	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m	0.0	<b>&lt;1</b>	---	---
Manganese	ppm	ASTM D5185m		<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m	0.0	<b>&lt;1</b>	---	---
Calcium	ppm	ASTM D5185m	1	<b>0</b>	---	---
Phosphorus	ppm	ASTM D5185m	3	<b>2</b>	---	---
Zinc	ppm	ASTM D5185m	0.1	<b>0</b>	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>2</b>	---	---
Sodium	ppm	ASTM D5185m		<b>0</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	---	---
Water	%	ASTM D6304	>0.1	<b>0.010</b>	---	---
ppm Water	ppm	ASTM D6304	>1000	<b>100</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	.06	<b>0.27</b>	---	---

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	---	---
Silt	scalar	*Visual	NONE	<b>▲ MODER</b>	---	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	---	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	---	---
Free Water	scalar	*Visual		<b>NEG</b>	---	---

# OIL ANALYSIS REPORT

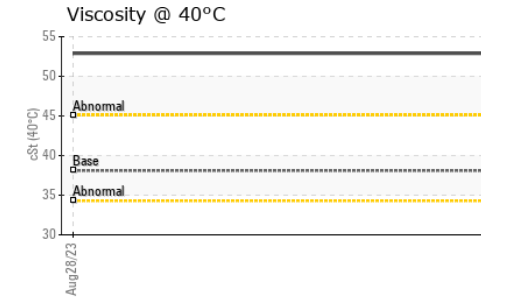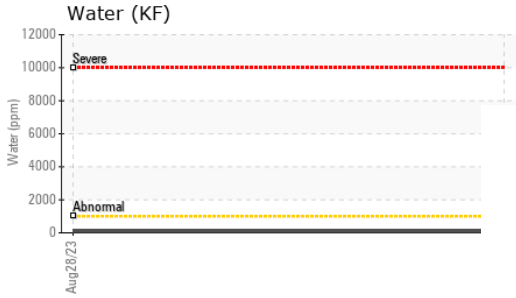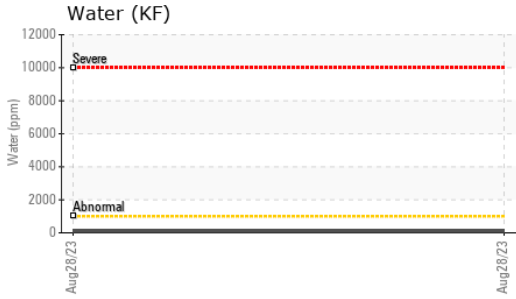





## FLUID PROPERTIES

method	limit/base	current	history1	history2	
Visc @ 40°C	cSt ASTM D445	38.1	52.9	---	---

## SAMPLE IMAGES

method	limit/base	current	history1	history2
Color			no image	no image
Bottom			no image	no image

## GRAPHS

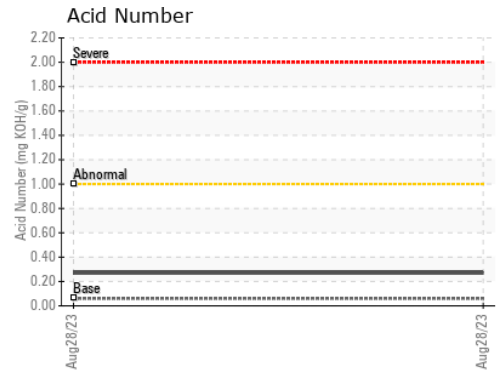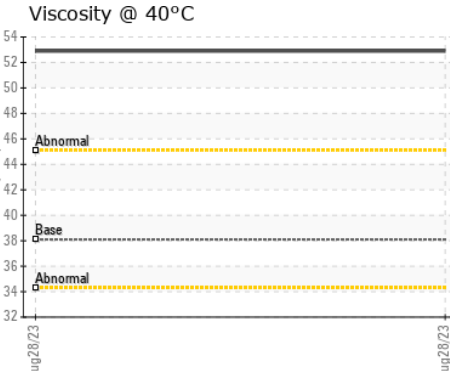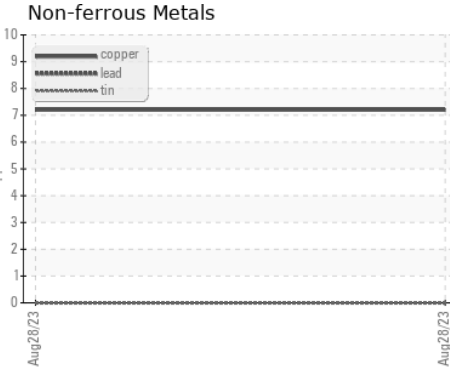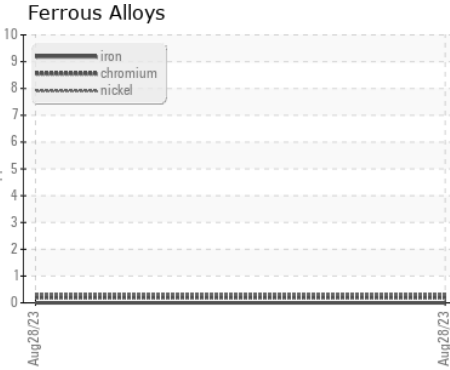

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0033660 **Received** : 21 Nov 2023  
**Lab Number** : 06014565 **Diagnosed** : 24 Nov 2023  
**Unique Number** : 10753709 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**SULZER HICKHAM**  
 11518 OLD LAPORTE RD.  
 LAPORTE, TX  
 US 77571  
 Contact: EVER GARZA  
 ever.garza@sulzer.com  
 T: (713)567-2807  
 F: (713)567-2846