


# **OIL ANALYSIS REPORT**

Sample Rating Trend



NORMAL



Machine Id

# KAESER BSD 50 6297771 (S/N 1442)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- QTS)

## DIAGNOSIS

# Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

# **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		May2019	Apr2020 Mar2021	Mar2022 Nov2022 Jun2023	Nov2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA007134	KCPA001942	KCP47940
Sample Date		Client Info		13 Nov 2023	05 Jun 2023	10 Nov 2022
Machine Age	hrs	Client Info		22110	19842	17204
Oil Age	hrs	Client Info		0	0	5620
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	ATTENTION	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	2	<1	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	7	2	5
Tin	ppm	ASTM D5185m	>10	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	90	42	51	3
Molybdenum	ppm	ASTM D5185m	0	<1	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	100	61	85	32
Calcium	ppm	ASTM D5185m	0	4	<1	0
Phosphorus	ppm	ASTM D5185m	0	4	0	3
Zinc	ppm	ASTM D5185m	0	0	0	12
Sulfur	ppm	ASTM D5185m	23500	19760	21877	20467
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	<1
Sodium	ppm	ASTM D5185m		32	21	10
Potassium	ppm	ASTM D5185m	>20	8	4	1
Water	%	ASTM D6304	>0.05	0.015	0.026	0.010
ppm Water	ppm	ASTM D6304	>500	159	262.9	105.7
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1910	4336	2926
Particles >6µm		ASTM D7647	>1300	762	<b>△</b> 1483	569
Particles >14µm		ASTM D7647	>80	73	<u>\$\times\$</u> 98	19
Particles >21µm		ASTM D7647	>20	20	19	4
Particles >38µm		ASTM D7647	>4	1	0	0
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/17/13	<u> </u>	19/16/11
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
A si al Niversala au (ANI)	I/OII/-	ACTM DODAE	1.0	0.00	0.00	0.00

Acid Number (AN)

mg KOH/g ASTM D8045 1.0


0.38

0.29

0.38



# **OIL ANALYSIS REPORT**

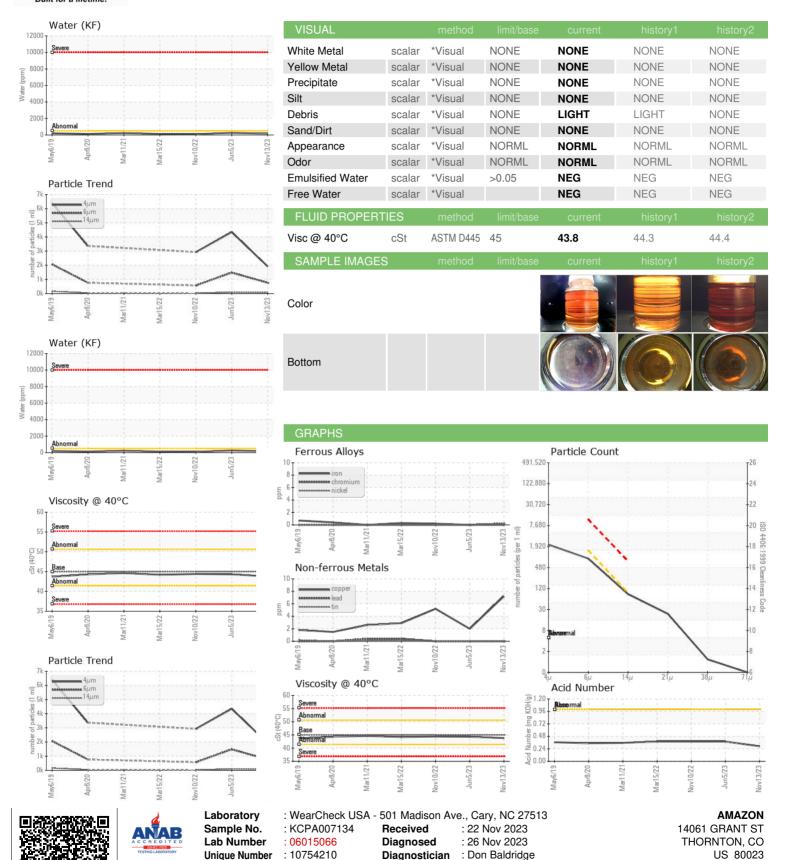

Test Package : IND 2 ( Additional Tests: KF, PrtCount )

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Certificate L2367

T: F:

Contact: Service Manager