

OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id

KAESER BSD 50 6273880 (S/N 1434)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- QTS)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		May2019	Apr2020 Mar2021	Mar2022 Nov2022 Jun2023	Nov2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA007123	KCPA001777	KCP47953
Sample Date		Client Info		13 Nov 2023	05 Jun 2023	10 Nov 2022
Machine Age	hrs	Client Info		19074	16806	14155
Oil Age	hrs	Client Info		0	0	2592
Oil Changed		Client Info		N/A	N/A	Changed
Sample Status				NORMAL	ABNORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	2	<1	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	7	2	4
Tin	ppm	ASTM D5185m	>10	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	90	21	38	2
Molybdenum	ppm	ASTM D5185m	0	<1	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	100	55	76	57
Calcium	ppm	ASTM D5185m	0	2	0	<1
Phosphorus	ppm	ASTM D5185m	0	2	0	4
Zinc	ppm	ASTM D5185m	0	<1	0	10
Sulfur	ppm	ASTM D5185m	23500	19538	22298	20756
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	<1
Sodium	ppm	ASTM D5185m		29	18	18
Potassium	ppm	ASTM D5185m	>20	7	5	3
Water	%	ASTM D6304	>0.05	0.026	0.023	0.014
ppm Water	ppm	ASTM D6304	>500	269	231.5	145.8
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		658	12444	1598
Particles >6µm		ASTM D7647	>1300	224	▲ 3532	410
Particles >14µm		ASTM D7647	>80	20	▲ 187	17
Particles >21µm		ASTM D7647	>20	5	<u>41</u>	3
Particles >38µm		ASTM D7647	>4	0	1	0
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/15/11	<u>21/19/15</u>	18/16/11
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.30	0.37	0.38



OIL ANALYSIS REPORT

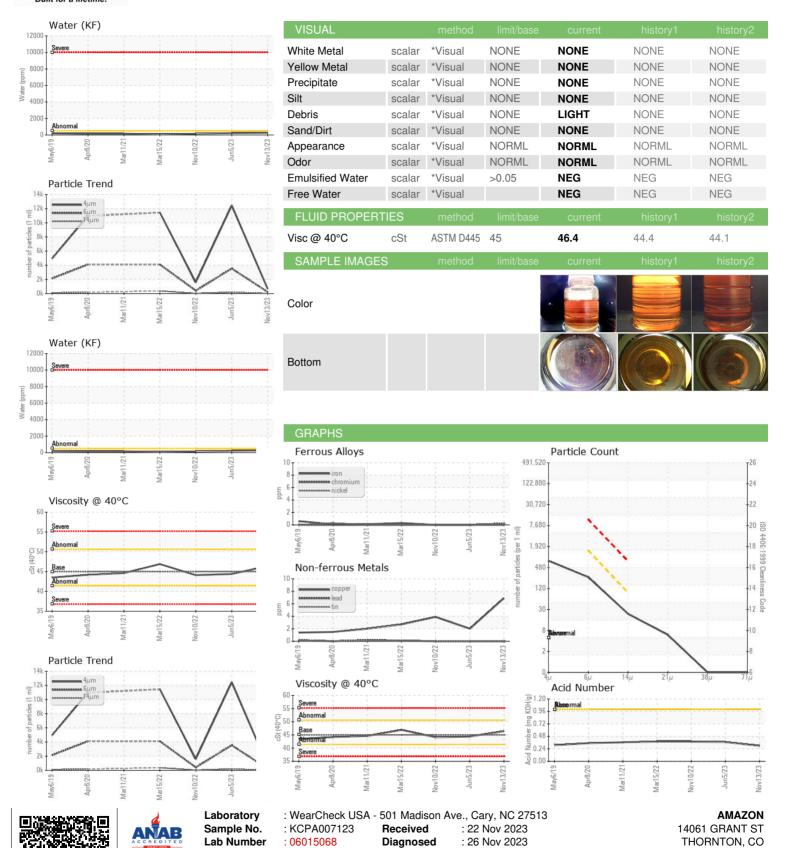



Certificate L2367

Unique Number

: 10754212

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Test Package : IND 2 (Additional Tests: KF, PrtCount)

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Diagnostician : Don Baldridge

US 80023

T: F:

Contact: Service Manager