


PROBLEM SUMMARY

Sample Rating Trend ISO

KAESER 8823702

Component Compressor Fluid KAESER SIGMA (OEM) M-460 (--- QTS)

COMPONENT CONDITION SUMMARY

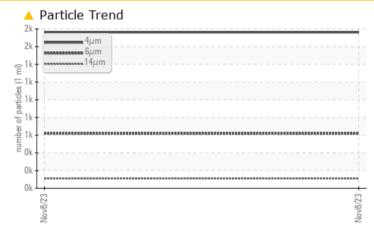

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS Sample Status ATTENTION -- Particles >14µm ASTM D7647 >80 ▲ 109 -- Particles >14µm ASTM D7647 >20 ▲ 49 -- Particles >21µm ASTM D7647 >20 ▲ 49 -- Particles >38µm ASTM D7647 >4 ▲ 7 -- Oil Cleanliness ISO 4406 (c) >17/13 ▲ 16/14 ---

Customer Id: MODLAK Sample No.: KC125954 Lab Number: 06015095 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 <u>customerservice@wearcheck.com</u> There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT





Machine Id KAESER 8823702 Component

Compressor Fluid KAESER SIGMA (OEM) M-460 (--- QTS)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC125954		
Sample Date		Client Info		08 Nov 2023		
Machine Age	hrs	Client Info		3168		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ATTENTION		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	2		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm		>50	13		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	<1		
Manganese	ppm	ASTM D5185m	0	<1		
Magnesium	ppm	ASTM D5185m	100	52		
Calcium	ppm	ASTM D5185m	0	2		
Phosphorus	ppm	ASTM D5185m	0	- <1		
Zinc	ppm	ASTM D5185m		0		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon		ASTM D5185m	>25	<1		
Sodium	ppm ppm	ASTM D5185m	>20	19		
Potassium	ppm	ASTM D5185m	>20	19		
Water	%	ASTM D5105III		0.021		
ppm Water	ppm	ASTM D0304 ASTM D6304	>500	211		
FLUID CLEANLIN		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1762		
Particles >6µm		ASTM D7647	>1300	619		
Particles >14µm		ASTM D7647	>80	▲ 109		
Particles >21µm		ASTM D7647		▲ 49		
Particles >38µm		ASTM D7647	>4	▲ 7		
Particles >71µm		ASTM D7647		0		
Oil Cleanliness		ISO 4406 (c)	>17/13	▲ 16/14		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
					history	
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.29		





Built for a lifetime







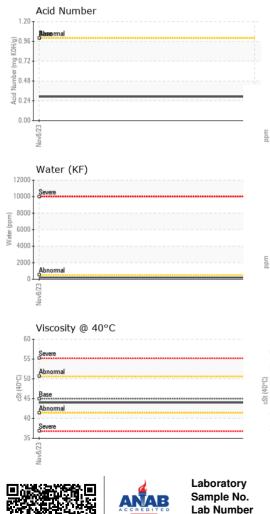

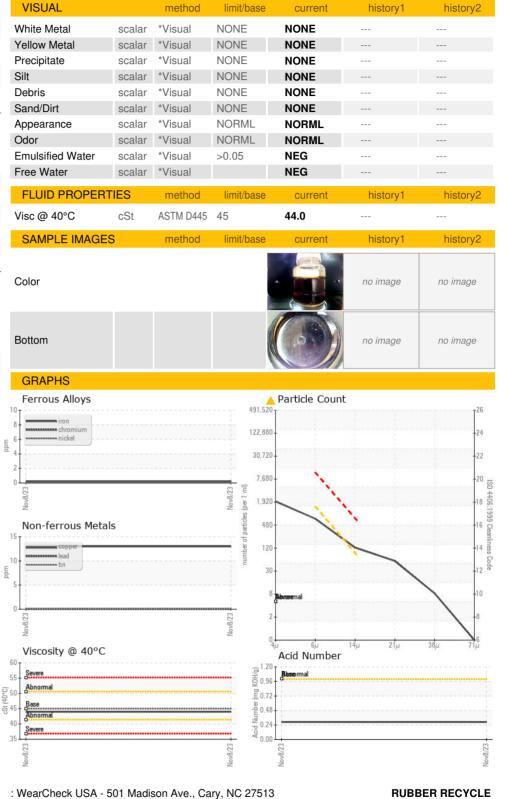

: 22 Nov 2023

: 26 Nov 2023 : Don Baldridge

Received

Diagnosed

Diagnostician



* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Unique Number

Test Package

: KC125954

:06015095

: 10754239

To discuss this sample report, contact Customer Service at 1-800-237-1369.

: IND 2

Certificate L2367

Contact/Location: Service Manager - MODLAK

1985 RUTGERS UNIVERSITY BLVD

LAKEWOOD, NJ

Contact: Service Manager

US 08701

T:

F: