

# **PROBLEM SUMMARY**

Sample Rating Trend


ISO

SULLAIR AIR 1 SLA (S/N 13896KGC)


Component

Air Compressor

USPI MAX FG AIR 46 (--- GAL)



# **COMPONENT CONDITION SUMMARY**

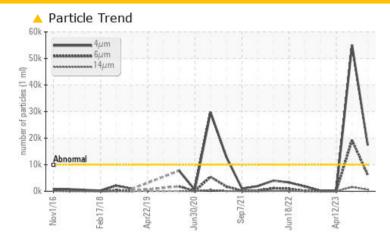

# RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status		ABNORM	AL ABNORMAL	NORMAL					
Particles >4µm	ASTM D7647 >	>10000 <b>A 17350</b>	△ 55079	177					
Particles >6µm	ASTM D7647 >	>2500 <b>A 6195</b>	▲ 19288	54					
Particles >14μm	ASTM D7647 >	-320 <b>^ 665</b>	<u>▲</u> 1560	10					
Particles >21μm	ASTM D7647 >	>80 <b>🔺 192</b>	<b>▲</b> 384	3					
Oil Cleanliness	ISO 4406 (c) >	>20/18/15 <u><b>21/20/1</b></u>	<b>7</b> <u>\( \) 23/21/18</u>	15/13/10					

Customer Id: TYSAMAPRO Sample No.: USPM31336 Lab Number: 06015122 Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 dougb@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

## **RECOMMENDED ACTIONS**

Action	Status	Date	Done By	Description
Change Filter			?	We recommend you service the filters on this component.

# HISTORICAL DIAGNOSIS

# 25 Jul 2023 Diag: Doug Bogart





We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



# 12 Apr 2023 Diag: Doug Bogart

#### NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

# view report

### 14 Dec 2022 Diag: Doug Bogart

#### NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





# **OIL ANALYSIS REPORT**

Sample Rating Trend



# SULLAIR AIR 1 SLA (S/N 13896KGC)

**Air Compressor** 

**USPI MAX FG AIR 46 (--- GAL)** 

# **DIAGNOSIS**

## Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

All component wear rates are normal.

# Contamination

There is a high amount of particulates present in the oil.

## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		ov2016 Feb	2018 Apr2019 Jun2	020 Sep2021 Jun2022 A	pr2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USPM31336	USPM29030	USPM26108
Sample Date		Client Info		14 Nov 2023	25 Jul 2023	12 Apr 2023
Machine Age	hrs	Client Info		42122	0	421014
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	ABNORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	0
Chromium	ppm	ASTM D5185m	>4	<1	0	0
Nickel	ppm	ASTM D5185m	>4	0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>10	1	0	0
Lead	ppm	ASTM D5185m	>20	0	0	0
Copper	ppm	ASTM D5185m	>40	11	16	6
Tin	ppm	ASTM D5185m	>5	0	0	0
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	0	0	2	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	0	<1	<1	0
Calcium	ppm	ASTM D5185m	0	1	<1	0
Phosphorus	ppm	ASTM D5185m	0	0	0	<1
Zinc	ppm	ASTM D5185m	0	0	6	0
Sulfur	ppm	ASTM D5185m	0	0	32	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	0
Sodium	ppm	ASTM D5185m		0	0	0
Potassium	ppm	ASTM D5185m	>20	<1	1	<1
Water	%	ASTM D6304	>0.6	0.015	0.016	0.005
ppm Water	ppm	ASTM D6304	>6000	154	163.7	53.7
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	<b>17350</b>	▲ 55079	177
Particles >6µm		ASTM D7647	>2500	<u>^</u> 6195	<u>▲</u> 19288	54
Particles >14μm		ASTM D7647	>320	<u>▲</u> 665	<u>▲</u> 1560	10
Particles >21µm		ASTM D7647	>80	<u> </u>	▲ 384	3
Particles >38µm		ASTM D7647	>20	8	14	0
Particles >71µm		ASTM D7647	>4	1	1	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	<u>^</u> 21/20/17	<u>\$\rightarrow\$ 23/21/18</u>	15/13/10
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.16	0.14	0.22	0.08



# **OIL ANALYSIS REPORT**

