


PROBLEM SUMMARY

SULLAIR AIR 3 PRO (S/N 14416HGB)

Air Compressor Fluid USPI MAX FG AIR 46 (--- GAL)

COMPONENT CONDITION SUMMARY

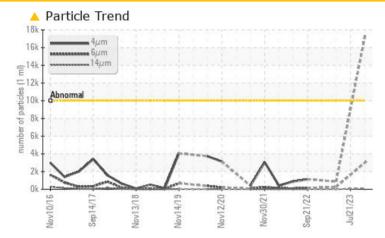

RECOMMENDATION

Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			ATTENTION	ABNORMAL	NORMAL				
Particles >4µm	ASTM D7647	>10000	🔺 17147		858				
Particles >6µm	ASTM D7647	>2500	A 2989		265				
Oil Cleanliness	ISO 4406 (c)	>20/18/15	<u> </u>		17/15/11				


Customer Id: TYSAMAPRO Sample No.: USPM31329 Lab Number: 06015129 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 <u>dougb@wearcheckusa.com</u>

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

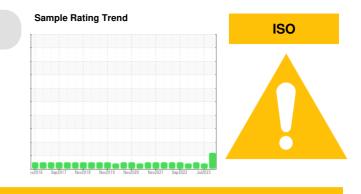

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

21 Jul 2023 Diag: Doug Bogart



We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



view report

17 Apr 2023 Diag: Doug Bogart

27 Dec 2022 Diag: Doug Bogart



Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of

level is acceptable for this fluid. The condition of the oil is suitable for further service.

any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN





We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Machine Id SULLAIR AIR 3 PRO (S/N 14416HGB) Component

Air Compressor Fluid

USPI MAX FG AIR 46 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



2016 Sep2017 Nev2018 Nev2019 Nev2020 Nev200 Nev2020 Nev2000 Ne

SAMPLE INFORM	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USPM31329	USPM28817	USPM26111
Sample Date		Client Info		14 Nov 2023	21 Jul 2023	17 Apr 2023
Machine Age	hrs	Client Info		22675	27675	226751
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ATTENTION	ABNORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	0
Chromium	ppm	ASTM D5185m	>4	<1	<1	0
Nickel	ppm	ASTM D5185m	>4	0	<1	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>10	1	0	0
Lead	ppm	ASTM D5185m	>20	0	0	0
Copper	ppm	ASTM D5185m	>40	1	<1	<1
Tin	ppm	ASTM D5185m	>5	0	<1	0
Vanadium	ppm	ASTM D5185m	-	0	2	0
Cadmium	ppm	ASTM D5185m		0	<1	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	0	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m	0	0	<1	0
Calcium	ppm	ASTM D5185m	0	<1	3	0
Phosphorus	ppm	ASTM D5185m	0	0	0	1
Zinc	ppm	ASTM D5185m	0	0	0	0
Sulfur	ppm	ASTM D5185m	0	0	0	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	1	0
Sodium	ppm	ASTM D5185m		0	44	0
Potassium	ppm	ASTM D5185m	>20	<1	10	<1
Water	%	ASTM D6304	>0.6	0.113	0.080	0.008
ppm Water	ppm	ASTM D6304	>6000	1130	808.2	87.5
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	 17147		858
Particles >6µm		ASTM D7647	>2500	<u> </u>		265
Particles >14µm		ASTM D7647	>320	133		15
Particles >21µm		ASTM D7647	>80	27		2
Particles >38µm		ASTM D7647	>20	1		0
Particles >71µm		ASTM D7647	>4	0		0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	A 21/19/14		17/15/11
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.16	0.38	0.27	0.17

Contact/Location: SERVICE MANAGER ? - TYSAMAPRO



Acid Number

2 !

(B/HOX Bur)

Water (

OIL ANALYSIS REPORT

scalar

scalar

scalar

scalar

scalar

scalar

scalar

scalar

method

*Visual

*Visual

*Visual

*Visual

*Visual

*Visual

*Visual

*Visual

scalar *Visual

scalar *Visual

limit/base

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

limit/base

>0.6

current

NONE

NONE

NONE

NONE

NONE

NONE

NORML


NORML


curren


NEG

NEG

50.5





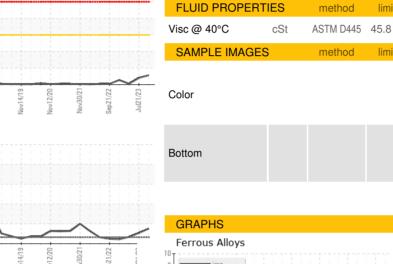

VISUAL

White Metal

Yellow Metal

Precipitate

Silt

Debris

Odor

Sand/Dirt

Appearance

Free Water

Emulsified Water



history1

NONE

NONE

NONE

NONE

MODER

NONE

LAYRD

NORML

0.2%

NEG

49.8

history

history2

NONE

NONE

NONE

NONE

NONE

NONE

NORML


NORML

history2

NEG

NEG

49.2

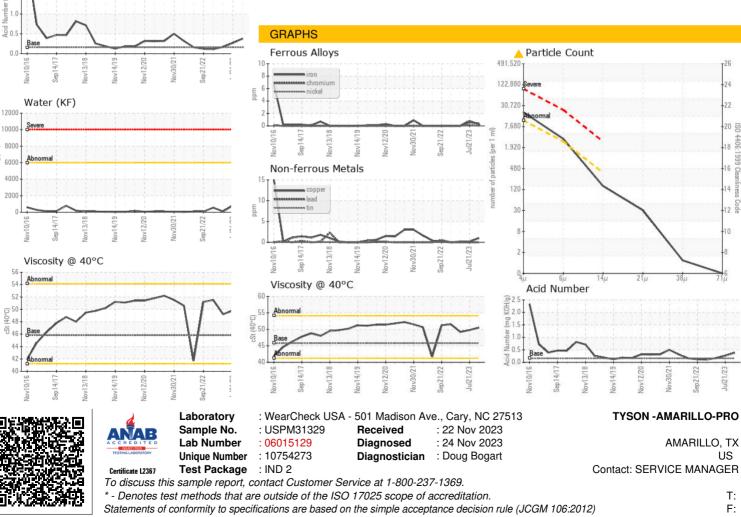

Contact/Location: SERVICE MANAGER ? - TYSAMAPRO