




PROBLEM SUMMARY


Area
SLAUGHTER
 Machine Id
SULLAIR TYSAMAS 2 SUL (S/N 007-99000331)
 Component
Refrigeration Compressor
 Fluid
NOT GIVEN (--- GAL)

Sample Rating Trend

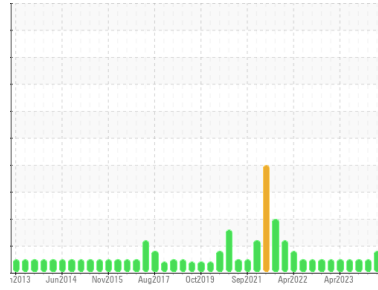

COMPONENT CONDITION SUMMARY

▲ Particle Trend

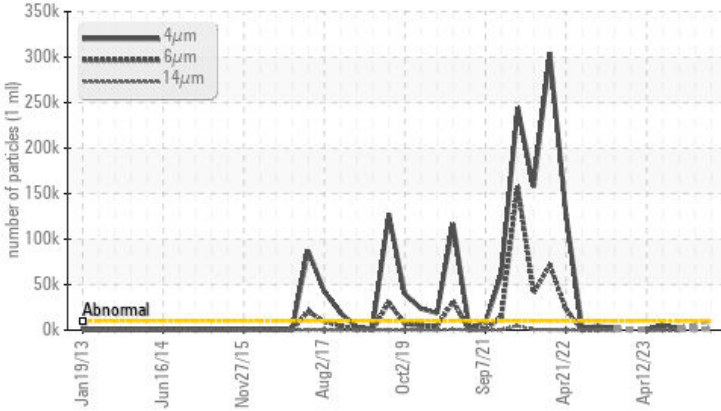

RECOMMENDATION

Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ATTENTION	NORMAL	NORMAL
Particles >4µm	ASTM D7647	>10000	▲ 10476	---	1804
Oil Cleanliness	ISO 4406 (c)	>20/18/15	▲ 21/18/12	---	18/16/12

Customer Id: TYSAMA
 Sample No.: USP0003556
 Lab Number: 06015147
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

26 Jul 2023 Diag: Doug Bogart

NORMAL



This is a baseline read-out on the submitted sample. Ester measured at approximately 0.5%.

view report



21 Jul 2023 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



12 Jul 2023 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

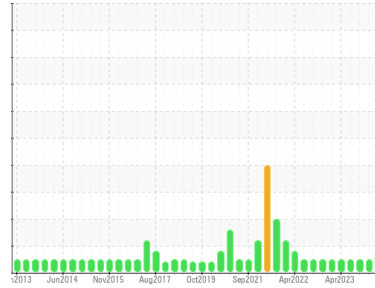

ISO



Area
SLAUGHTER
 Machine Id
SULLAIR TYSAMAS 2 SUL (S/N 007-99000331)
 Component
Refrigeration Compressor
 Fluid
NOT GIVEN (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 6 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2	
Sample Number	Client Info	USP0003556	USPM29034	USP0001047	
Sample Date	Client Info	14 Nov 2023	26 Jul 2023	21 Jul 2023	
Machine Age	hrs	Client Info	12172	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info	N/A	N/A	N/A	
Sample Status		ATTENTION	NORMAL	NORMAL	

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >8	0	---	3
Chromium	ppm	ASTM D5185m >2	0	---	0
Nickel	ppm	ASTM D5185m	0	---	0
Titanium	ppm	ASTM D5185m	0	---	0
Silver	ppm	ASTM D5185m >2	0	---	0
Aluminum	ppm	ASTM D5185m >3	0	---	0
Lead	ppm	ASTM D5185m >2	0	---	<1
Copper	ppm	ASTM D5185m >8	0	---	0
Tin	ppm	ASTM D5185m >4	0	---	0
Vanadium	ppm	ASTM D5185m	0	---	0
Cadmium	ppm	ASTM D5185m	0	---	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	---	0
Barium	ppm	ASTM D5185m	0	---	1
Molybdenum	ppm	ASTM D5185m	0	---	0
Manganese	ppm	ASTM D5185m	<1	---	0
Magnesium	ppm	ASTM D5185m	0	---	<1
Calcium	ppm	ASTM D5185m	1	---	<1
Phosphorus	ppm	ASTM D5185m	0	---	0
Zinc	ppm	ASTM D5185m	0	---	0
Sulfur	ppm	ASTM D5185m	0	---	28

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >15	0	---	0
Sodium	ppm	ASTM D5185m	0	---	0
Potassium	ppm	ASTM D5185m >20	0	---	1
Water	%	ASTM D6304 >0.01	0.004	---	0.001
ppm Water	ppm	ASTM D6304 >100	46	---	7.6


FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	▲ 10476	---	1804
Particles >6µm	ASTM D7647 >2500	2004	---	504
Particles >14µm	ASTM D7647 >320	34	---	27
Particles >21µm	ASTM D7647 >80	5	---	4
Particles >38µm	ASTM D7647 >20	0	---	0
Particles >71µm	ASTM D7647 >4	0	---	0
Oil Cleanliness	ISO 4406 (c) >20/18/15	▲ 21/18/12	---	18/16/12


FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D974	0.01	---	0.013


▲ Particle Trend

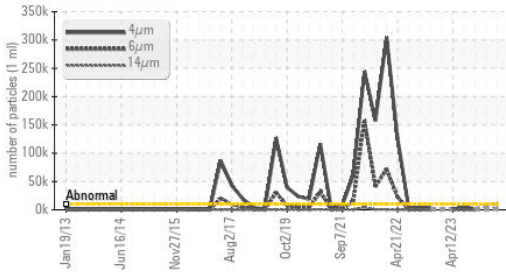


Water (KF)

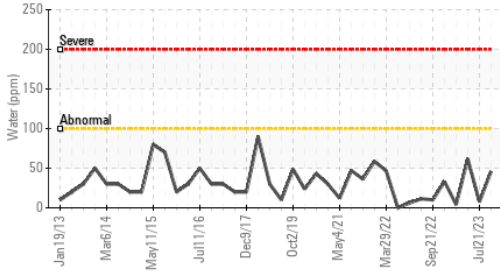


Acid Number

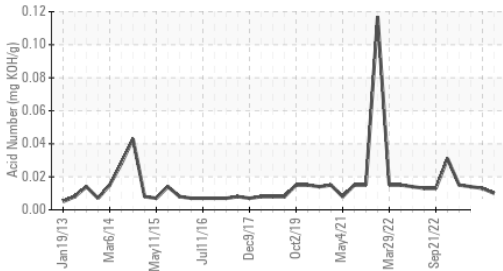

Water (KF)

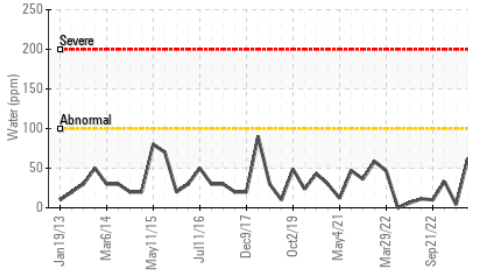


Viscosity @ 40°C

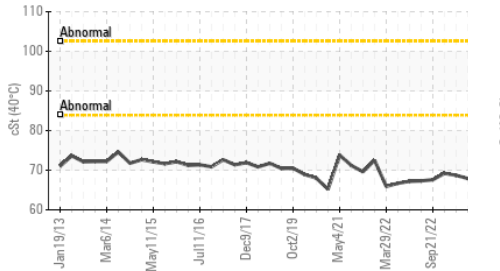

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	66.9	---	68.0

SAMPLE IMAGES

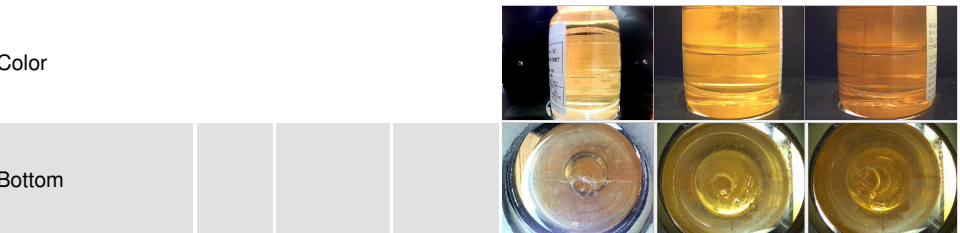


GRAPHS


Ferrous Alloys

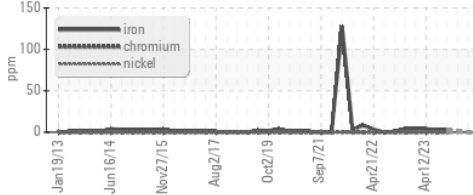


Non-ferrous Metals

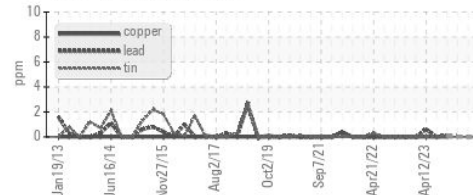


Viscosity @ 40°C

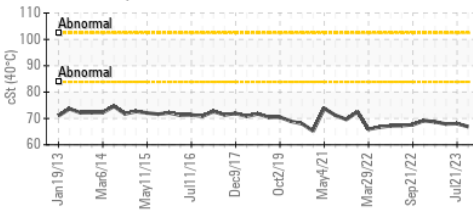

▲ Particle Count

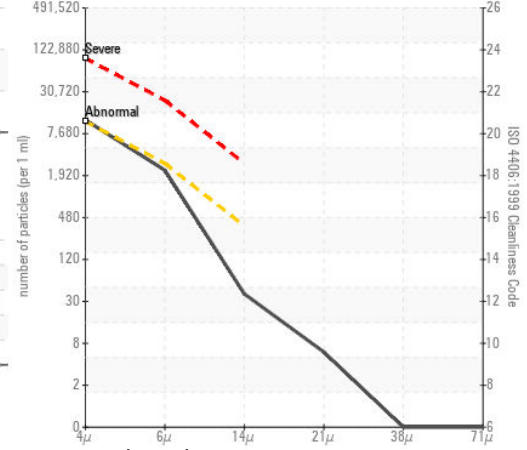

Acid Number

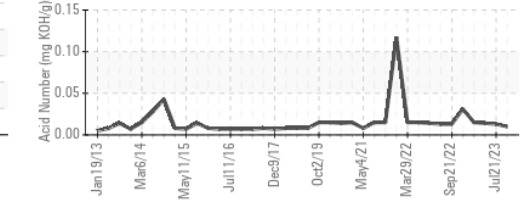

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : USP0003556 **Received** : 22 Nov 2023
Lab Number : 06015147 **Diagnosed** : 24 Nov 2023
Unique Number : 10754291 **Diagnostician** : Doug Bogart
Test Package : IND 2

TYSON -AMARILLO-USB
 AMARILLO, TX
 US
 Contact: RANDY INGRAM

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (806)355-7732
 F: (806)352-6946