

OIL ANALYSIS REPORT

VILTER PROCESS PUMP OUT (S/N 2053618)

Refrigeration Compressor

USPI 1009-68 SC (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service. Elements confirmed.





NORMAL

SAMPLE INFORM	/ ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0003575	USP245586	USP240873
Sample Date		Client Info		31 Oct 2023	03 Apr 2023	26 Dec 2022
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status		onone nuo		NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
		ASTM D5185m	>8			
Iron Chromium	ppm	ASTM D5185m		0	0	<1 0
Nickel	ppm		>2	0	0	0
	ppm	ASTM D5185m		-		0
Titanium	ppm	ASTM D5185m	0	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	0	<1	0
Lead	ppm	ASTM D5185m	>2	0	0	0
Copper	ppm	ASTM D5185m	>8	<1	0	<1
Tin	ppm	ASTM D5185m	>4	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		29	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m		0	0	0
Calcium	ppm	ASTM D5185m		2	1	0
Phosphorus	ppm	ASTM D5185m		0	0	0
Zinc	ppm	ASTM D5185m		3	0	0
Sulfur	ppm	ASTM D5185m	50	21	0	0
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1	<1	1
Sodium	ppm	ASTM D5185m		2	<1	1
Potassium	ppm	ASTM D5185m	>20	0	<1	0
Water	%	ASTM D6304		0.008	0.001	0.003
ppm Water	ppm	ASTM D6304		89	8.7	25.5
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	336	821	1352
Particles >6µm		ASTM D7647	>2500	97	201	305
Particles >14µm		ASTM D7647	>320	10	6	12
Particles >21µm		ASTM D7647		3	1	1
Particles >38µm		ASTM D7647	>20	0	0	0
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	16/14/10	17/15/10	18/15/11
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.04	0.013	0.014

Report Id: TYSWAL [WUSCAR] 06015164 (Generated: 11/30/2023 02:45:32) Rev: 1


Contact/Location: RICK DUVALL - TYSWAL




Water (KF)

3000


OIL ANALYSIS REPORT







Bottom

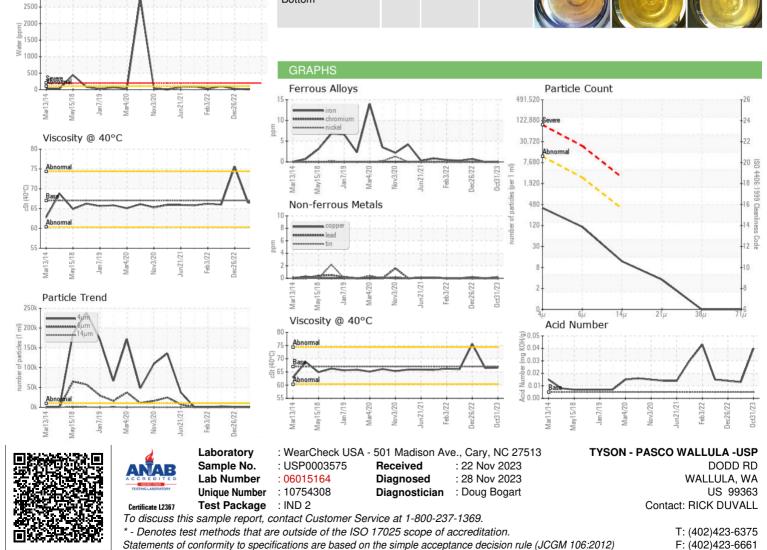

Report Id: TYSWAL [WUSCAR] 06015164 (Generated: 11/30/2023 02:45:32) Rev: 1

Contact/Location: RICK DUVALL - TYSWAL