




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

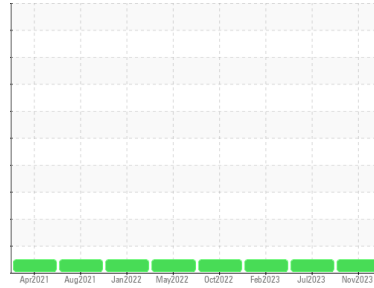

Machine Id  
**38 HSC ER6 (S/N W0940VFMCLHAA03)**

Component  
**Refrigeration Compressor**  
Fluid  
**FRICK 19 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

cv bn<sub>1</sub>./All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>USP0003538</b>	USP250058	USP246729
Sample Date	Client Info	<b>10 Nov 2023</b>	08 Jul 2023	21 Feb 2023
Machine Age	hrs Client Info	<b>8267</b>	7644	6383
Oil Age	hrs Client Info	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >8	<b>0</b>	<1	0
Chromium	ppm ASTM D5185m >2	<b>0</b>	0	0
Nickel	ppm ASTM D5185m	<b>0</b>	0	0
Titanium	ppm ASTM D5185m	<b>0</b>	0	0
Silver	ppm ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm ASTM D5185m >3	<b>0</b>	<1	0
Lead	ppm ASTM D5185m >2	<b>0</b>	0	0
Copper	ppm ASTM D5185m >8	<b>0</b>	0	0
Tin	ppm ASTM D5185m >4	<b>0</b>	0	0
Vanadium	ppm ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	<b>0</b>	0	0
Barium	ppm ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm ASTM D5185m	<b>0</b>	0	0
Manganese	ppm ASTM D5185m	<b>&lt;1</b>	0	0
Magnesium	ppm ASTM D5185m	<b>0</b>	0	0
Calcium	ppm ASTM D5185m	<b>1</b>	0	0
Phosphorus	ppm ASTM D5185m	<b>0</b>	0	0
Zinc	ppm ASTM D5185m	<b>0</b>	0	0
Sulfur	ppm ASTM D5185m	<b>0</b>	0	0

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >15	<b>&lt;1</b>	1	1
Sodium	ppm ASTM D5185m	<b>0</b>	0	<1
Potassium	ppm ASTM D5185m >20	<b>&lt;1</b>	<1	0
Water	% ASTM D6304 >0.01	<b>0.004</b>	0.001	0.002
ppm Water	ppm ASTM D6304 >100	<b>42</b>	0.00	15.2

## FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	<b>1741</b>	2063	1703
Particles >6µm	ASTM D7647 >2500	<b>417</b>	500	360
Particles >14µm	ASTM D7647 >320	<b>13</b>	23	14
Particles >21µm	ASTM D7647 >80	<b>2</b>	7	3
Particles >38µm	ASTM D7647 >20	<b>1</b>	0	0
Particles >71µm	ASTM D7647 >4	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >20/18/15	<b>18/16/11</b>	18/16/12	18/16/11

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D974	<b>0.01</b>	0.014	0.014



# OIL ANALYSIS REPORT

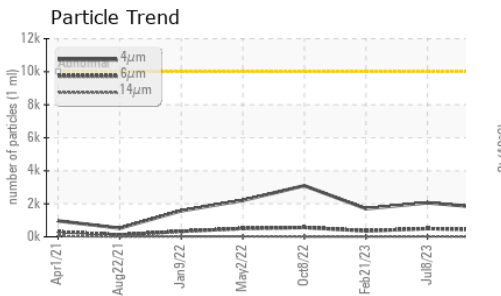
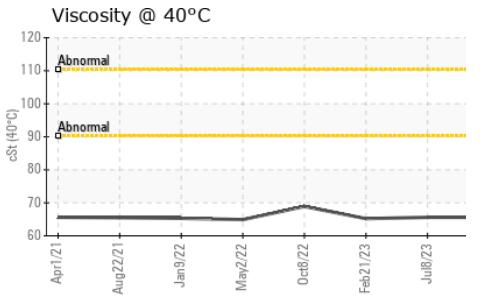
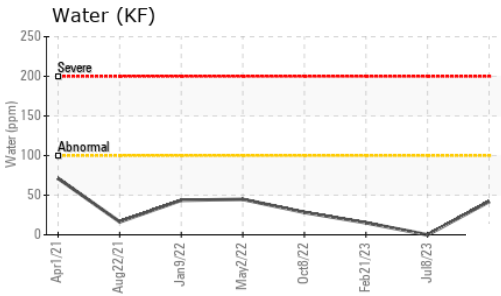
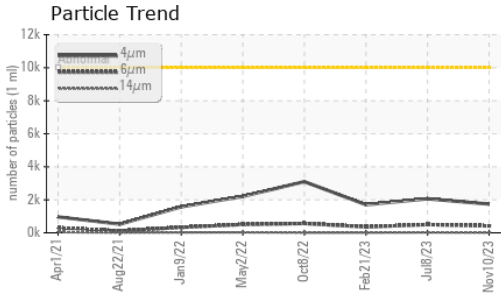
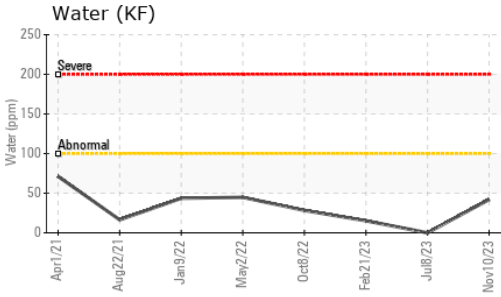


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	65.6	65.6	65.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

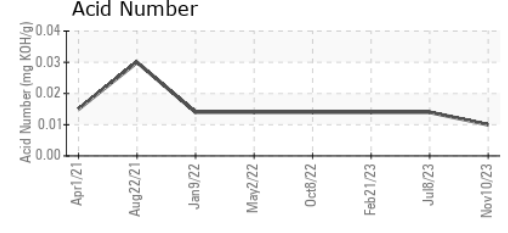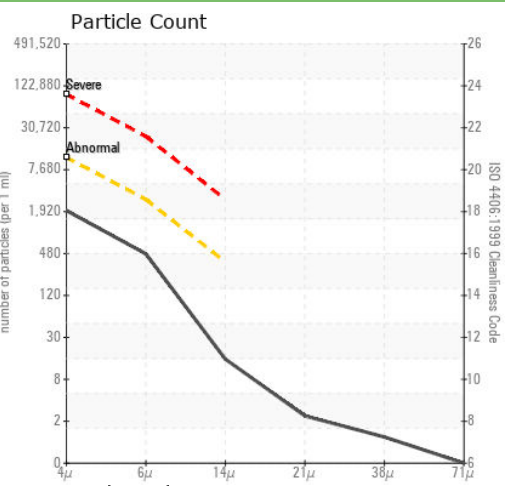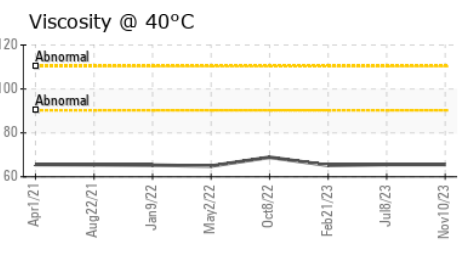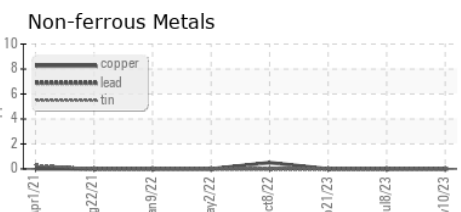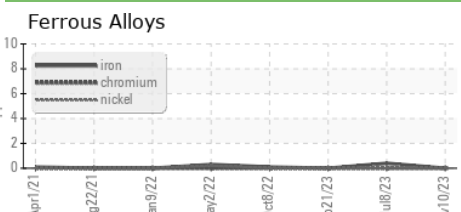

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP0003538 **Received** : 22 Nov 2023  
**Lab Number** : 06015169 **Diagnosed** : 26 Nov 2023  
**Unique Number** : 10754313 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**SMITHFIELD FOODS - NORTH PLANT**  
 601 N CHURCH ST  
 SMITHFIELD, VA  
 US 23430  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: