

# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Machine Id  
**VILTER 103-C (S/N 5716)**

Component  
**Compressor**

Fluid  
**TULCO LUBSOIL 2150 SYNTHETIC 150 (--- LTR)**

**DIAGNOSIS**

**Recommendation**

Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**Contamination**

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

**SAMPLE INFORMATION** method limit/base current history1 history2

Sample Number	Client Info	<b>TO60001555</b>	---	---
Sample Date	Client Info	<b>02 Nov 2023</b>	---	---
Machine Age	hrs Client Info	<b>84105</b>	---	---
Oil Age	hrs Client Info	<b>74062</b>	---	---
Oil Changed	Client Info	<b>Not Changed</b>	---	---
Sample Status		<b>NORMAL</b>	---	---

**WEAR METALS** method limit/base current history1 history2

Iron	ppm	ASTM D5185m	>50	<b>0</b>	---	---
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Titanium	ppm	ASTM D5185m		<b>0</b>	---	---
Silver	ppm	ASTM D5185m		<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>25	<b>&lt;1</b>	---	---
Lead	ppm	ASTM D5185m	>25	<b>0</b>	---	---
Copper	ppm	ASTM D5185m	>50	<b>0</b>	---	---
Tin	ppm	ASTM D5185m	>15	<b>1</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---

**ADDITIVES** method limit/base current history1 history2

Boron	ppm	ASTM D5185m		<b>0</b>	---	---
Barium	ppm	ASTM D5185m		<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	---	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185m		<b>2</b>	---	---
Calcium	ppm	ASTM D5185m		<b>2</b>	---	---
Phosphorus	ppm	ASTM D5185m		<b>21</b>	---	---
Zinc	ppm	ASTM D5185m		<b>0</b>	---	---
Sulfur	ppm	ASTM D5185m		<b>90</b>	---	---

**CONTAMINANTS** method limit/base current history1 history2

Silicon	ppm	ASTM D5185m	>25	<b>0</b>	---	---
Sodium	ppm	ASTM D5185m		<b>0</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	---	---
Water	%	ASTM D6304	>2.0	<b>0.270</b>	---	---
ppm Water	ppm	ASTM D6304	>20000	<b>2701</b>	---	---






**FLUID CLEANLINESS** method limit/base current history1 history2

Particles >4µm		ASTM D7647	>10000	<b>4456</b>	---	---
Particles >6µm		ASTM D7647	>2500	<b>2195</b>	---	---
Particles >14µm		ASTM D7647	>320	<b>199</b>	---	---
Particles >21µm		ASTM D7647	>80	<b>33</b>	---	---
Particles >38µm		ASTM D7647	>20	<b>5</b>	---	---
Particles >71µm		ASTM D7647	>4	<b>3</b>	---	---
Oil Cleanliness		ISO 4406 (c)	>20/18/15	<b>19/18/15</b>	---	---

**FLUID DEGRADATION** method limit/base current history1 history2

Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.32</b>	---	---
------------------	----------	------------	--	-------------	-----	-----

# OIL ANALYSIS REPORT

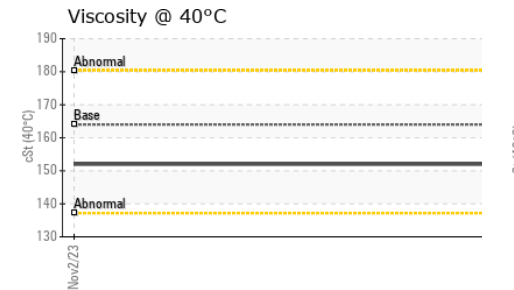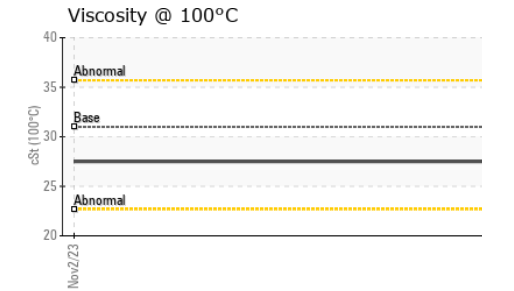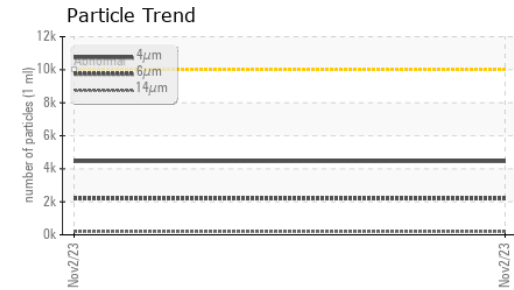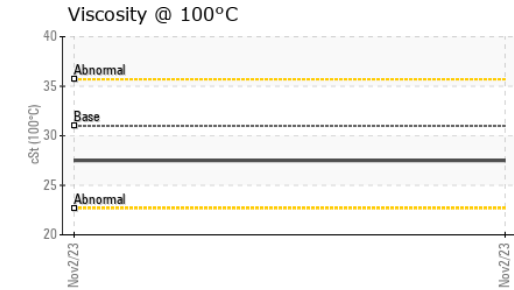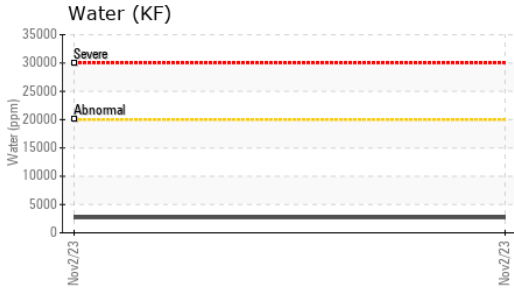





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>2.0	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	164	152	---
Visc @ 100°C	cSt	ASTM D445	31	27.5	---
Viscosity Index (VI)	Scale	ASTM D2270	233	219	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

## GRAPHS

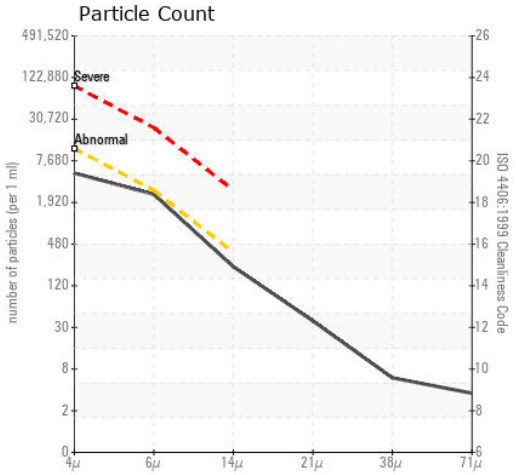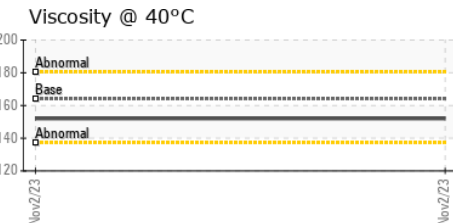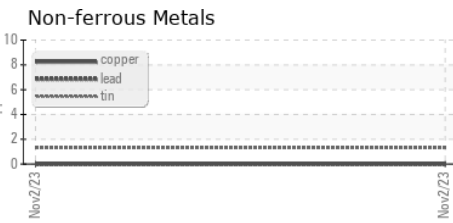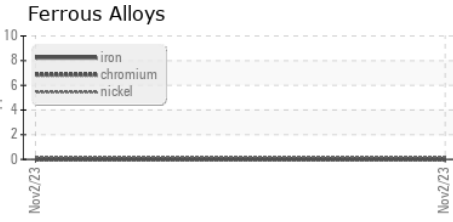

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : TO60001555 **Received** : 22 Nov 2023  
**Lab Number** : 06015186 **Diagnosed** : 26 Nov 2023  
**Unique Number** : 10754330 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, KV100, PrtCount, VI )

**ELK PETROLEUM**  
 23429 ROAD G  
 CORTEZ, CO  
 US 81321-9538  
 Contact: Service Manager

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: