




FUEL REPORT

Sample Rating Trend

WATER



Area
[PMIAS3096796]
 Machine Id
80R0Z1 607277
 Component
Diesel Fuel
 Fluid
NOT GIVEN (--- GAL)

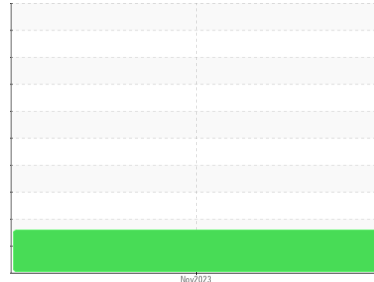

DIAGNOSIS

Recommendation

We advise that you follow the water drain-off procedure for this component. All other laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

Free water present. There is no bacteria or fungus (yeast and/or mold) present in the sample.

Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	DC0030212	---	---
Sample Date	Client Info	23 Nov 2023	---	---
Machine Age	hrs Client Info	1626	---	---
Sample Status		ABNORMAL	---	---

PHYSICAL PROPERTIES

method	limit/base	current	history1	history2
ASTM Color	scalar *ASTM D1500	3.0	---	---
Visc @ 40°C	cSt ASTM D445	2.44	---	---

SULFUR CONTENT

method	limit/base	current	history1	history2
Sulfur	ppm ASTM D5185m	0	---	---
Sulfur (UVF)	ppm ASTM D5453	8	---	---

IGNITION QUALITY

method	limit/base	current	history1	history2
API Gravity	ASTM D7777	37.0	---	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m <1.0	0	---	---
Sodium	ppm ASTM D5185m <0.1	<1	---	---
Potassium	ppm ASTM D5185m <0.1	0	---	---
Water	% ASTM D6304 <0.05	0.005	---	---
ppm Water	ppm ASTM D6304 <500	57	---	---
% Gasoline	% *In-House <0.50	0.0	---	---
% Biodiesel	% *In-House <20.0	0.0	---	---



MICROBIAL

method	limit/base	current	history1	history2
Bacteria	CFU/ml WC-Method >=100000	0	---	---
Yeast	CFU/ml WC-Method >=100000	0	---	---
Mold	Colonies WC-Method MODER	---	---	---

HEAVY METALS


method	limit/base	current	history1	history2
Aluminum	ppm ASTM D5185m <0.1	0	---	---
Nickel	ppm ASTM D5185m <0.1	0	---	---
Lead	ppm ASTM D5185m <0.1	0	---	---
Vanadium	ppm ASTM D5185m <0.1	0	---	---
Iron	ppm ASTM D5185m <0.1	0	---	---
Calcium	ppm ASTM D5185m <0.1	0	---	---
Magnesium	ppm ASTM D5185m <0.1	0	---	---
Phosphorus	ppm ASTM D5185m <0.1	0	---	---
Zinc	ppm ASTM D5185m <0.1	0	---	---

SAMPLE IMAGES



method	limit/base	current	history1	history2
Color			no image	no image
Bottom			no image	no image



FUEL REPORT

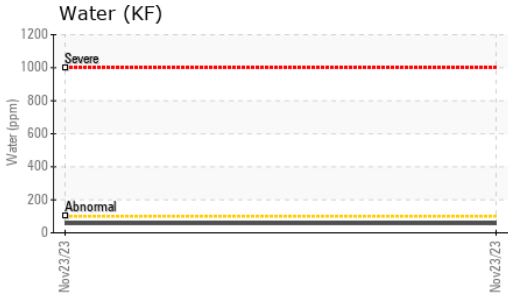

GRAPHS

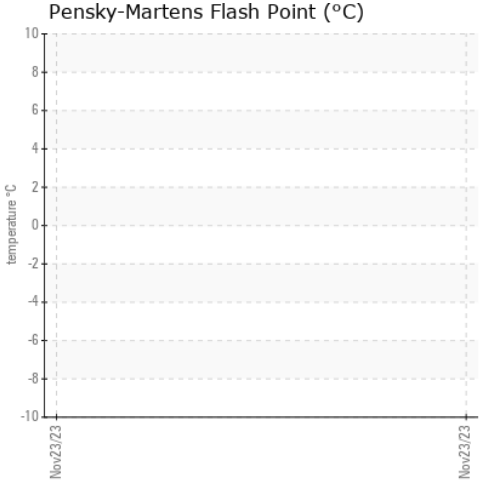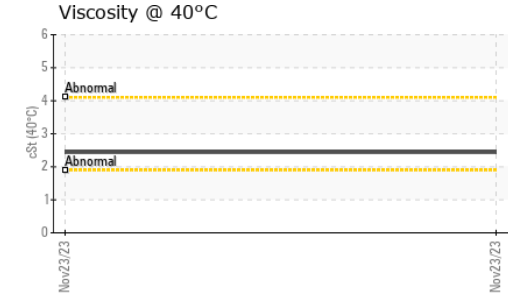

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : DC0030212 **Received** : 22 Nov 2023
Lab Number : 06015983 **Diagnosed** : 13 Dec 2023
Unique Number : 10755127 **Diagnostician** : Doug Bogart
Test Package : DF-5 (Additional Tests: API, Bacteria, Cetane, Fuel, Screen)

KELLY GENERATOR & EQUIPMENT INC
 1955 DALE LN
 OWINGS, MD
 US 20736
 Contact: LESLIE SNURR
 LSNURR@KGE.COM
 T: (410)257-5225
 F: (410)257-5227

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)