


# OIL ANALYSIS REPORT

## Sample Rating Trend



**NORMAL**

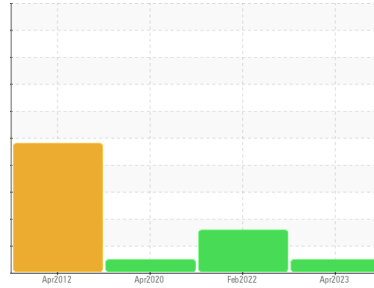

Machine Id  
**G-01**  
Component  
**Wind Turbine Gearbox**  
Fluid  
**ROYAL PURPLE SYNFILM GT 320 (65 GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>MHI021613</b>	MHI019862	MHI022642
Sample Date	Client Info	<b>25 Apr 2023</b>	13 Feb 2022	23 Apr 2020
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	109268
Oil Changed	Client Info	<b>N/A</b>	N/A	Not Changd
Sample Status		<b>NORMAL</b>	ABNORMAL	NORMAL

### WEAR METALS

method	limit/base	current	history1	history2		
PQ	ASTM D8184	>200	<b>12</b>	15	22	
Iron	ppm	ASTM D5185m	>200	<b>25</b>	19	8
Chromium	ppm	ASTM D5185m	>3	<b>&lt;1</b>	0	<1
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>30	<b>2</b>	0	0
Lead	ppm	ASTM D5185m	>15	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>75	<b>16</b>	10	8
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Antimony	ppm	ASTM D5185m	>5	<b>---</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

### ADDITIVES

method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m		<b>0</b>	<1	<1
Barium	ppm	ASTM D5185m		<b>0</b>	0	<1
Molybdenum	ppm	ASTM D5185m		<b>4</b>	3	3
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	90	<b>&lt;1</b>	0	0
Calcium	ppm	ASTM D5185m		<b>0</b>	0	<1
Phosphorus	ppm	ASTM D5185m		<b>211</b>	176	173
Zinc	ppm	ASTM D5185m		<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m		<b>17260</b>	8522	6083






### CONTAMINANTS

method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	>+30	<b>&lt;1</b>	1	1
Sodium	ppm	ASTM D5185m		<b>0</b>	0	1
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	0	0
Water	%	ASTM D6304	>0.1	<b>0.008</b>	0.004	0.004
ppm Water	ppm	ASTM D6304	>1000	<b>83</b>	43.0	41.2

### FLUID CLEANLINESS

method	limit/base	current	history1	history2	
Particles >4µm	ASTM D7647		<b>17845</b>	217293	11821
Particles >6µm	ASTM D7647	>5000	<b>569</b>	▲ 151786	448
Particles >14µm	ASTM D7647	>640	<b>7</b>	▲ 20360	11
Particles >21µm	ASTM D7647	>160	<b>4</b>	▲ 2027	3
Particles >38µm	ASTM D7647	>40	<b>1</b>	▲ 45	0
Particles >71µm	ASTM D7647	>10	<b>1</b>	2	0
Oil Cleanliness	ISO 4406 (c)	>--/19/16	<b>21/16/10</b>	▲ 25/24/22	21/16/11

# OIL ANALYSIS REPORT

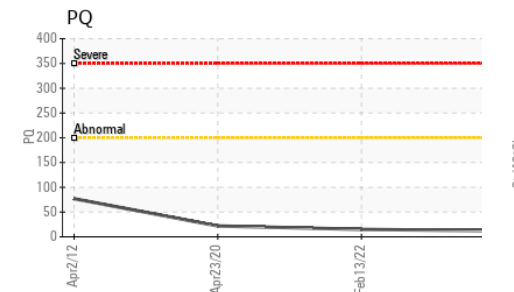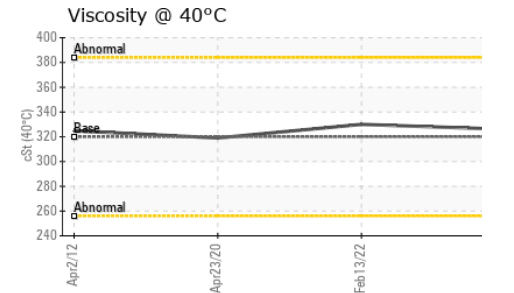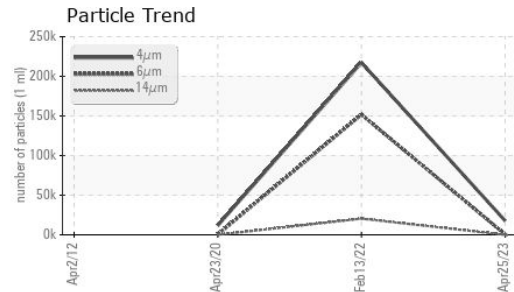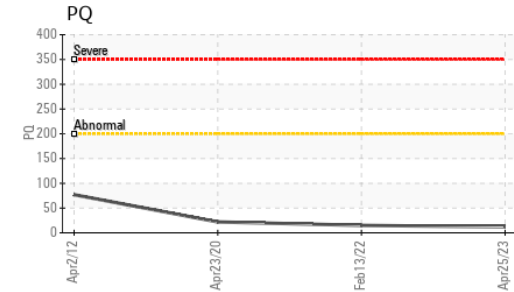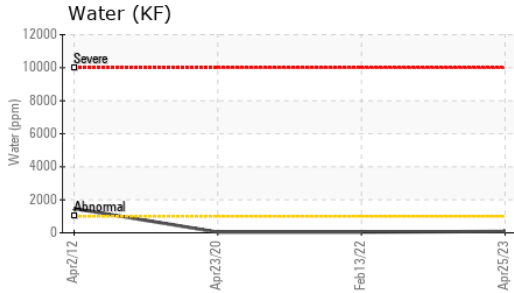


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.25	<b>0.70</b>	0.70	0.788






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	320	<b>326</b>	330	319

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

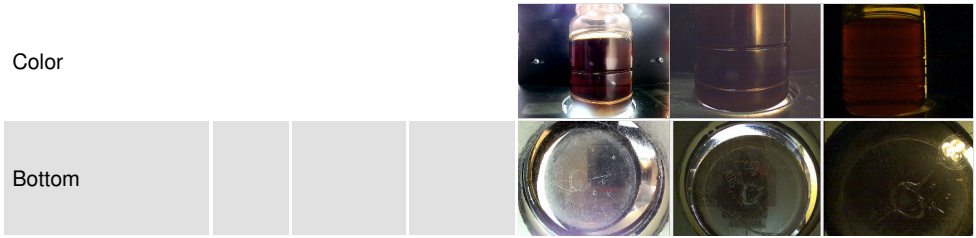

## GRAPHS

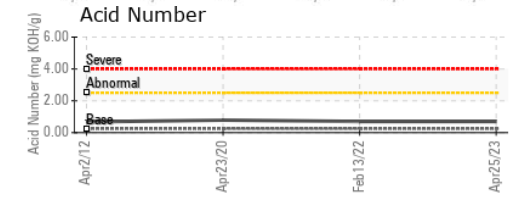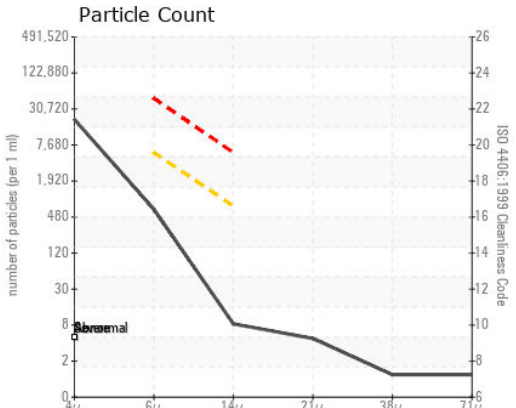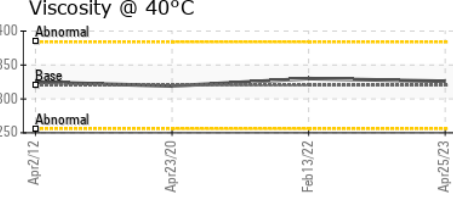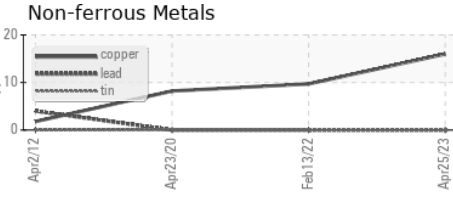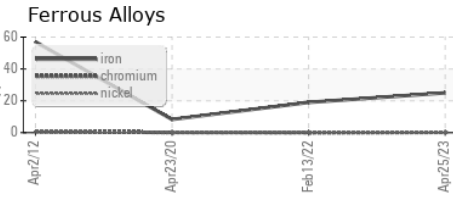

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : MHI021613 **Received** : 24 Nov 2023  
**Lab Number** : 06016356 **Diagnosed** : 28 Nov 2023  
**Unique Number** : 10755500 **Diagnostician** : Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: KF, PQ, PrtCount )

**DIAMOND WTG - WHITE DEER SITE - MPS WD**  
 PO BOX 872  
 WHITE DEER, TX  
 US 79097  
 Contact: WESLEY CAMPBELL  
 wesley.campbell@diamondwtg.com  
 T: (806)883-1051  
 F: (806)883-2004

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)