


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

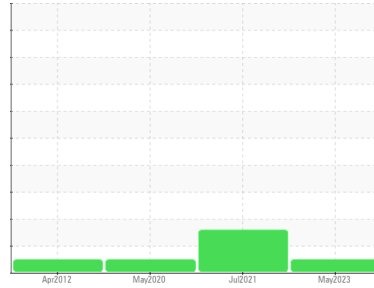

Machine Id
H-04
Component
Hydraulic System
Fluid
MOBIL DTE 10 EXCEL 32 (45 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			MHI021615	MHI019353	MHI022617
Sample Date	Client Info			11 May 2023	22 Jul 2021	08 May 2020
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	114623
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				NORMAL	ABNORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	23	16	11
Chromium	ppm	ASTM D5185m	>20	<1	0	<1
Nickel	ppm	ASTM D5185m	>20	1	1	<1
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>20	2	0	0
Lead	ppm	ASTM D5185m	>20	<1	<1	<1
Copper	ppm	ASTM D5185m	>20	<1	<1	<1
Tin	ppm	ASTM D5185m	>20	0	0	0
Antimony	ppm	ASTM D5185m		---	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	<1
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m		3	1	3
Calcium	ppm	ASTM D5185m	120	132	135	124
Phosphorus	ppm	ASTM D5185m	475	424	479	448
Zinc	ppm	ASTM D5185m		15	13	16
Sulfur	ppm	ASTM D5185m	1275	1770	1398	1400

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>+30	<1	<1	2
Sodium	ppm	ASTM D5185m		0	2	2
Potassium	ppm	ASTM D5185m	>20	1	0	0
Water	%	ASTM D6304	>0.1	0.012	0.041	0.002
ppm Water	ppm	ASTM D6304	>1000	121	412.4	22.3

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	729	▲ 26913	1863
Particles >6µm		ASTM D7647	>1300	193	▲ 6019	366
Particles >14µm		ASTM D7647	>160	50	▲ 623	30
Particles >21µm		ASTM D7647	>40	25	▲ 157	7
Particles >38µm		ASTM D7647	>10	2	3	0
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>19/17/14	17/15/13	▲ 22/20/16	18/16/12

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.154	0.04	0.108


OIL ANALYSIS REPORT

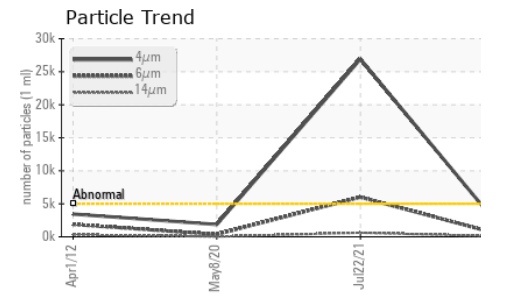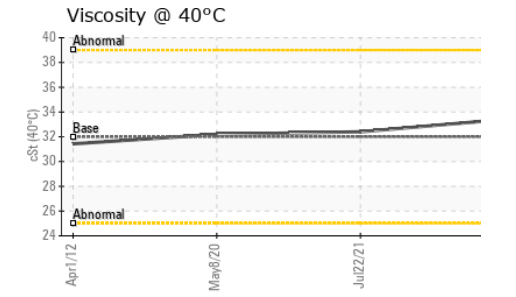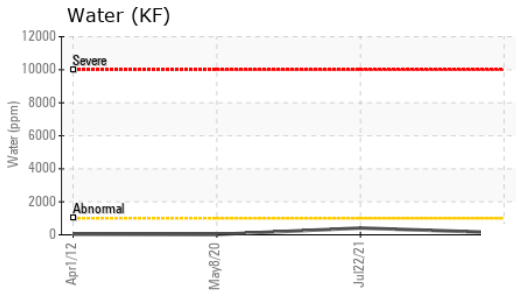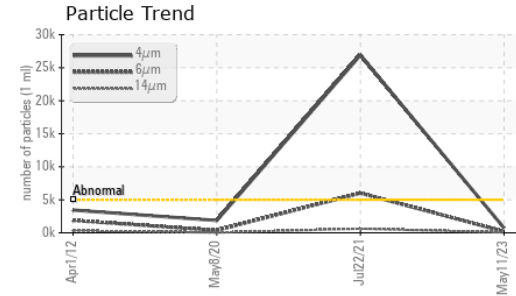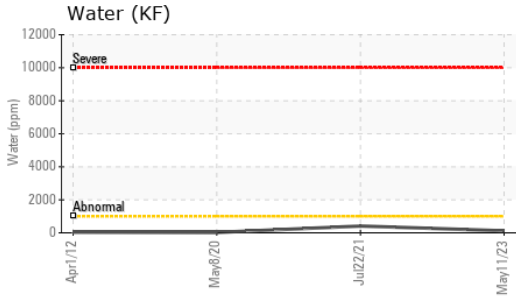






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	VLITE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 32	33.4	32.4	32.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

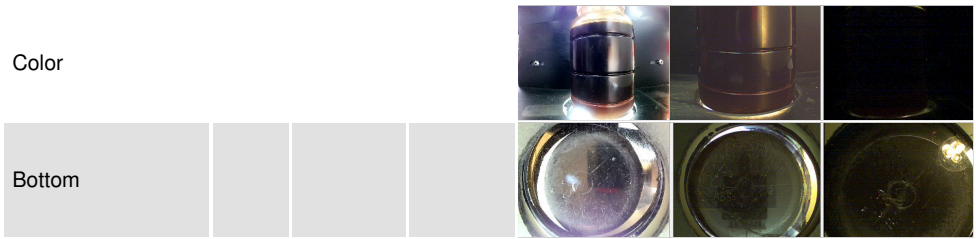

GRAPHS

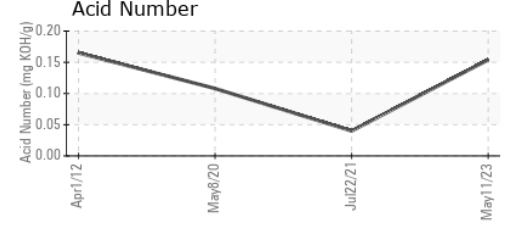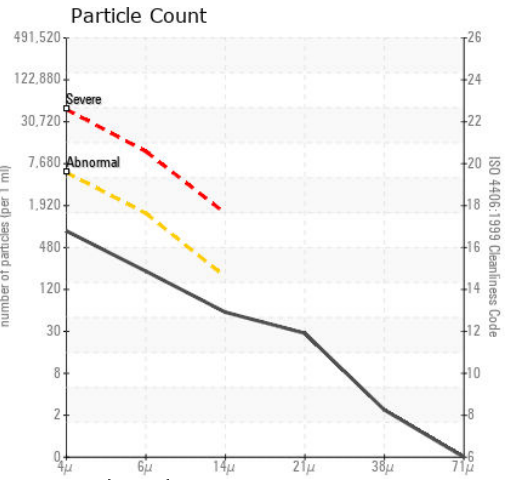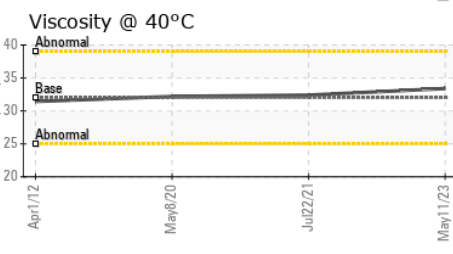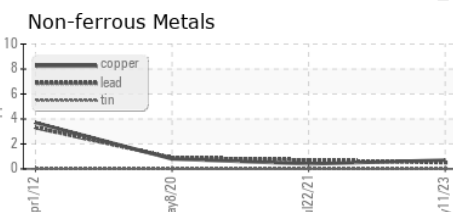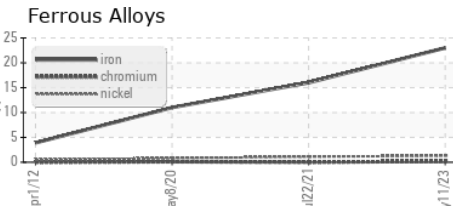

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : MH1021615 Received : 24 Nov 2023
 Lab Number : 06016375 Diagnosed : 28 Nov 2023
 Unique Number : 10755519 Diagnostician : Jonathan Hester
 Test Package : IND 2 (Additional Tests: KF)

DIAMOND WTG - WHITE DEER SITE - MPS WD
 PO BOX 872
 WHITE DEER, TX
 US 79097
 Contact: WESLEY CAMPBELL
 wesley.campbell@diamondwtg.com
 T: (806)883-1051
 F: (806)883-2004

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)