


PROBLEM SUMMARY

Sample Rating Trend




ISO

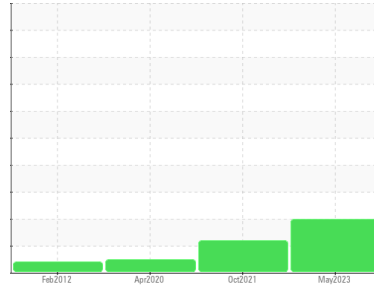

Machine Id
F-09
Component
Hydraulic System
Fluid
MOBIL DTE 10 EXCEL 32 (45 GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

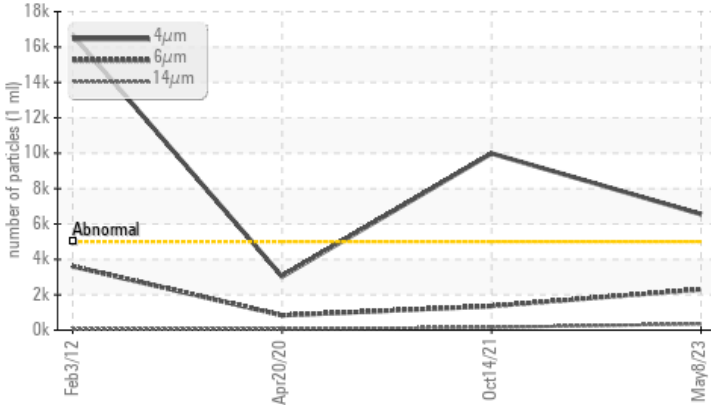

RECOMMENDATION

Re-sample to verify the actual oil condition. Replace filter elements. Change oil if cleanliness level does not improve after replacing the filter(s).

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ATTENTION	NORMAL
Particles >4µm	ASTM D7647	>5000	▲ 6553	▲ 9987	3027
Particles >6µm	ASTM D7647	>1300	▲ 2302	▲ 1361	839
Particles >14µm	ASTM D7647	>160	▲ 355	157	78
Particles >21µm	ASTM D7647	>40	▲ 90	71	22
Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ 20/18/16	▲ 20/18/14	19/17/13

Customer Id: MITWHI
Sample No.: MHI021779
Lab Number: 06016376
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	Re-sample to verify the actual oil condition. Replace filter elements. Change oil if cleanliness level does not improve after replacing the filter(s).
Resample	---	---	?	Re-sample to verify the actual oil condition. Replace filter elements. Change oil if cleanliness level does not improve after replacing the filter(s).

HISTORICAL DIAGNOSIS

14 Oct 2021 Diag: Doug Bogart

ISO



Re-sample to verify the actual oil condition. Replace filter elements. Change oil if cleanliness level does not improve after replacing the filter(s). All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid.

view report



20 Apr 2020 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



03 Feb 2012 Diag: Jonathan Hester

ISO




No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The condition of oil is suitable for further service.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

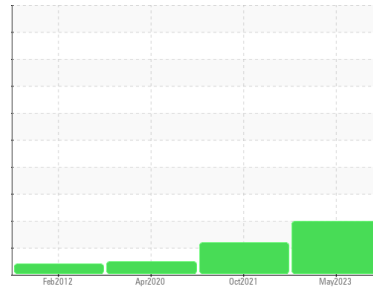

ISO



Machine Id
F-09
Component
Hydraulic System
Fluid
MOBIL DTE 10 EXCEL 32 (45 GAL)

DIAGNOSIS

Recommendation

Re-sample to verify the actual oil condition. Replace filter elements. Change oil if cleanliness level does not improve after replacing the filter(s).

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			MHI021779	MHI017128	MHI022632
Sample Date	Client Info			08 May 2023	14 Oct 2021	20 Apr 2020
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	98294
Oil Changed	Client Info			N/A	N/A	Not Changd
Sample Status				ABNORMAL	ATTENTION	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	8	3	5
Chromium	ppm	ASTM D5185m	>20	<1	0	<1
Nickel	ppm	ASTM D5185m	>20	<1	0	<1
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>20	2	0	0
Lead	ppm	ASTM D5185m	>20	0	<1	2
Copper	ppm	ASTM D5185m	>20	<1	<1	2
Tin	ppm	ASTM D5185m	>20	0	0	<1
Antimony	ppm	ASTM D5185m		---	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	<1
Barium	ppm	ASTM D5185m		0	0	<1
Molybdenum	ppm	ASTM D5185m		0	0	<1
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m		4	6	7
Calcium	ppm	ASTM D5185m	120	135	136	143
Phosphorus	ppm	ASTM D5185m	475	442	439	443
Zinc	ppm	ASTM D5185m		7	28	29
Sulfur	ppm	ASTM D5185m	1275	1677	1503	1525


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>+30	<1	0	3
Sodium	ppm	ASTM D5185m		0	2	2
Potassium	ppm	ASTM D5185m	>20	2	0	<1
Water	%	ASTM D6304	>0.1	0.010	0.003	0.004
ppm Water	ppm	ASTM D6304	>1000	101	39.5	44.7

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	▲ 6553	▲ 9987	3027
Particles >6µm		ASTM D7647	>1300	▲ 2302	▲ 1361	839
Particles >14µm		ASTM D7647	>160	▲ 355	157	78
Particles >21µm		ASTM D7647	>40	▲ 90	▲ 71	22
Particles >38µm		ASTM D7647	>10	3	5	1
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>19/17/14	▲ 20/18/16	▲ 20/18/14	19/17/13


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.091	0.07	0.059

OIL ANALYSIS REPORT


Particle Trend

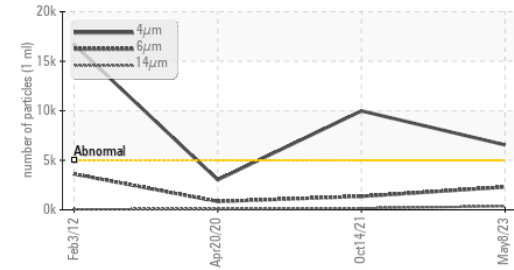


Water (KF)

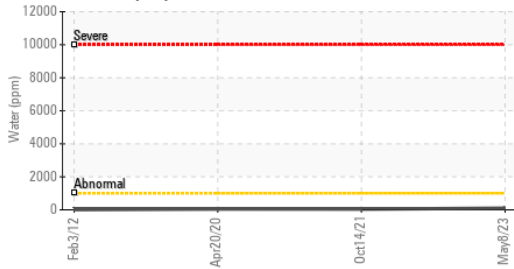


Acid Number

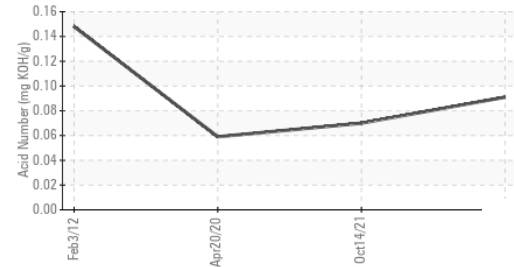

Water (KF)

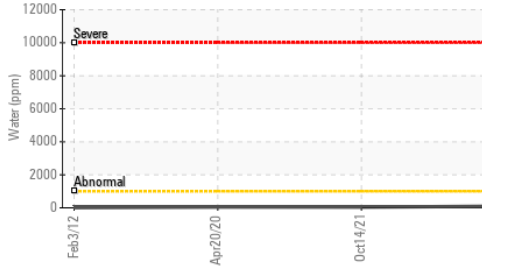


Viscosity @ 40°C

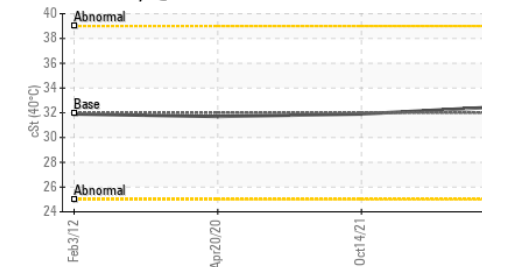

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	LIGHT	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 32	32.5	31.9	31.7

SAMPLE IMAGES

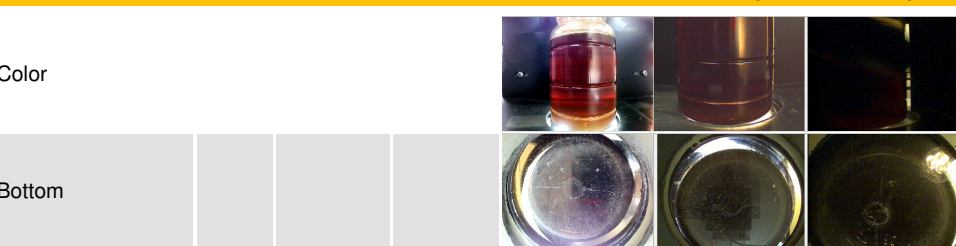


GRAPHS


Ferrous Alloys

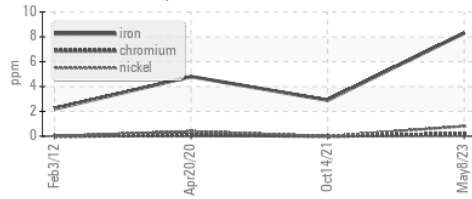


Non-ferrous Metals

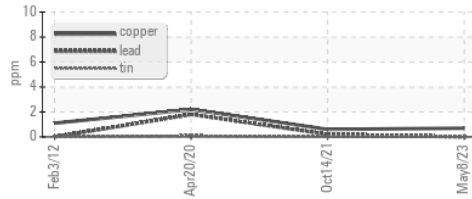


Viscosity @ 40°C

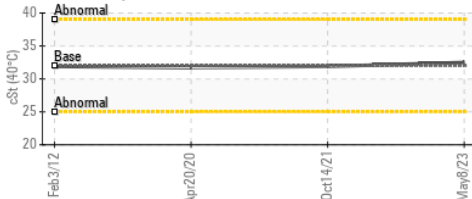

Particle Count

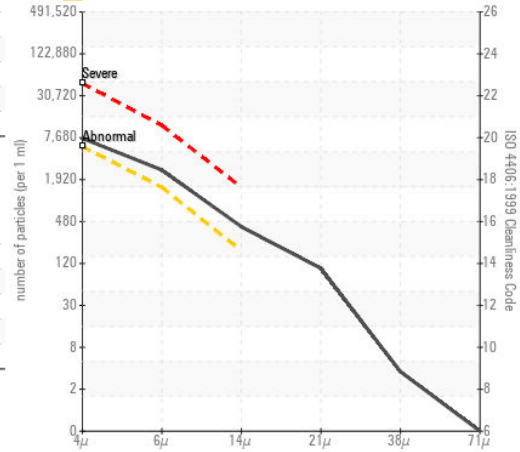

Acid Number

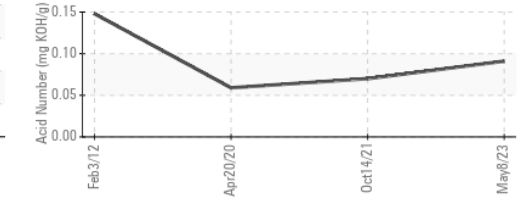

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : MHI021779
 Lab Number : 06016376
 Unique Number : 10755520
 Test Package : IND 2 (Additional Tests: KF)

Received : 24 Nov 2023
 Diagnosed : 28 Nov 2023
 Diagnostician : Jonathan Hester

DIAMOND WTG - WHITE DEER SITE - MPS WD
 PO BOX 872
 WHITE DEER, TX
 US 79097

Contact: WESLEY CAMPBELL
 wesley.campbell@diamondwtg.com

T: (806)883-1051
 F: (806)883-2004

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)