




# PROBLEM SUMMARY

Sample Rating Trend

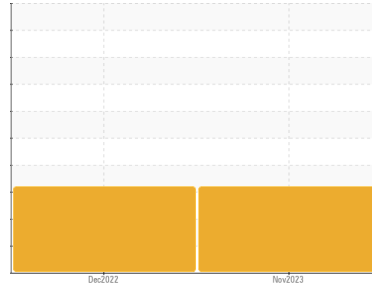

## ADDITIVES




Machine Id  
**KAESER 2885032**

Component  
**Compressor**


Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

### COMPONENT CONDITION SUMMARY

▲ Particle Trend

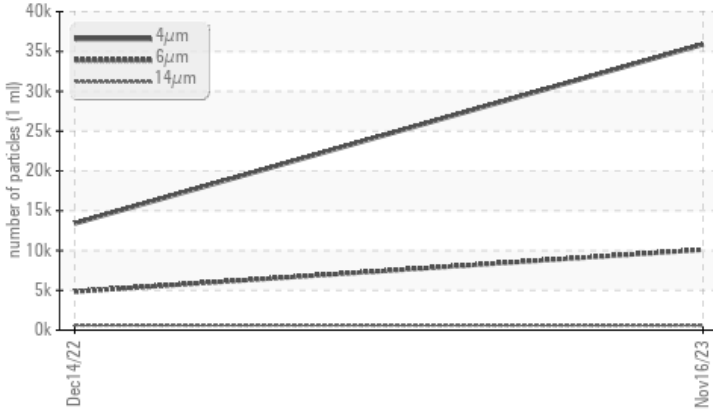

▲ Additives

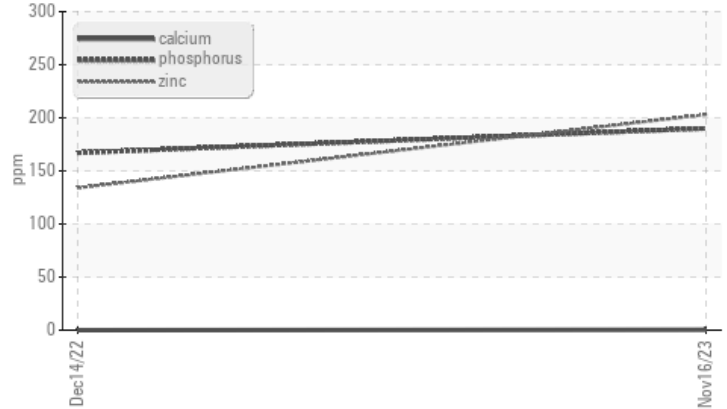

### RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	ABNORMAL	---
Phosphorus	ppm	ASTM D5185m	0	▲ 190	▲ 167	---
Zinc	ppm	ASTM D5185m	0	▲ 203	▲ 134	---
Sulfur	ppm	ASTM D5185m	23500	▲ 3947	▲ 1718	---
Particles >6µm		ASTM D7647	>1300	▲ 10103	▲ 4843	---
Particles >14µm		ASTM D7647	>80	▲ 604	▲ 629	---
Particles >21µm		ASTM D7647	>20	▲ 166	▲ 167	---
Particles >38µm		ASTM D7647	>4	▲ 12	▲ 18	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 22/21/16	▲ 21/19/16	---

Customer Id: STUIND  
Sample No.: KCPA010767  
Lab Number: 06016418  
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Jonathan Hester +1 919-379-4092 x4092  
[jhester@wearcheckusa.com](mailto:jhester@wearcheckusa.com)

To change component or sample information:  
Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

**14 Dec 2022 Diag: Doug Bogart**

### ADDITIVES




No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. Additive levels indicate the addition of a different brand, or type of oil. Confirm oil type. The AN level is acceptable for this fluid.

view report



# OIL ANALYSIS REPORT

Sample Rating Trend

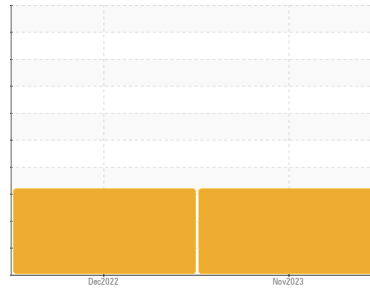

**ADDITIVES**



Machine Id  
**KAESER 2885032**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

**DIAGNOSIS**

▲ **Recommendation**

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

▲ **Contamination**

There is a high amount of particulates present in the oil.

▲ **Fluid Condition**

Additive levels indicate the addition of a different brand, or type of oil. Confirm oil type. The AN level is acceptable for this fluid.

**SAMPLE INFORMATION**

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA010767</b>	KCP49004	---
Sample Date	Client Info		<b>16 Nov 2023</b>	14 Dec 2022	---
Machine Age	hrs	Client Info	<b>51200</b>	47568	---
Oil Age	hrs	Client Info	<b>0</b>	3000	---
Oil Changed	Client Info		<b>N/A</b>	Not Changd	---
Sample Status			<b>ABNORMAL</b>	ABNORMAL	---

**WEAR METALS**

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>3</b>	3	---
Chromium	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	---
Nickel	ppm	ASTM D5185m >3	<b>&lt;1</b>	0	---
Titanium	ppm	ASTM D5185m >3	<b>&lt;1</b>	0	---
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m >10	<b>2</b>	5	---
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	---
Copper	ppm	ASTM D5185m >50	<b>15</b>	2	---
Tin	ppm	ASTM D5185m >10	<b>&lt;1</b>	<1	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	0	---

**ADDITIVES**

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	---
Barium	ppm	ASTM D5185m 90	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m 0	<b>&lt;1</b>	0	---
Manganese	ppm	ASTM D5185m	<b>0</b>	0	---
Magnesium	ppm	ASTM D5185m 100	<b>0</b>	0	---
Calcium	ppm	ASTM D5185m 0	<b>&lt;1</b>	0	---
Phosphorus	ppm	ASTM D5185m 0	<b>▲ 190</b>	▲ 167	---
Zinc	ppm	ASTM D5185m 0	<b>▲ 203</b>	▲ 134	---
Sulfur	ppm	ASTM D5185m 23500	<b>▲ 3947</b>	▲ 1718	---

**CONTAMINANTS**

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	<1	---
Sodium	ppm	ASTM D5185m	<b>0</b>	<1	---
Potassium	ppm	ASTM D5185m >20	<b>1</b>	0	---
Water	%	ASTM D6304 >0.05	<b>0.009</b>	0.002	---
ppm Water	ppm	ASTM D6304 >500	<b>93</b>	20.6	---






**FLUID CLEANLINESS**

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>35888</b>	13390	---
Particles >6µm	ASTM D7647	>1300	<b>▲ 10103</b>	▲ 4843	---
Particles >14µm	ASTM D7647	>80	<b>▲ 604</b>	▲ 629	---
Particles >21µm	ASTM D7647	>20	<b>▲ 166</b>	▲ 167	---
Particles >38µm	ASTM D7647	>4	<b>▲ 12</b>	▲ 18	---
Particles >71µm	ASTM D7647	>3	<b>0</b>	1	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	<b>▲ 22/21/16</b>	▲ 21/19/16	---

**FLUID DEGRADATION**

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	<b>0.59</b>	0.46	---


# OIL ANALYSIS REPORT

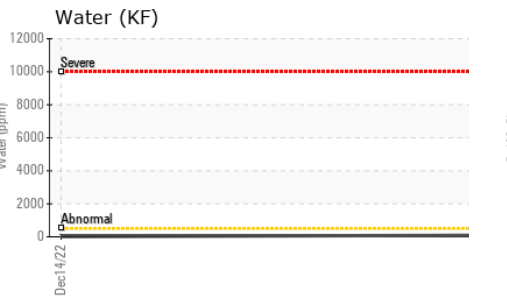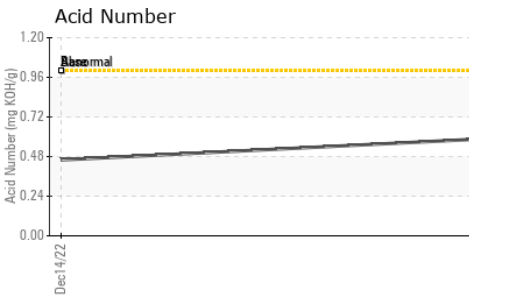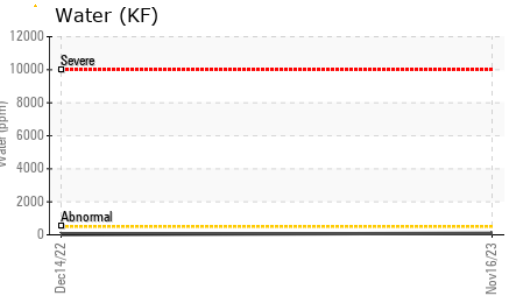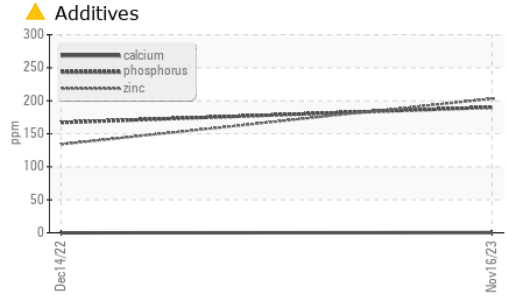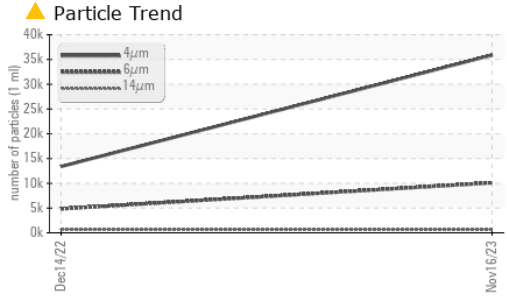






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	47.5	46.5	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

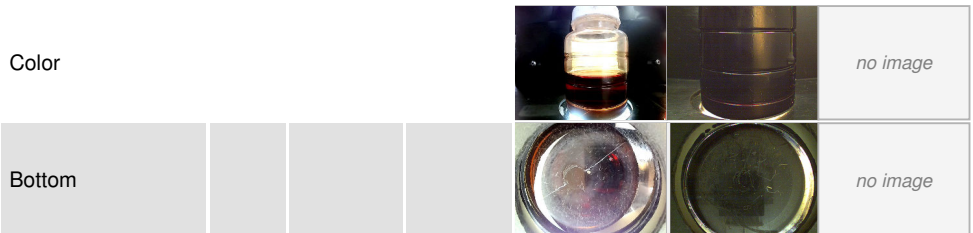

## GRAPHS

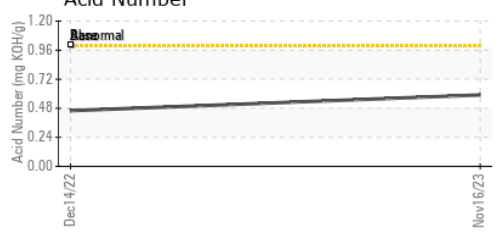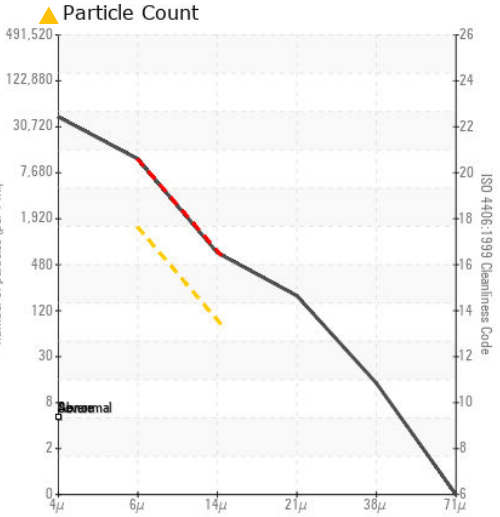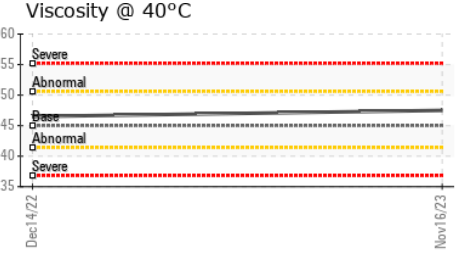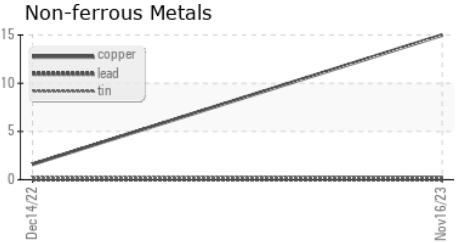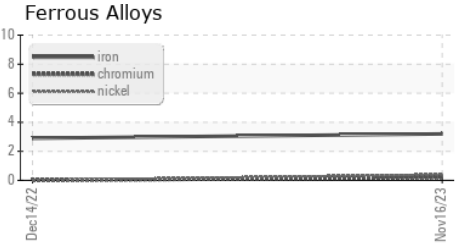

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA010767 **Received** : 24 Nov 2023  
**Lab Number** : 06016418 **Diagnosed** : 28 Nov 2023  
**Unique Number** : 10755562 **Diagnostician** : Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**STUTZ PACKING COMPANY**  
 82689 AVE 45  
 INDIIO, CA  
 US 92201  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)