PROBLEM SUMMARY

Sample Rating Trend

WATER

Machine Id
KAESER 7361337 (S/N 2592)
Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

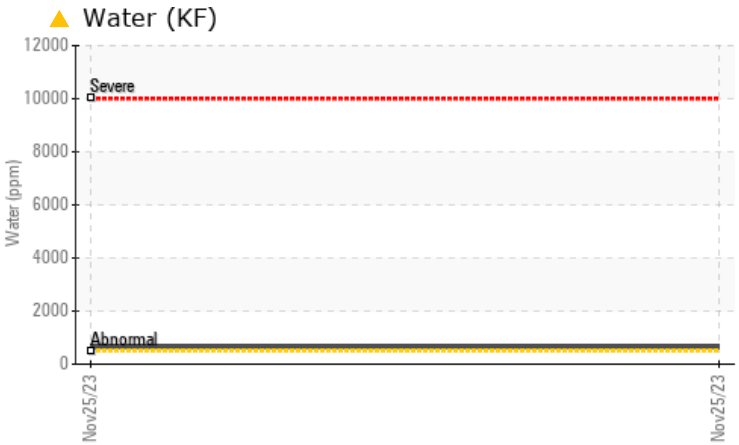

RECOMMENDATION

The filter change at the time of sampling has been noted. We were unable to perform a particle count on this sample. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status				**ABNORMAL**	---	---
Water	%	ASTM D6304	>0.05	▲ **0.065**	---	---
ppm Water	ppm	ASTM D6304	>500	▲ **650**	---	---

Customer Id: GRAIRVCA
Sample No.: KCPA007155
Lab Number: 06016422
Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data:
Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Alert	---	---	?	We were unable to perform a particle count due to a high concentration of particles present in this sample.

HISTORICAL DIAGNOSIS

KAESER COMPRESSORS
Built for a lifetime.

OIL ANALYSIS REPORT

Sample Rating Trend

WATER

Machine Id
KAESER 7361337 (S/N 2592)
Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation
The filter change at the time of sampling has been noted. We were unable to perform a particle count on this sample. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

Wear
All component wear rates are normal.

Contamination
There is a light concentration of water present in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**KCPA007155**	---	---
Sample Date		Client Info		**25 Nov 2023**	---	---
Machine Age	hrs	Client Info		**22828**	---	---
Oil Age	hrs	Client Info		**0**	---	---
Oil Changed		Client Info		**N/A**	---	---
Sample Status				**ABNORMAL**	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	**<1**	---	---
Chromium	ppm	ASTM D5185m	>10	**<1**	---	---
Nickel	ppm	ASTM D5185m	>3	**<1**	---	---
Titanium	ppm	ASTM D5185m	>3	**<1**	---	---
Silver	ppm	ASTM D5185m	>2	**0**	---	---
Aluminum	ppm	ASTM D5185m	>10	**2**	---	---
Lead	ppm	ASTM D5185m	>10	**0**	---	---
Copper	ppm	ASTM D5185m	>50	**29**	---	---
Tin	ppm	ASTM D5185m	>10	**0**	---	---
Vanadium	ppm	ASTM D5185m		**0**	---	---
Cadmium	ppm	ASTM D5185m		**<1**	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		**0**	---	---
Barium	ppm	ASTM D5185m	90	**0**	---	---
Molybdenum	ppm	ASTM D5185m		**<1**	---	---
Manganese	ppm	ASTM D5185m		**<1**	---	---
Magnesium	ppm	ASTM D5185m	90	**10**	---	---
Calcium	ppm	ASTM D5185m	2	**1**	---	---
Phosphorus	ppm	ASTM D5185m		**0**	---	---
Zinc	ppm	ASTM D5185m		**26**	---	---
Sulfur	ppm	ASTM D5185m		**21483**	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	**2**	---	---
Sodium	ppm	ASTM D5185m		**<1**	---	---
Potassium	ppm	ASTM D5185m	>20	**1**	---	---
Water	%	ASTM D6304	>0.05	▲ **0.065**	---	---
ppm Water	ppm	ASTM D6304	>500	▲ **650**	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	**0.29**	---	---

KAESER COMPRESSORS
Built for a lifetime.

OIL ANALYSIS REPORT

Water (KF)

Acid Number

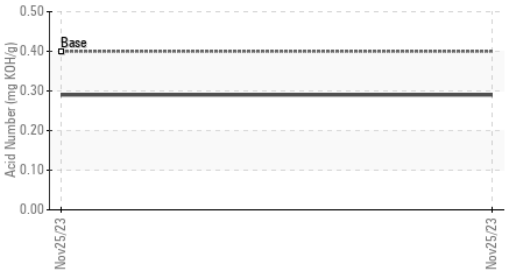

Viscosity @ 40°C

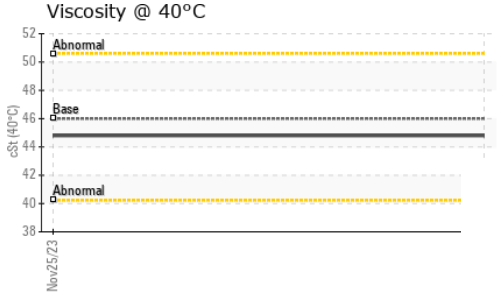

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**MODER**	---	---
Yellow Metal	scalar	*Visual	NONE	**NONE**	---	---
Precipitate	scalar	*Visual	NONE	**NONE**	---	---
Silt	scalar	*Visual	NONE	**NONE**	---	---
Debris	scalar	*Visual	NONE	**NONE**	---	---
Sand/Dirt	scalar	*Visual	NONE	**NONE**	---	---
Appearance	scalar	*Visual	NORML	**NORML**	---	---
Odor	scalar	*Visual	NORML	**NORML**	---	---
Emulsified Water	scalar	*Visual	>0.05	**0.2%**	---	---
Free Water	scalar	*Visual		**NEG**	---	---

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	**44.8**	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				*no image*	*no image*
Bottom				*no image*	*no image*

GRAPHS

Ferrous Alloys

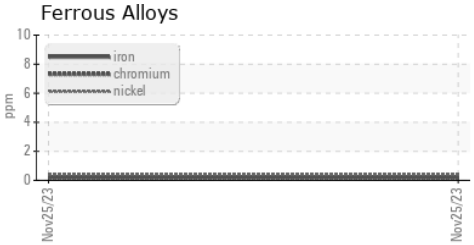

Non-ferrous Metals

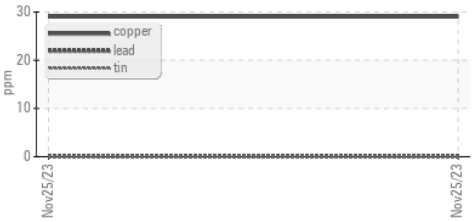

Viscosity @ 40°C

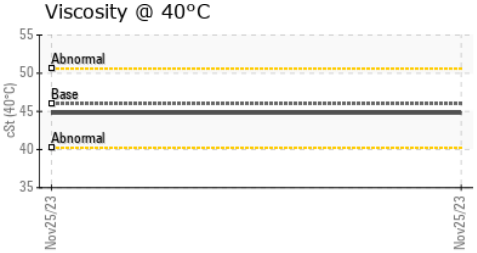

Acid Number

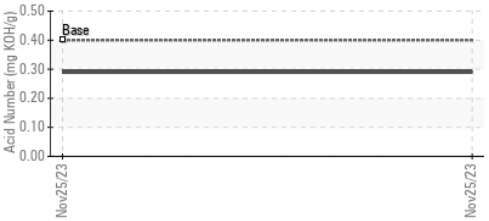

ANAB ACCREDITED ISO/IEC 17025 TESTING LABORATORY
Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA007155 **Received** : 24 Nov 2023
Lab Number : 06016422 **Diagnosed** : 28 Nov 2023
Unique Number : 10755566 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

GRAPHIC PACKAGING INTERNATIONAL
1600 BARRANCA PKWY
IRVINE, CA
US 92606
Contact: Service Manager
T:
F: