




# PROBLEM SUMMARY

Sample Rating Trend

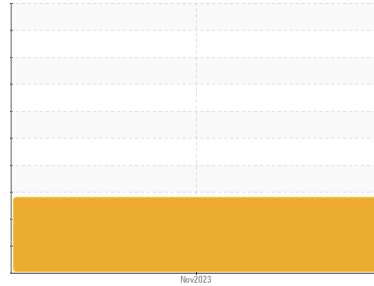


DEGRADATION




Machine Id  
**KAESER DSG 220-2 SFC W 8239314 (S/N 1355)**  
 Component  
**Compressor**  
 Fluid  
**G-680 (--- GAL)**

## COMPONENT CONDITION SUMMARY

### ▲ Acid Number

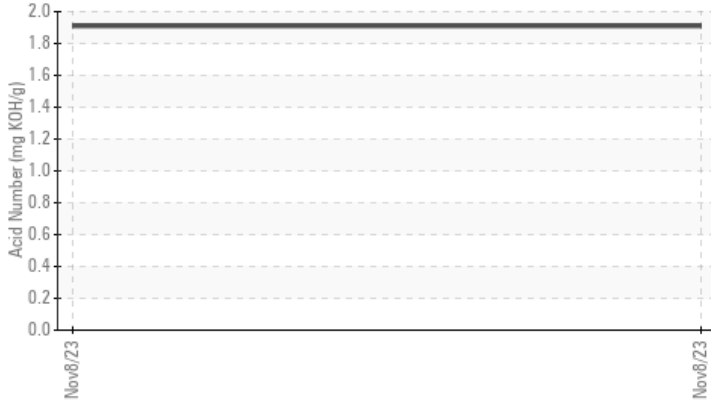

### ▲ Particle Trend

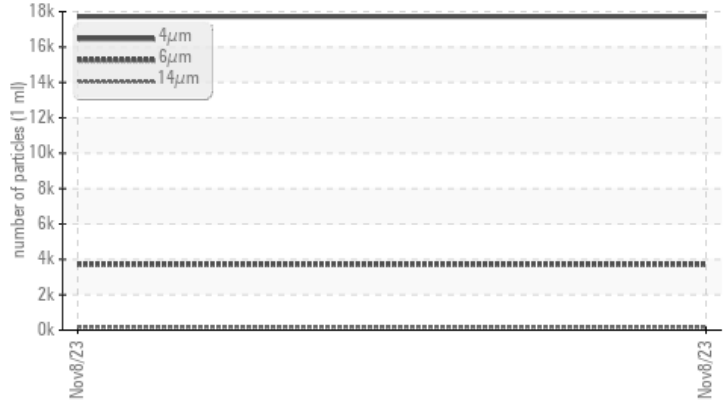

## RECOMMENDATION

Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition.

## PROBLEMATIC TEST RESULTS

Sample Status			<b>ABNORMAL</b>	---	---
Particles >6µm	ASTM D7647	>1300	▲ <b>3715</b>	---	---
Particles >14µm	ASTM D7647	>80	▲ <b>171</b>	---	---
Particles >21µm	ASTM D7647	>20	▲ <b>40</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ <b>21/19/15</b>	---	---
Acid Number (AN)	mg KOH/g	ASTM D8045	▲ <b>1.91</b>	---	---

Customer Id: JACLONKC  
 Sample No.: KC109663  
 Lab Number: 06016426  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Jonathan Hester +1 919-379-4092 x4092  
[jhester@wearcheckusa.com](mailto:jhester@wearcheckusa.com)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)


## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

## HISTORICAL DIAGNOSIS

# OIL ANALYSIS REPORT

Sample Rating Trend

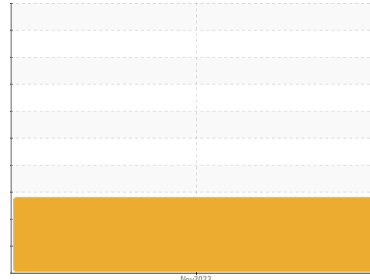

**DEGRADATION**



Machine Id  
**KAESER DSG 220-2 SFC W 8239314 (S/N 1355)**

Component  
**Compressor**  
Fluid  
**G-680 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition.

### Wear

All component wear rates are normal.

### ▲ Contamination

There is a high amount of particulates present in the oil.

### ▲ Fluid Condition

The AN level is at the top-end of the recommended limit.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KC109663</b>	---	---
Sample Date	Client Info		<b>08 Nov 2023</b>	---	---
Machine Age	hrs	Client Info	<b>11667</b>	---	---
Oil Age	hrs	Client Info	<b>3000</b>	---	---
Oil Changed	Client Info		<b>Changed</b>	---	---
Sample Status			<b>ABNORMAL</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	---	---
Chromium	ppm	ASTM D5185m >10	<1	---	---
Nickel	ppm	ASTM D5185m >3	<1	---	---
Titanium	ppm	ASTM D5185m >3	<1	---	---
Silver	ppm	ASTM D5185m >2	0	---	---
Aluminum	ppm	ASTM D5185m >10	2	---	---
Lead	ppm	ASTM D5185m >10	1	---	---
Copper	ppm	ASTM D5185m >50	4	---	---
Tin	ppm	ASTM D5185m >10	0	---	---
Vanadium	ppm	ASTM D5185m	0	---	---
Cadmium	ppm	ASTM D5185m	<1	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	---	---
Barium	ppm	ASTM D5185m	0	---	---
Molybdenum	ppm	ASTM D5185m	<1	---	---
Manganese	ppm	ASTM D5185m	<1	---	---
Magnesium	ppm	ASTM D5185m	2	---	---
Calcium	ppm	ASTM D5185m	1	---	---
Phosphorus	ppm	ASTM D5185m	<b>584</b>	---	---
Zinc	ppm	ASTM D5185m	<b>10</b>	---	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	---	---
Sodium	ppm	ASTM D5185m	0	---	---
Potassium	ppm	ASTM D5185m >20	1	---	---
Water	%	ASTM D6304 >0.05	<b>0.015</b>	---	---
ppm Water	ppm	ASTM D6304 >500	<b>155</b>	---	---

## FLUID CLEANLINESS


	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>17717</b>	---	---
Particles >6µm	ASTM D7647	>1300	▲ <b>3715</b>	---	---
Particles >14µm	ASTM D7647	>80	▲ <b>171</b>	---	---
Particles >21µm	ASTM D7647	>20	▲ <b>40</b>	---	---
Particles >38µm	ASTM D7647	>4	<b>3</b>	---	---
Particles >71µm	ASTM D7647	>3	<b>1</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ <b>21/19/15</b>	---	---

## FLUID DEGRADATION


	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	▲ <b>1.91</b>	---	---

# OIL ANALYSIS REPORT


## Particle Trend

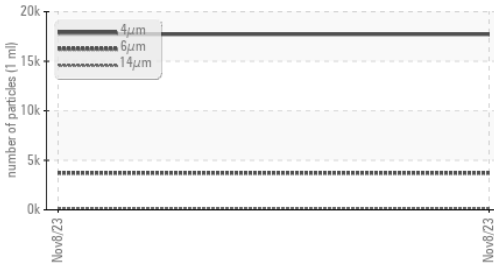

## Water (KF)

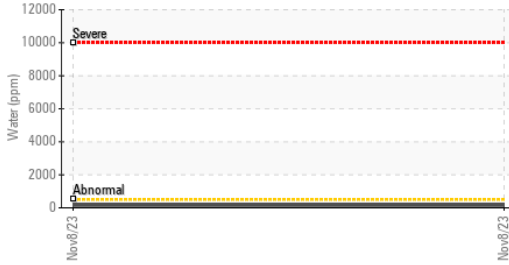


## Particle Trend

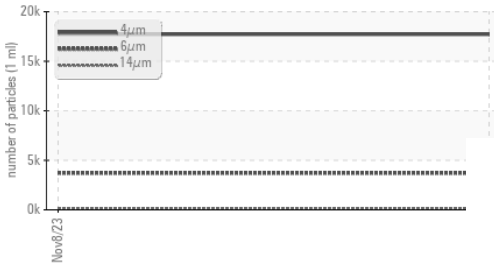

## Water (KF)



## Viscosity @ 40°C

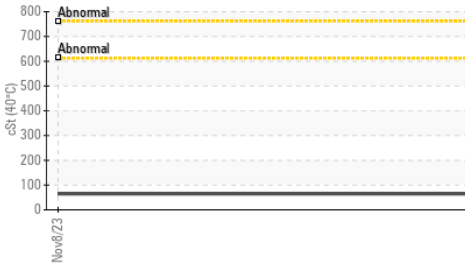

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	LIGHT	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	64.7	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------


Color



no image

no image

Bottom




no image


no image

## GRAPHS


### Ferrous Alloys

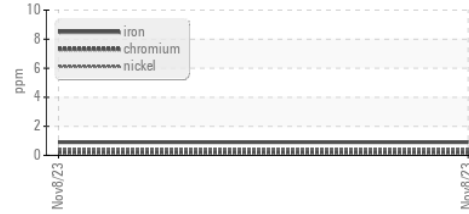


### Non-ferrous Metals

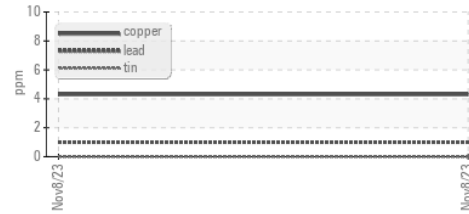


### Viscosity @ 40°C

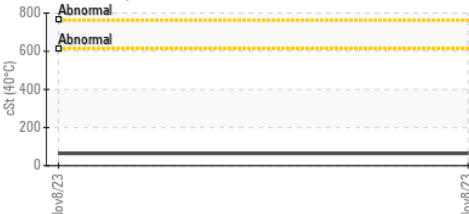

### Particle Count

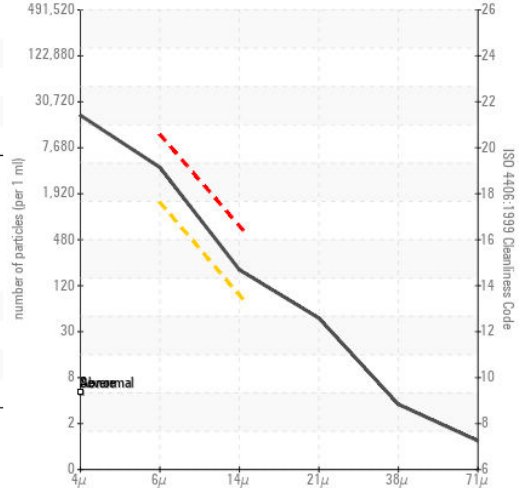

### Acid Number

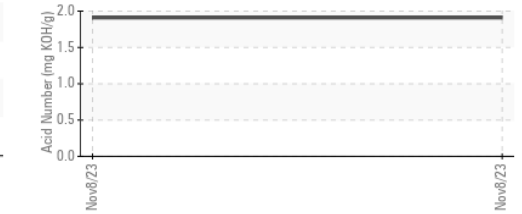

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : KC109663  
 Lab Number : 06016426  
 Unique Number : 10755570  
 Test Package : IND 2

**JACOB & HEFNER - BOEING**  
 3301 COVER ST  
 LONG BEACH, CA  
 US 90808  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: