




# OIL ANALYSIS REPORT

Sample Rating Trend

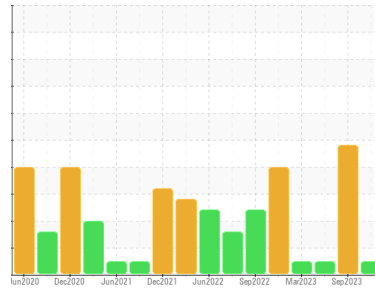

**NORMAL**



Machine Id  
**TOLE\_U8 TOLE\_U8\_P8**  
 Component  
**Non-Drive End Pump**  
 Fluid  
**ROYAL PURPLE SYNFILM GT 32 (2 QTS)**

**DIAGNOSIS**

**Recommendation**

Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**Contamination**

The water content is negligible. There is no indication of any contamination in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>RP0025466</b>	RP0026211	RP0025435
Sample Date	Client Info			<b>16 Nov 2023</b>	25 Sep 2023	06 Jun 2023
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	ABNORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>90	<b>&lt;1</b>	0	2
Chromium	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>5	<b>&lt;1</b>	<1	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	<1
Silver	ppm	ASTM D5185m	>3	<b>&lt;1</b>	0	0
Aluminum	ppm	ASTM D5185m	>7	<b>&lt;1</b>	<1	<1
Lead	ppm	ASTM D5185m	>12	<b>&lt;1</b>	<1	0
Copper	ppm	ASTM D5185m	>30	<b>2</b>	2	2
Tin	ppm	ASTM D5185m	>9	<b>&lt;1</b>	<1	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>33</b>	26	40
Calcium	ppm	ASTM D5185m		<b>1</b>	3	0
Phosphorus	ppm	ASTM D5185m		<b>4</b>	3	6
Zinc	ppm	ASTM D5185m		<b>0</b>	11	0

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>60	<b>4</b>	3	3
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	0
Water	%	ASTM D6304	>.1	<b>0.013</b>	▲ 0.231	0.015
ppm Water	ppm	ASTM D6304	>1000	<b>133</b>	▲ 2310	156.3

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.356</b>	0.359	0.463

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	▲ MODER	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	▲ HAZY	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	<b>NEG</b>	0.2%	NEG
Free Water	scalar	*Visual		<b>NEG</b>	0.01%	NEG

# OIL ANALYSIS REPORT

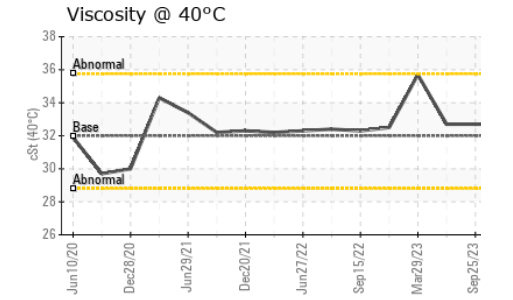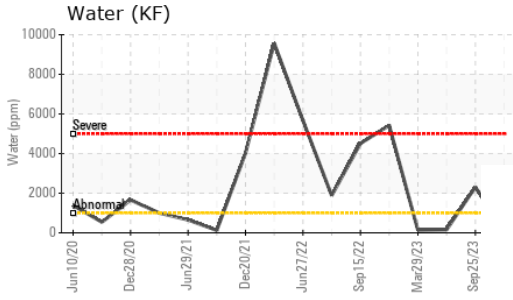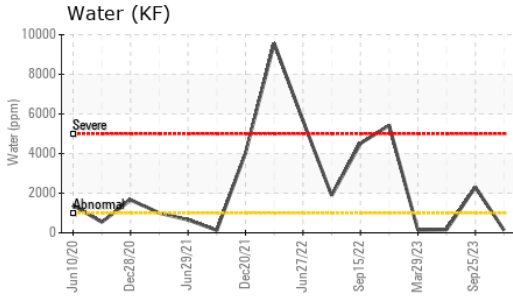

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	32	<b>32.7</b>	32.7	32.7





SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

Color



Bottom

## GRAPHS

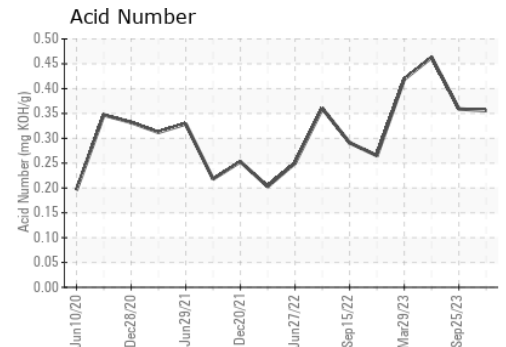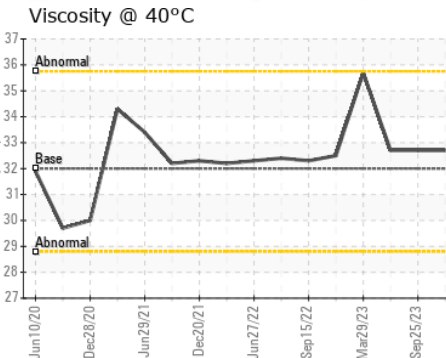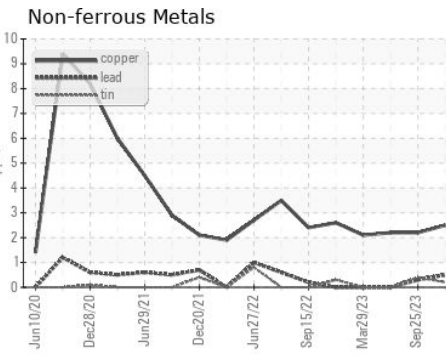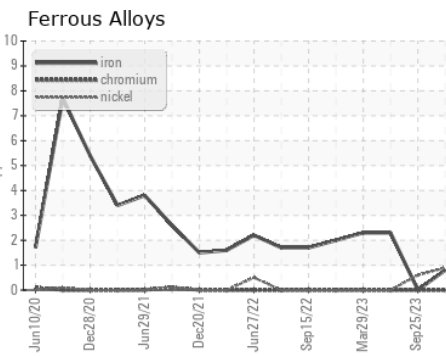

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0025466 **Received** : 24 Nov 2023  
**Lab Number** : **06016531** **Diagnosed** : 28 Nov 2023  
**Unique Number** : 10755675 **Diagnostician** : Jonathan Hester  
**Test Package** : PLANT

**ENERGY TRANSFER - TOLEDO**  
 2549 BROWN ROAD  
 OREGON, OH  
 US 43616  
 Contact: DARREN GRANT

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (419)389-7403

F: