




# OIL ANALYSIS REPORT

Sample Rating Trend

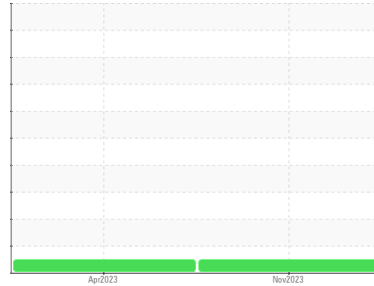

Machine Id  
**MLU-1**  
 Component  
**Outboard Pump**  
 Fluid  
**ROYAL PURPLE SYNFILM GT 32 (--- GAL)**

## DIAGNOSIS

- Recommendation**  
 Resample at the next service interval to monitor.
- Wear**  
 All component wear rates are normal.
- Contamination**  
 The water content is negligible. There is no indication of any contamination in the oil.
- Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>RP0037132</b>	RP0027411	---
Sample Date	Client Info			<b>01 Nov 2023</b>	13 Apr 2023	---
Machine Age	hrs	Client Info		<b>0</b>	0	---
Oil Age	hrs	Client Info		<b>0</b>	0	---
Oil Changed	Client Info			<b>N/A</b>	N/A	---
Sample Status				<b>NORMAL</b>	NORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>90	<b>6</b>	4	---
Chromium	ppm	ASTM D5185m	>5	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m	>5	<b>&lt;1</b>	0	---
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Silver	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>7	<b>&lt;1</b>	<1	---
Lead	ppm	ASTM D5185m	>12	<b>2</b>	0	---
Copper	ppm	ASTM D5185m	>30	<b>9</b>	2	---
Tin	ppm	ASTM D5185m	>9	<b>1</b>	0	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	<1	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	---
Barium	ppm	ASTM D5185m		<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	---
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	---
Magnesium	ppm	ASTM D5185m		<b>85</b>	89	---
Calcium	ppm	ASTM D5185m		<b>4</b>	<1	---
Phosphorus	ppm	ASTM D5185m		<b>4</b>	2	---
Zinc	ppm	ASTM D5185m		<b>0</b>	0	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>60	<b>14</b>	1	---
Sodium	ppm	ASTM D5185m		<b>6</b>	0	---
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	---
Water	%	ASTM D6304	>.1	<b>0.025</b>	0.024	---
ppm Water	ppm	ASTM D6304	>1000	<b>255</b>	249.4	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.35</b>	0.39	---

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Debris	scalar	*Visual	NONE	<b>LIGHT</b>	NONE	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Emulsified Water	scalar	*Visual	>.1	<b>NEG</b>	NEG	---
Free Water	scalar	*Visual		<b>NEG</b>	NEG	---






# OIL ANALYSIS REPORT

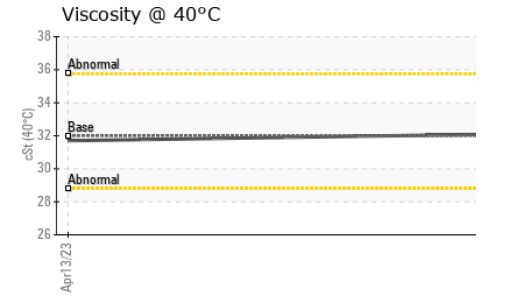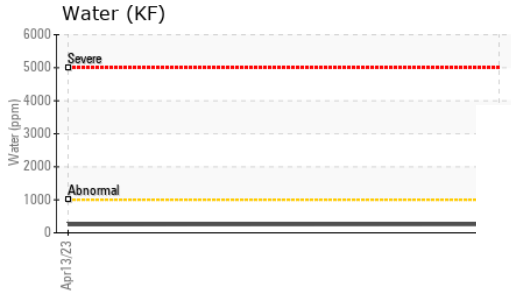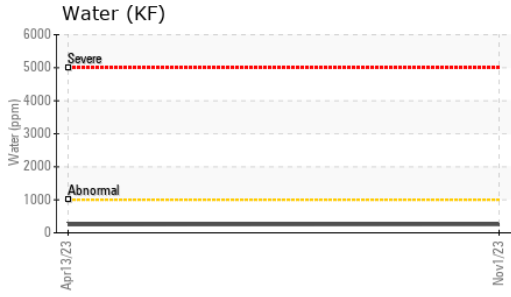

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	32	<b>32.1</b>	31.7	---

SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						no image
Bottom						no image

## GRAPHS

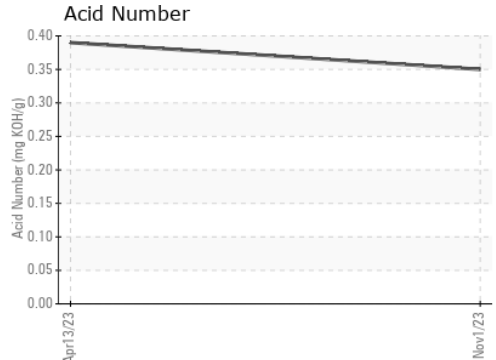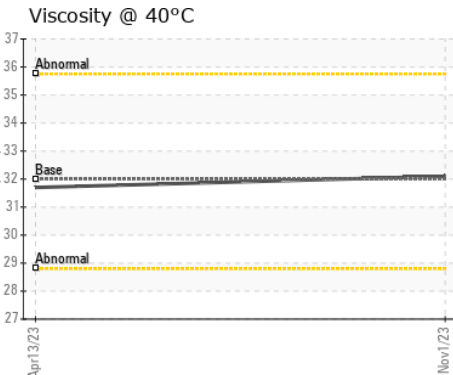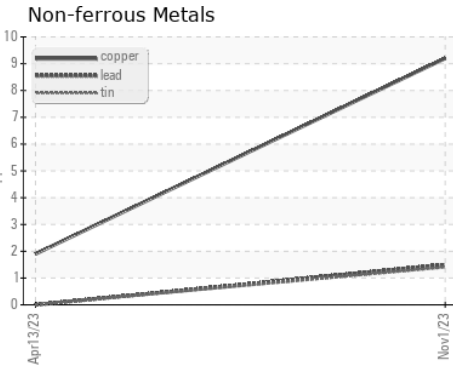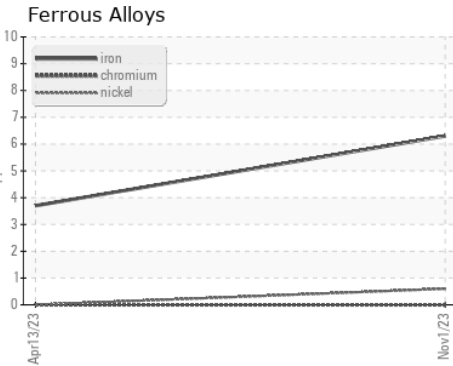

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0037132 **Received** : 24 Nov 2023  
**Lab Number** : **06016564** **Diagnosed** : 28 Nov 2023  
**Unique Number** : 10755708 **Diagnostician** : Jonathan Hester  
**Test Package** : IND 2

**ENERGY TRANSFER - LONGVIEW**  
 1010 COX DIARY RD  
 LONGVIEW, TX  
 US 75601  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: