




# PROBLEM SUMMARY

Sample Rating Trend

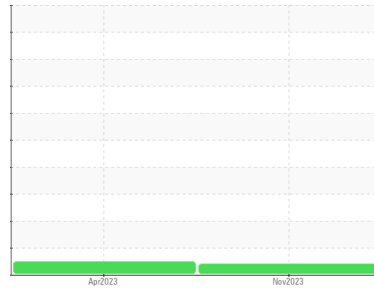


## VISCOSITY



Machine Id  
**800 HP**  
Component  
**Outboard Bearing**  
Fluid  
**ROYAL PURPLE SYNFILM GT 32 (--- GAL)**

### COMPONENT CONDITION SUMMARY

#### ▲ Viscosity @ 40°C

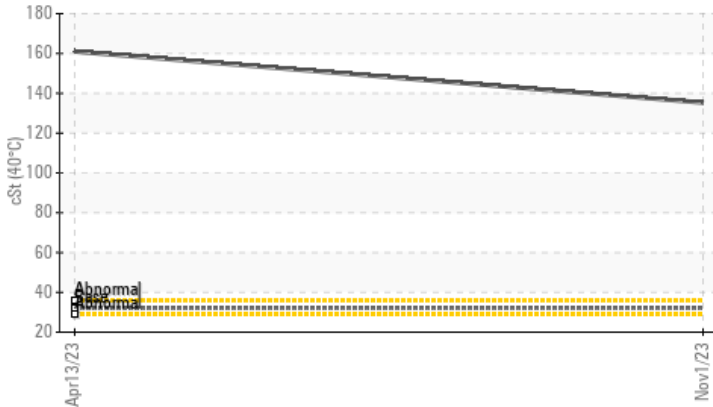

### RECOMMENDATION

No corrective action is recommended at this time.  
Resample at the next service interval to monitor.

### PROBLEMATIC TEST RESULTS

Sample Status				ATTENTION	NORMAL	---
Visc @ 40°C	cSt	ASTM D445	32	▲ 135.3	161	---

Customer Id: ENELONRP  
Sample No.: RP0032098  
Lab Number: 06016571  
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Jonathan Hester +1 919-379-4092 x4092  
[jhester@wearcheckusa.com](mailto:jhester@wearcheckusa.com)

To change component or sample information:  
Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

**13 Apr 2023 Diag: Jonathan Hester**

NORMAL




Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



# OIL ANALYSIS REPORT

Sample Rating Trend

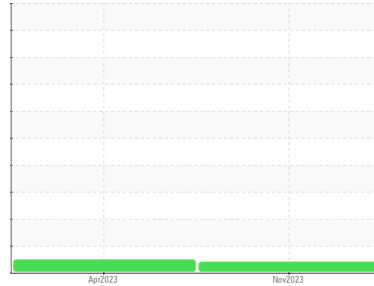

VISCOSITY



Machine Id  
**800 HP**

Component  
**Outboard Bearing**

Fluid  
**ROYAL PURPLE SYNFILM GT 32 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The water content is negligible. There is no indication of any contamination in the oil.

### Fluid Condition

The oil viscosity is higher than normal. Confirm oil type. The AN level is acceptable for this fluid.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>RP0032098</b>	RP0027414	---
Sample Date	Client Info			<b>01 Nov 2023</b>	13 Apr 2023	---
Machine Age	hrs	Client Info		<b>0</b>	0	---
Oil Age	hrs	Client Info		<b>0</b>	0	---
Oil Changed	Client Info			<b>N/A</b>	N/A	---
Sample Status				<b>ATTENTION</b>	NORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Chromium	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	---
Titanium	ppm	ASTM D5185m		<b>0</b>	0	---
Silver	ppm	ASTM D5185m		<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	---
Lead	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Copper	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Tin	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	<1	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	---
Barium	ppm	ASTM D5185m		<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	---
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	---
Magnesium	ppm	ASTM D5185m		<b>82</b>	3	---
Calcium	ppm	ASTM D5185m		<b>3</b>	0	---
Phosphorus	ppm	ASTM D5185m		<b>4</b>	314	---
Zinc	ppm	ASTM D5185m		<b>0</b>	0	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>&lt;1</b>	0	---
Sodium	ppm	ASTM D5185m		<b>1</b>	0	---
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	0	---
Water	%	ASTM D6304	>2	<b>0.022</b>	0.004	---
ppm Water	ppm	ASTM D6304		<b>225</b>	43.3	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.38</b>	0.27	---

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Emulsified Water	scalar	*Visual	>2	<b>NEG</b>	NEG	---
Free Water	scalar	*Visual		<b>NEG</b>	NEG	---

# OIL ANALYSIS REPORT

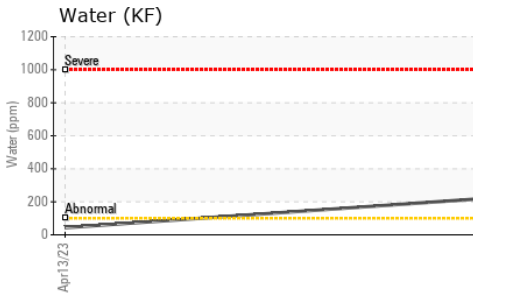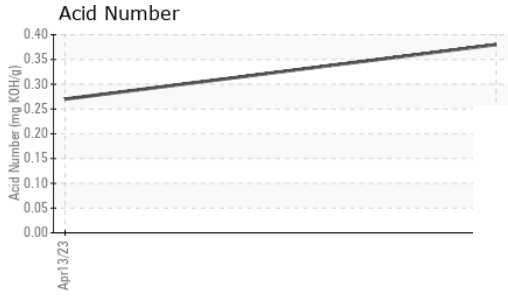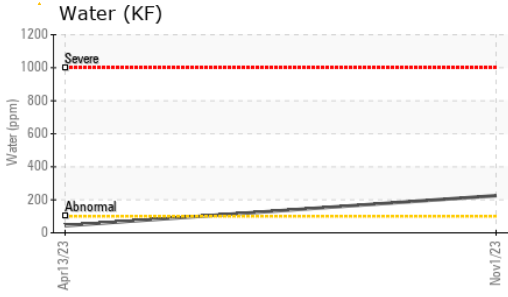





### FLUID PROPERTIES

method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D445	▲ 135.3	161	---

### SAMPLE IMAGES

method	limit/base	current	history1	history2
Color				no image
Bottom				no image

### GRAPHS

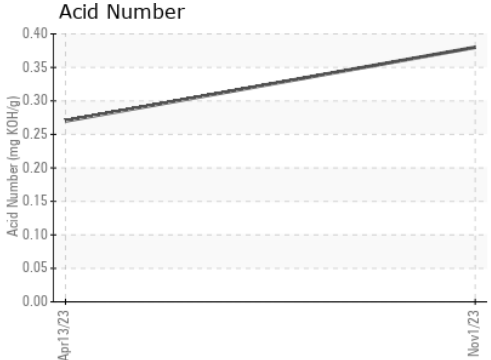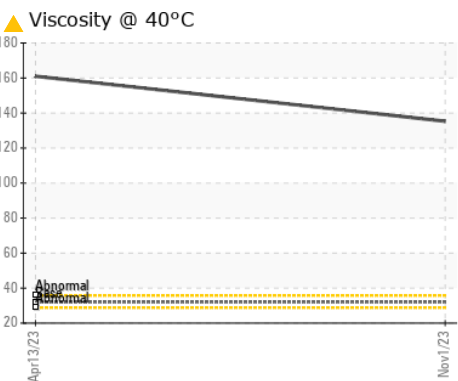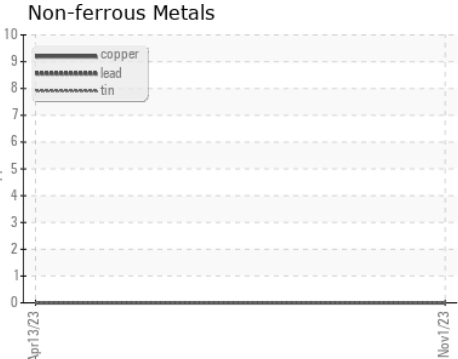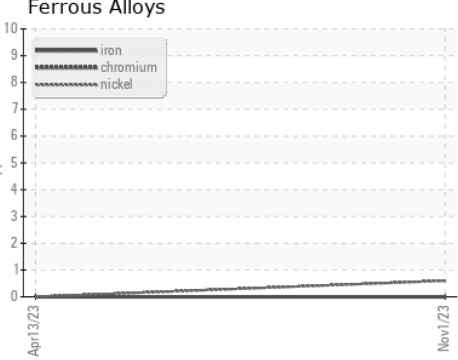

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0032098 **Received** : 24 Nov 2023  
**Lab Number** : 06016571 **Diagnosed** : 01 Dec 2023  
**Unique Number** : 10755715 **Diagnostician** : Jonathan Hester  
**Test Package** : IND 2

**ENERGY TRANSFER - LONGVIEW**  
 1010 COX DIARY RD  
 LONGVIEW, TX  
 US 75601  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: