


# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

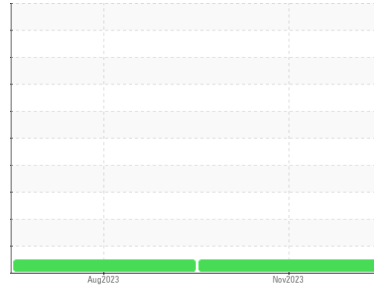

Area  
**PALLUBE 32**  
Machine Id  
**SULLIVAN PALATEK 21FE002269 - WEST MEMPHIS STEEL**  
Component  
**Compressor**

**DIAGNOSIS**

**Recommendation**

Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**Contamination**

There is no indication of any contamination in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>UCS06016580</b>	UCS05942339	---
Sample Date	Client Info			<b>15 Nov 2023</b>	28 Aug 2023	---
Machine Age	hrs	Client Info		<b>8277</b>	7087	---
Oil Age	hrs	Client Info		<b>1200</b>	0	---
Oil Changed	Client Info			<b>Not Changed</b>	Changed	---
Sample Status				<b>NORMAL</b>	NORMAL	---

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	<b>NEG</b>	NEG	---



WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	<1	---
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Titanium	ppm	ASTM D5185m		<b>0</b>	0	---
Silver	ppm	ASTM D5185m		<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>25	<b>&lt;1</b>	0	---
Lead	ppm	ASTM D5185m	>25	<b>0</b>	0	---
Copper	ppm	ASTM D5185m	>50	<b>0</b>	<1	---
Tin	ppm	ASTM D5185m	>15	<b>1</b>	<1	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	<1	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	1	<b>0</b>	0	---
Barium	ppm	ASTM D5185m	730	<b>356</b>	370	---
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m	0.0	<b>&lt;1</b>	<1	---
Magnesium	ppm	ASTM D5185m	0	<b>2</b>	<1	---
Calcium	ppm	ASTM D5185m	0	<b>9</b>	5	---
Phosphorus	ppm	ASTM D5185m	0	<b>7</b>	13	---
Zinc	ppm	ASTM D5185m	0	<b>0</b>	<1	---
Sulfur	ppm	ASTM D5185m	590	<b>529</b>	668	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	---
Sodium	ppm	ASTM D5185m		<b>75</b>	35	---
Potassium	ppm	ASTM D5185m	>20	<b>7</b>	3	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.14	<b>0.39</b>	0.17	---


# OIL ANALYSIS REPORT

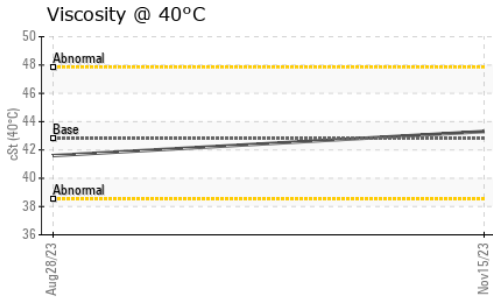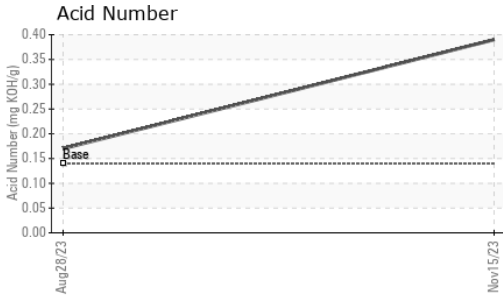





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	---
Free Water	scalar	*Visual		<b>NEG</b>	NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	42.8	<b>43.3</b>	41.6	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

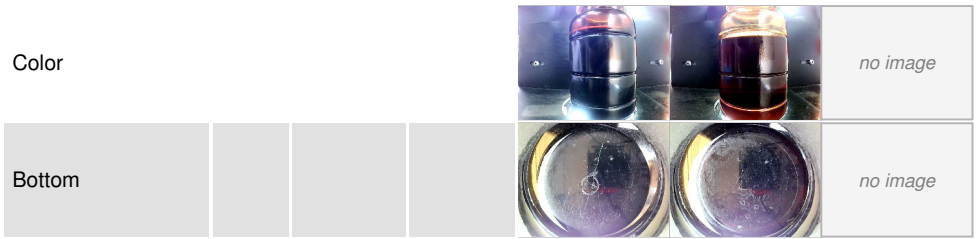

## GRAPHS

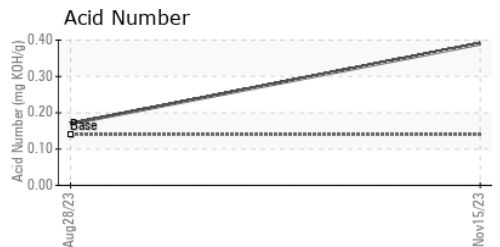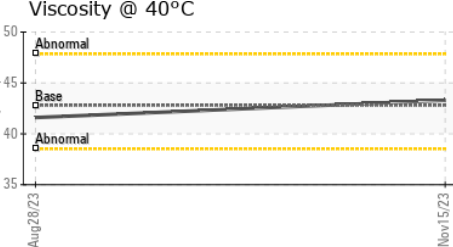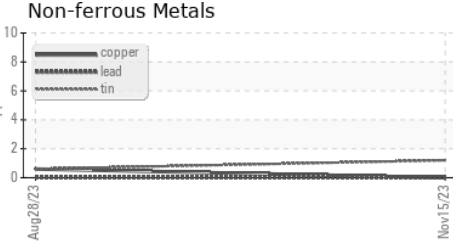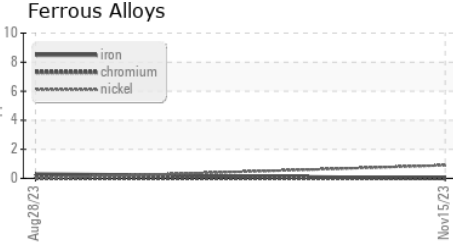

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCS06016580 **Received** : 24 Nov 2023  
**Lab Number** : **06016580** **Diagnosed** : 28 Nov 2023  
**Unique Number** : 10755724 **Diagnostician** : Jonathan Hester  
**Test Package** : IND 2

**BLAKE AND PENDLETON**

MEMPHIS, TN  
US 38133

Contact: JAY GIANNINI  
JGIANNINI@BLAKEANDPENDLETON.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: