




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

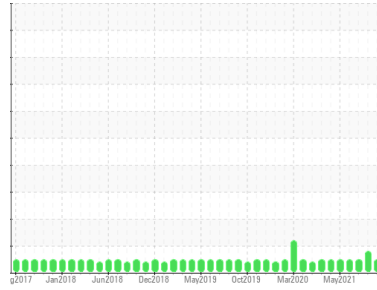

Machine Id  
**JOGGER 2**  
 Component  
**Gearbox**  
 Fluid  
**SAE 10W (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

### Wear

All component wear rates are normal.

### Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>PTK0000388</b>	PTK0000297	PTK0001310
Sample Date	Client Info			<b>09 Nov 2023</b>	13 Jun 2023	23 Nov 2022
Machine Age	mths	Client Info		<b>0</b>	0	0
Oil Age	mths	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	ATTENTION	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.2	<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	<b>0</b>	2	2
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>25	<b>5</b>	5	4
Lead	ppm	ASTM D5185m	>50	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m	>200	<b>1</b>	1	1
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m	>5	<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0


ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	2	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	<1	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m		<b>0</b>	2	<1
Calcium	ppm	ASTM D5185m		<b>52</b>	56	56
Phosphorus	ppm	ASTM D5185m		<b>320</b>	323	356
Zinc	ppm	ASTM D5185m		<b>435</b>	429	410
Sulfur	ppm	ASTM D5185m		<b>1044</b>	1281	1075

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	1	0


FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>21236</b>	25773	44819
Particles >6µm		ASTM D7647	>2500	<b>1430</b>	▲ 2814	1919
Particles >14µm		ASTM D7647	>320	<b>43</b>	313	23
Particles >21µm		ASTM D7647	>80	<b>12</b>	91	4
Particles >38µm		ASTM D7647	>20	<b>1</b>	2	0
Particles >71µm		ASTM D7647	>4	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>18/15	<b>18/13</b>	▲ 19/15	18/12

# OIL ANALYSIS REPORT


## Particle Trend

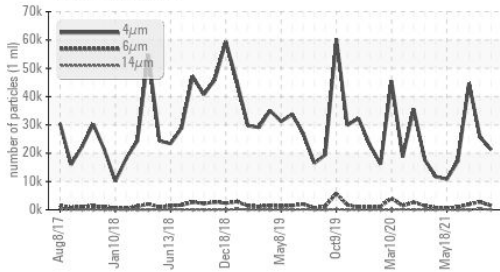


## Acid Number

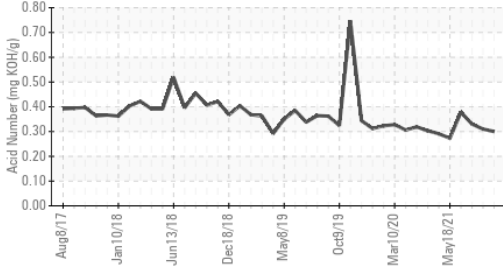

## Viscosity @ 40°C

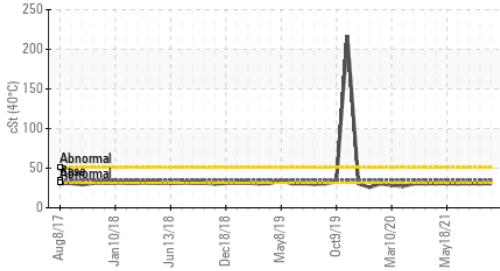

## Particle Trend

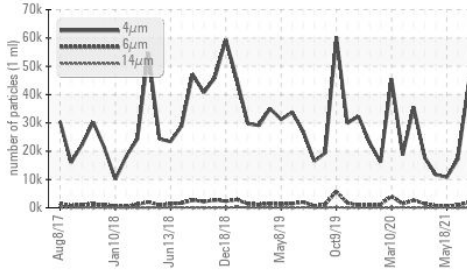


## FLUID DEGRADATION

method	limit/base	current	history1	history2		
Acid Number (AN) mg KOH/g	ASTM D8045	<b>0.30</b>	0.31	0.33		
VISUAL						
White Metal	scalar	*Visual	NONE	<b>NONE</b>	LIGHT	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG

## FLUID PROPERTIES


method	limit/base	current	history1	history2		
Visc @ 40°C	cSt	ASTM D445	35.0	<b>30.5</b>	30.5	30.5

## SAMPLE IMAGES

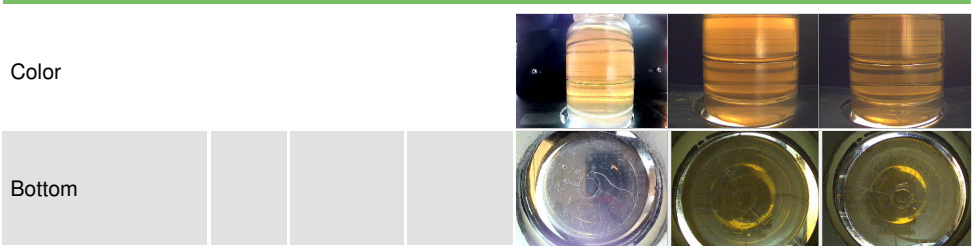


## GRAPHS


### Ferrous Alloys

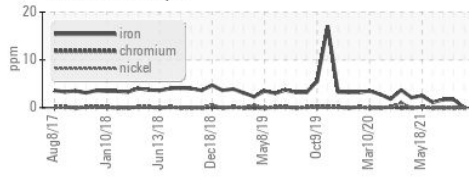


### Non-ferrous Metals

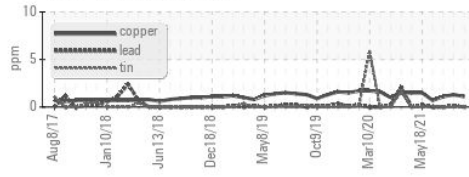


### Viscosity @ 40°C

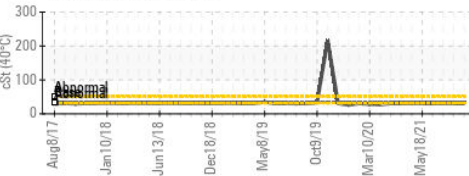

### Particle Count

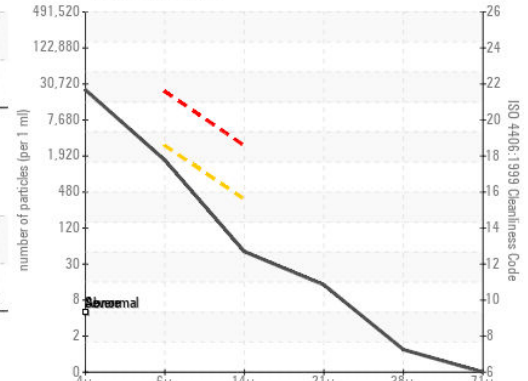

### Acid Number

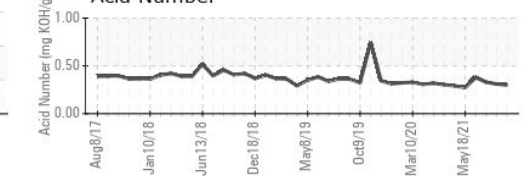

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PTK0000388 **Received** : 24 Nov 2023  
**Lab Number** : 06017328 **Diagnosed** : 29 Nov 2023  
**Unique Number** : 10756472 **Diagnostician** : Angela Borella  
**Test Package** : MOB 2 ( Additional Tests: PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

### GRAPHIC PACKAGING

1500 NICHOLAS BLVD  
 ELK GROVE, IL  
 US 60017

Contact: TONY HILDY  
 anthonyhildy@graphicpkg.com

T: (847)437-1700

F: