

PROBLEM SUMMARY

Sample Rating Trend




Machine Id **2877267 (S/N 1054)**

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

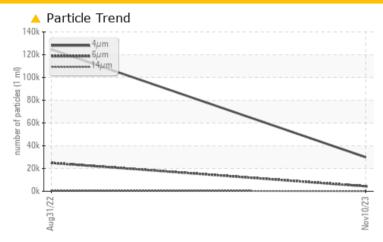

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

| PROBLEMATIC TEST RESULTS | | | | | | | | | |
|--------------------------|--------------|---------|-------------|----------------|--|--|--|--|--|
| Sample Status | | | ABNORMAL | ABNORMAL | | | | | |
| Particles >6µm | ASTM D7647 | >1300 | 4395 | <u>^</u> 24918 | | | | | |
| Particles >14μm | ASTM D7647 | >80 | <u> </u> | <u></u> 4716 | | | | | |
| Oil Cleanliness | ISO 4406 (c) | >/17/13 | A 22/19/14 | A 24/22/17 | | | | | |

Customer Id: AMGCAM Sample No.: KC107499 Lab Number: 06017351 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Jonathan Hester +1 919-379-4092 x4092 jhester@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

| Action | Status | Date | Done By | Description |
|---------------|--------|------|---------|---|
| Change Filter | | | ? | We recommend you service the filters on this component. |

HISTORICAL DIAGNOSIS

31 Aug 2022 Diag: Angela Borella





We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.





OIL ANALYSIS REPORT

^{Machine Id} **2877267 (S/N 1054)**

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

Sample Rating Trend



DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| | | | Aug ² 022 | Nov2023 | | |
|-----------------|----------|--------------|----------------------|-----------------|-------------------|----------|
| SAMPLE INFORM | MATION | method | limit/base | current | history1 | history2 |
| Sample Number | | Client Info | | KC107499 | KCP37271 | |
| Sample Date | | Client Info | | 10 Nov 2023 | 31 Aug 2022 | |
| Machine Age | hrs | Client Info | | 87529 | 78931 | |
| Oil Age | hrs | Client Info | | 7904 | 2200 | |
| Oil Changed | | Client Info | | Not Changd | N/A | |
| Sample Status | | | | ABNORMAL | ABNORMAL | |
| WEAR METALS | | method | limit/base | current | history1 | history2 |
| Iron | ppm | ASTM D5185m | >50 | 0 | 3 | |
| Chromium | ppm | ASTM D5185m | >10 | 0 | 0 | |
| Nickel | ppm | ASTM D5185m | >3 | 0 | <1 | |
| Titanium | ppm | ASTM D5185m | >3 | 0 | 0 | |
| Silver | ppm | ASTM D5185m | >2 | 0 | <1 | |
| Aluminum | ppm | ASTM D5185m | >10 | <1 | 2 | |
| Lead | ppm | ASTM D5185m | >10 | 0 | 0 | |
| Copper | ppm | ASTM D5185m | >50 | 3 | 16 | |
| Tin | ppm | ASTM D5185m | >10 | 0 | 0 | |
| Vanadium | ppm | ASTM D5185m | | 0 | <1 | |
| Cadmium | ppm | ASTM D5185m | | 0 | 0 | |
| ADDITIVES | | method | limit/base | current | history1 | history2 |
| Boron | ppm | ASTM D5185m | 0 | 0 | 0 | |
| Barium | ppm | ASTM D5185m | 90 | 23 | 6 | |
| Molybdenum | ppm | ASTM D5185m | 0 | 0 | <1 | |
| Manganese | ppm | ASTM D5185m | | <1 | <1 | |
| Magnesium | ppm | ASTM D5185m | 100 | 66 | 34 | |
| Calcium | ppm | ASTM D5185m | 0 | 2 | 4 | |
| Phosphorus | ppm | ASTM D5185m | 0 | 0 | 5 | |
| Zinc | ppm | ASTM D5185m | 0 | 20 | 24 | |
| CONTAMINANTS | ; | method | limit/base | current | history1 | history2 |
| Silicon | ppm | ASTM D5185m | >25 | 0 | 1 | |
| Sodium | ppm | ASTM D5185m | | 27 | 7 | |
| Potassium | ppm | ASTM D5185m | >20 | 11 | <1 | |
| Water | % | ASTM D6304 | >0.05 | 0.018 | 0.008 | |
| ppm Water | ppm | ASTM D6304 | >500 | 184 | 89.9 | |
| FLUID CLEANLIN | IESS | method | limit/base | current | history1 | history2 |
| Particles >4µm | | ASTM D7647 | | 29961 | 124674 | |
| Particles >6μm | | ASTM D7647 | >1300 | 4395 | <u>4</u> 24918 | |
| Particles >14µm | | ASTM D7647 | >80 | <u> </u> | ▲ 716 | |
| Particles >21µm | | ASTM D7647 | >20 | 18 | ▲ 153 | |
| Particles >38µm | | ASTM D7647 | >4 | 0 | 5 | |
| Particles >71µm | | ASTM D7647 | >3 | 0 | 0 | |
| Oil Cleanliness | | ISO 4406 (c) | >/17/13 | <u>22/19/14</u> | <u>4</u> 24/22/17 | |
| FLUID DEGRADA | ATION | method | limit/base | current | history1 | history2 |
| | | | | | | |

Acid Number (AN)


mg KOH/g ASTM D8045 1.0

0.49

0.35



OIL ANALYSIS REPORT

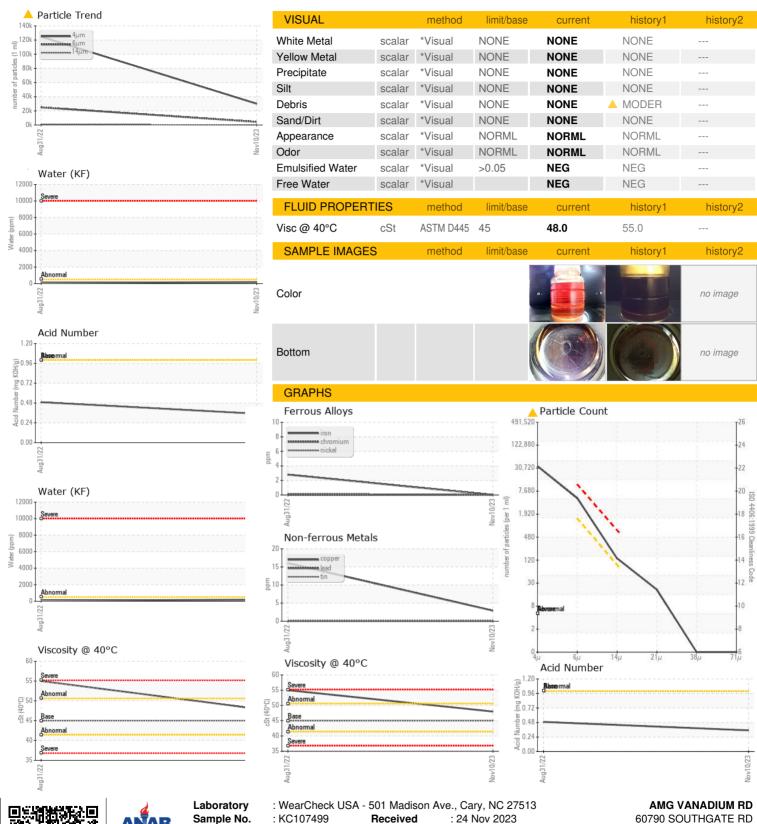





Certificate L2367

Sample No. Lab Number **Unique Number** Test Package

: KC107499 : 06017351

: 10756495 : IND 2

Received Diagnosed

: 29 Nov 2023 : Jonathan Hester Diagnostician

60790 SOUTHGATE RD CAMBRIDGE, OH US 43725

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: