


OIL ANALYSIS REPORT



NORMAL



Machine Id KAESER 8060071 (S/N 1786)

Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Jun 2023	Nov2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC06017408	KC103136	
Sample Date		Client Info		23 Nov 2023	13 Jun 2023	
Machine Age	hrs	Client Info		19338	15376	
Oil Age	hrs	Client Info		0	4245	
Oil Changed		Client Info		N/A	Not Changd	
Sample Status				NORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	<1	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	0	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	11	4	
Tin	ppm	ASTM D5185m	>10	0	<1	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	5	78	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m	90	27	78	
Calcium	ppm	ASTM D5185m	2	0	3	
Phosphorus	ppm	ASTM D5185m		0	3	
Zinc	ppm	ASTM D5185m		21	3	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	
Sodium	ppm	ASTM D5185m		14	37	
Potassium	ppm	ASTM D5185m	>20	<1	6	
Water	%	ASTM D6304	>0.05	0.012	0.021	
ppm Water	ppm	ASTM D6304	>500	129	218.1	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		3502	30765	
Particles >6µm		ASTM D7647	>1300	741	<u>▲</u> 10188	
Particles >14μm		ASTM D7647	>80	38	899	
Particles >21µm		ASTM D7647	>20	9	▲ 182	
Particles >38μm		ASTM D7647	>4	0	<u> </u>	
Particles >71μm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/12	<u>22/21/17</u>	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
	1/011/	10T11 D0015	0.4			

Acid Number (AN)


mg KOH/g ASTM D8045 0.4

0.38

0.34



OIL ANALYSIS REPORT

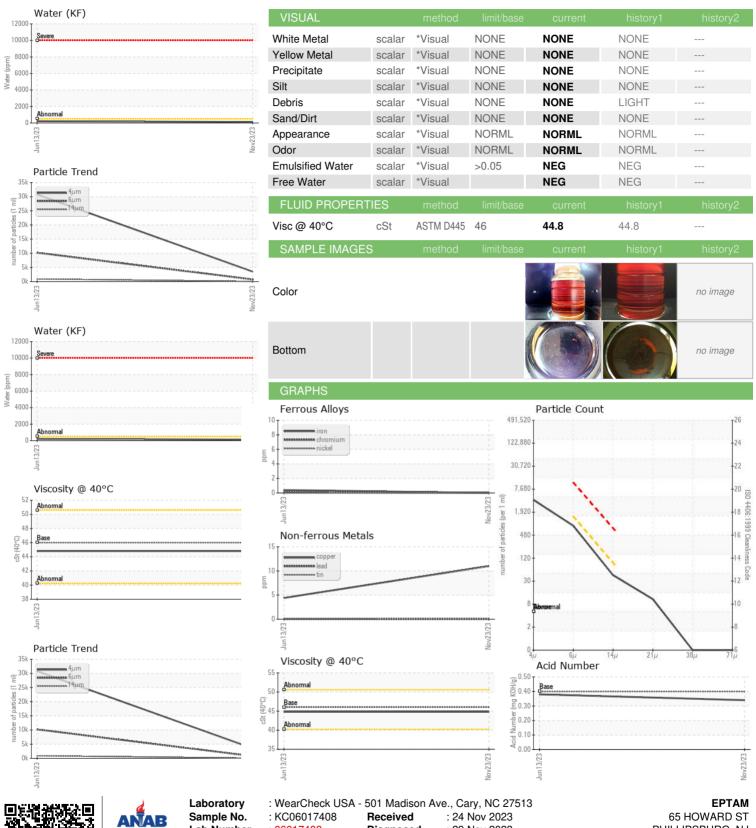





Certificate L2367

Lab Number Unique Number

: 06017408

: 10756552 Test Package : IND 2

Diagnosed : 29 Nov 2023

: Jonathan Hester Diagnostician

PHILLIPSBURG, NJ US 08865

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: