



# OIL ANALYSIS REPORT

Sample Rating Trend


**NORMAL**



Area  
**NOT GIVEN**

Machine Id  
**GARDNER DENVER U30071 - ADVANCE RESEARCH EAST WAREHOUSE**

Component  
**Compressor**

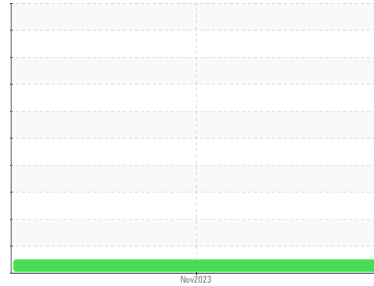

## DIAGNOSIS

### Recommendation

We suspect abnormal metal contamination may be due to sampling method. No corrective action is recommended at this time. Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

### Wear

Moderate concentration of visible metal present. All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCH06017468</b>	---	---
Sample Date	Client Info		<b>10 Nov 2023</b>	---	---
Machine Age	hrs	Client Info	<b>194030</b>	---	---
Oil Age	hrs	Client Info	<b>8000</b>	---	---
Oil Changed	Client Info		<b>Changed</b>	---	---
Sample Status			<b>NORMAL</b>	---	---

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	<b>NEG</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>11</b>	---
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	---
Nickel	ppm	ASTM D5185m		<b>&lt;1</b>	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	---
Silver	ppm	ASTM D5185m		<b>0</b>	---
Aluminum	ppm	ASTM D5185m	>25	<b>2</b>	---
Lead	ppm	ASTM D5185m	>25	<b>&lt;1</b>	---
Copper	ppm	ASTM D5185m	>50	<b>2</b>	---
Tin	ppm	ASTM D5185m	>15	<b>0</b>	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	---
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	---
Barium	ppm	ASTM D5185m		<b>0</b>	---
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	---
Manganese	ppm	ASTM D5185m		<b>0</b>	---
Magnesium	ppm	ASTM D5185m		<b>0</b>	---
Calcium	ppm	ASTM D5185m		<b>&lt;1</b>	---
Phosphorus	ppm	ASTM D5185m		<b>44</b>	---
Zinc	ppm	ASTM D5185m		<b>33</b>	---
Sulfur	ppm	ASTM D5185m		<b>946</b>	---

## CONTAMINANTS



	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	---
Sodium	ppm	ASTM D5185m		<b>0</b>	---
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.34</b>	---



# OIL ANALYSIS REPORT

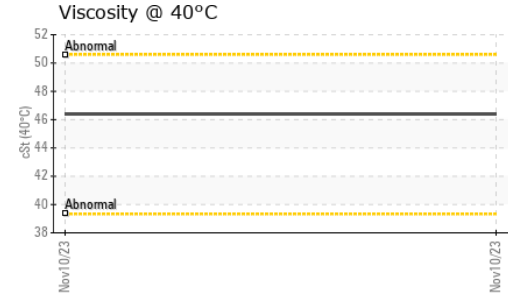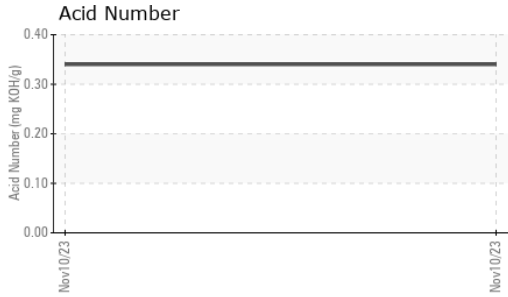






VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>MODER</b>	---	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	---	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	---	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	---	---
Free Water	scalar	*Visual		<b>NEG</b>	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	<b>46.4</b>	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

## GRAPHS

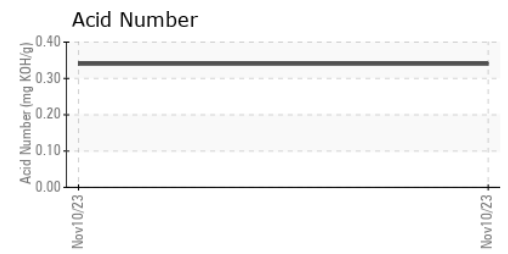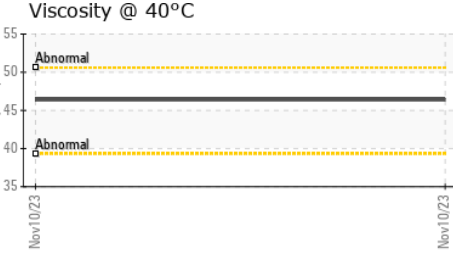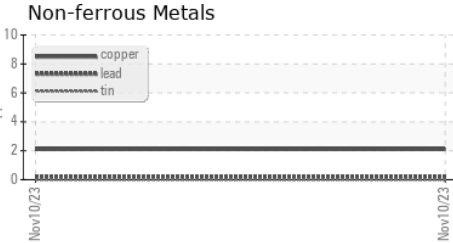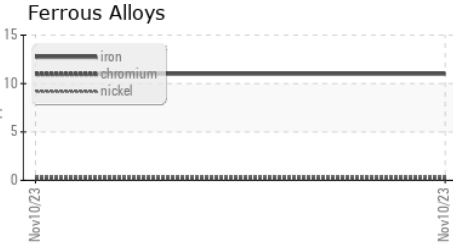

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06017468 **Received** : 24 Nov 2023  
**Lab Number** : **06017468** **Diagnosed** : 29 Nov 2023  
**Unique Number** : 10756612 **Diagnostician** : Jonathan Hester  
**Test Package** : IND 2

**GREEN COUNTY COMPRESSOR SERVICE**  
 11974 E 530 RD  
 CLAREMORE, OK  
 US 74019  
 Contact: ASHLEY PIGUET  
 ashley@gccs.us.com  
 T: (918)906-6343  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)