




# OIL ANALYSIS REPORT

Sample Rating Trend

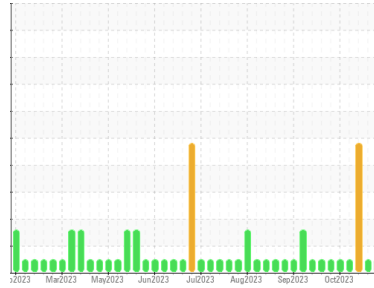

**NORMAL**



Machine Id  
**SJNM03BE**  
 Component  
**Biogas Engine**  
 Fluid  
**CHEVRON HDAX 6500 LFG GAS ENGINE OIL (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

|               | method      | limit/base  | current            | history1    | history2    |
|---------------|-------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info |             | <b>WC0865658</b>   | WC0865653   | WC0865670   |
| Sample Date   | Client Info |             | <b>20 Nov 2023</b> | 16 Nov 2023 | 09 Nov 2023 |
| Machine Age   | hrs         | Client Info | <b>102293</b>      | 102195      | 102029      |
| Oil Age       | hrs         | Client Info | <b>264</b>         | 166         | 1000        |
| Oil Changed   | Client Info |             | <b>Not Chngd</b>   | Not Chngd   | Changed     |
| Sample Status |             |             | <b>NORMAL</b>      | NORMAL      | SEVERE      |

## CONTAMINATION

|        | method    | limit/base | current        | history1 | history2 |
|--------|-----------|------------|----------------|----------|----------|
| Fuel   | WC Method | >4.0       | <b>&lt;1.0</b> | <1.0     | <1.0     |
| Water  | WC Method | >0.1       | <b>NEG</b>     | NEG      | NEG      |
| Glycol | WC Method |            | <b>NEG</b>     | NEG      | NEG      |

## WEAR METALS

|          | method | limit/base  | current | history1     | history2 |    |
|----------|--------|-------------|---------|--------------|----------|----|
| Iron     | ppm    | ASTM D5185m | >15     | <b>2</b>     | 0        | 4  |
| Chromium | ppm    | ASTM D5185m | >4      | <b>&lt;1</b> | 0        | <1 |
| Nickel   | ppm    | ASTM D5185m | >2      | <b>&lt;1</b> | <1       | <1 |
| Titanium | ppm    | ASTM D5185m |         | <b>&lt;1</b> | 0        | 0  |
| Silver   | ppm    | ASTM D5185m | >5      | <b>0</b>     | 0        | <1 |
| Aluminum | ppm    | ASTM D5185m | >6      | <b>2</b>     | 1        | 2  |
| Lead     | ppm    | ASTM D5185m | >9      | <b>&lt;1</b> | 0        | 2  |
| Copper   | ppm    | ASTM D5185m | >6      | <b>1</b>     | <1       | 1  |
| Tin      | ppm    | ASTM D5185m | >4      | <b>2</b>     | 2        | 3  |
| Vanadium | ppm    | ASTM D5185m |         | <b>0</b>     | 0        | 0  |
| Cadmium  | ppm    | ASTM D5185m |         | <b>&lt;1</b> | 0        | 0  |

## ADDITIVES

|            | method | limit/base  | current | history1     | history2 |      |
|------------|--------|-------------|---------|--------------|----------|------|
| Boron      | ppm    | ASTM D5185m |         | <b>3</b>     | 2        | 4    |
| Barium     | ppm    | ASTM D5185m |         | <b>0</b>     | 0        | 6    |
| Molybdenum | ppm    | ASTM D5185m |         | <b>2</b>     | <1       | 3    |
| Manganese  | ppm    | ASTM D5185m |         | <b>&lt;1</b> | <1       | <1   |
| Magnesium  | ppm    | ASTM D5185m |         | <b>25</b>    | 27       | 26   |
| Calcium    | ppm    | ASTM D5185m |         | <b>1842</b>  | 1878     | 2143 |
| Phosphorus | ppm    | ASTM D5185m |         | <b>244</b>   | 298      | 357  |
| Zinc       | ppm    | ASTM D5185m |         | <b>339</b>   | 363      | 396  |
| Sulfur     | ppm    | ASTM D5185m |         | <b>2431</b>  | 2173     | 2854 |

## CONTAMINANTS

|           | method | limit/base  | current | history1   | history2 |     |
|-----------|--------|-------------|---------|------------|----------|-----|
| Silicon   | ppm    | ASTM D5185m | >181    | <b>112</b> | 82       | 206 |
| Sodium    | ppm    | ASTM D5185m |         | <b>0</b>   | <1       | 0   |
| Potassium | ppm    | ASTM D5185m | >20     | <b>2</b>   | 2        | 2   |

## INFRA-RED




|           | method   | limit/base  | current | history1    | history2 |      |
|-----------|----------|-------------|---------|-------------|----------|------|
| Soot %    | %        | *ASTM D7844 |         | <b>0</b>    | 0        | 0.1  |
| Nitration | Abs/cm   | *ASTM D7624 | >20     | <b>6.9</b>  | 6.5      | 8.4  |
| Sulfation | Abs/.1mm | *ASTM D7415 | >30     | <b>19.6</b> | 18.2     | 24.7 |

## FLUID DEGRADATION

|                  | method   | limit/base  | current | history1    | history2 |       |
|------------------|----------|-------------|---------|-------------|----------|-------|
| Oxidation        | Abs/.1mm | *ASTM D7414 | >25     | <b>14.0</b> | 12.2     | 23.2  |
| Acid Number (AN) | mg KOH/g | ASTM D8045  | 1.2     | <b>0.97</b> | 0.60     | 0.833 |
| Base Number (BN) | mg KOH/g | ASTM D2896  | 4.5     | <b>4.74</b> | 4.66     | 3.60  |











# OIL ANALYSIS REPORT

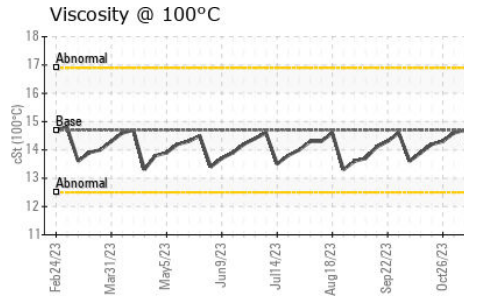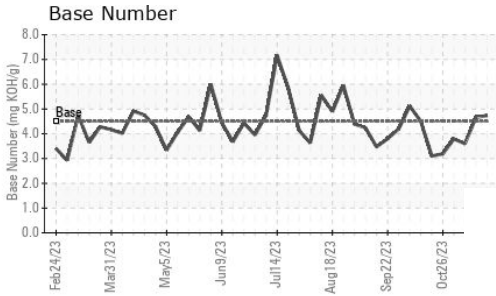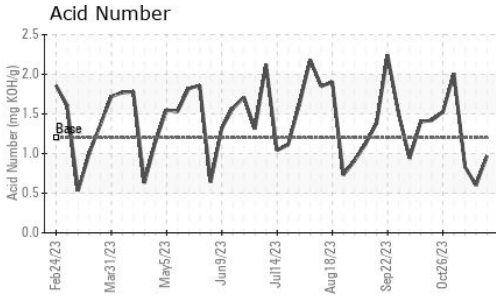

| VISUAL           | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Yellow Metal     | scalar | *Visual    | NONE    | NONE     | NONE     |
| Precipitate      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Silt             | scalar | *Visual    | NONE    | NONE     | NONE     |
| Debris           | scalar | *Visual    | NONE    | NONE     | NONE     |
| Sand/Dirt        | scalar | *Visual    | NONE    | NONE     | NONE     |
| Appearance       | scalar | *Visual    | NORML   | NORML    | NORML    |
| Odor             | scalar | *Visual    | NORML   | NORML    | NORML    |
| Emulsified Water | scalar | *Visual    | >0.1    | NEG      | NEG      |
| Free Water       | scalar | *Visual    |         | NEG      | NEG      |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 100°C     | cSt    | ASTM D445  | 14.7    | 13.7     | 14.7     |

## GRAPHS

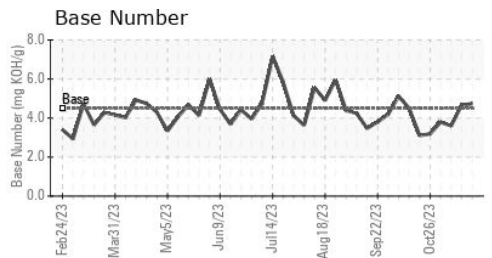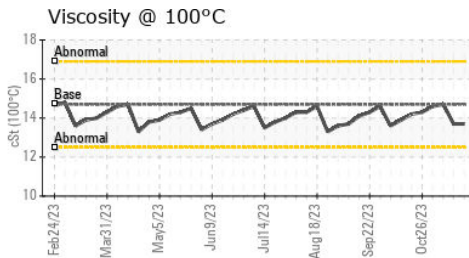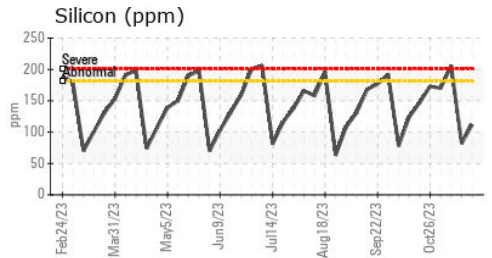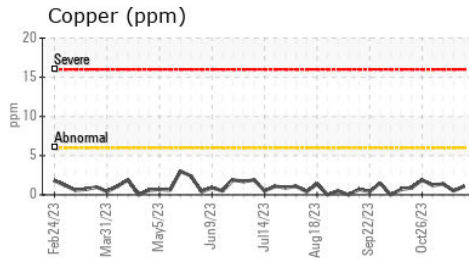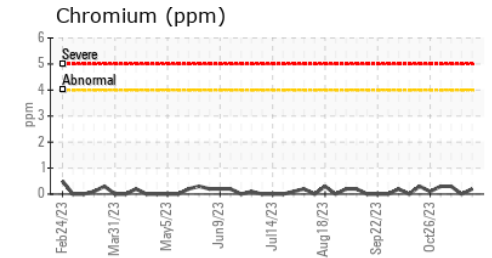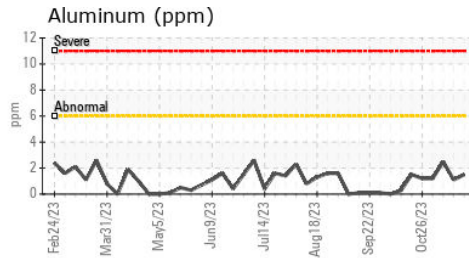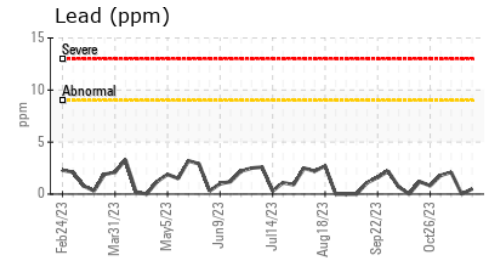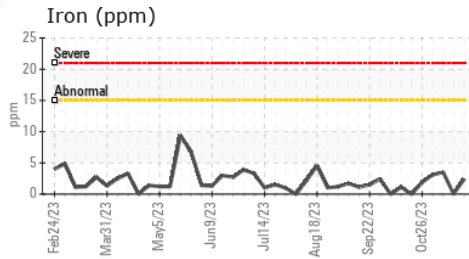

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : WC0865658 Received : 24 Nov 2023  
 Lab Number : 06017519 Diagnosed : 29 Nov 2023  
 Unique Number : 10756663 Diagnostician : Jonathan Hester  
 Test Package : MOB 2

**EDL NA Recips-South Jordan**  
 South Jordan Powerstation, 10473 S. Bacchus Hwy.  
 South Jordan, UT  
 US 84095  
 Contact: Aaron Klein  
 aaron.klein@edlenergy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: