




FUEL REPORT

Sample Rating Trend

VIS DEBRIS

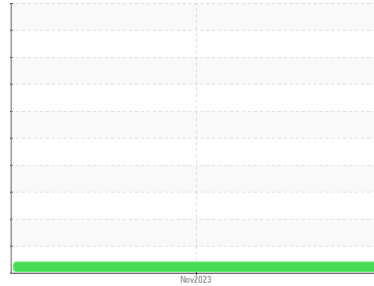

Machine Id
NOT GIVEN WC0812914

Component
Diesel Fuel
Fluid
NOT GIVEN (--- GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component if applicable. All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

Light concentration of visible dirt/debris present in the fuel. The water content is negligible. There is no bacteria or fungus (yeast and/or mold) present in the sample.

Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

| SAMPLE INFORMATION | | method | limit/base | current | history1 | history2 |
|--------------------|-------------|-------------|------------|--------------------|----------|----------|
| Sample Number | Client Info | | | WC0812914 | --- | --- |
| Sample Date | Client Info | | | 26 Nov 2023 | --- | --- |
| Machine Age | hrs | Client Info | | 0 | --- | --- |
| Sample Status | | | | ABNORMAL | --- | --- |



| PHYSICAL PROPERTIES | | method | limit/base | current | history1 | history2 |
|---------------------|--------|-------------|------------|-------------|----------|----------|
| ASTM Color | scalar | *ASTM D1500 | | L4.5 | --- | --- |
| Visc @ 40°C | cSt | ASTM D445 | | 2.43 | --- | --- |

| SULFUR CONTENT | | method | limit/base | current | history1 | history2 |
|----------------|-----|-------------|------------|-----------|----------|----------|
| Sulfur | ppm | ASTM D5185m | | 11 | --- | --- |
| Sulfur (UVF) | ppm | ASTM D5453 | | 9 | --- | --- |

| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
|--------------|-----|-------------|------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185m | <1.0 | 0 | --- | --- |
| Sodium | ppm | ASTM D5185m | <0.1 | 1 | --- | --- |
| Potassium | ppm | ASTM D5185m | <0.1 | <1 | --- | --- |
| Water | % | ASTM D6304 | <0.05 | 0.005 | --- | --- |
| ppm Water | ppm | ASTM D6304 | <500 | 54 | --- | --- |
| % Gasoline | % | *In-House | <0.50 | 0.0 | --- | --- |
| % Biodiesel | % | *In-House | <20.0 | 1.4 | --- | --- |


| MICROBIAL | | method | limit/base | current | history1 | history2 |
|-----------|----------|-----------|------------|------------|----------|----------|
| Bacteria | CFU/ml | WC-Method | >=100000 | 0 | --- | --- |
| Yeast | CFU/ml | WC-Method | >=100000 | 0 | --- | --- |
| Mold | Colonies | WC-Method | MODER | --- | --- | --- |

| HEAVY METALS | | method | limit/base | current | history1 | history2 |
|--------------|-----|-------------|------------|--------------|----------|----------|
| Aluminum | ppm | ASTM D5185m | <0.1 | <1 | --- | --- |
| Nickel | ppm | ASTM D5185m | <0.1 | <1 | --- | --- |
| Lead | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Vanadium | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Iron | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Calcium | ppm | ASTM D5185m | <0.1 | 1 | --- | --- |
| Magnesium | ppm | ASTM D5185m | <0.1 | <1 | --- | --- |
| Phosphorus | ppm | ASTM D5185m | <0.1 | 4 | --- | --- |
| Zinc | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |


| SAMPLE IMAGES | | method | limit/base | current | history1 | history2 |
|---------------|--|--------|------------|---|----------|----------|
| Color | | | |  | no image | no image |
| Bottom | | | |  | no image | no image |



FUEL REPORT

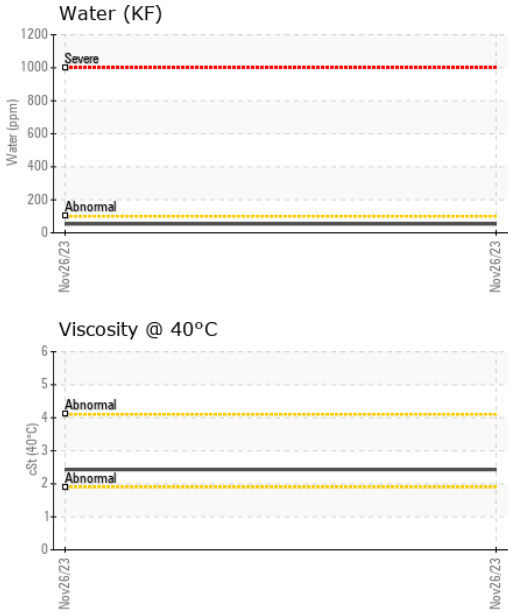

GRAPHS

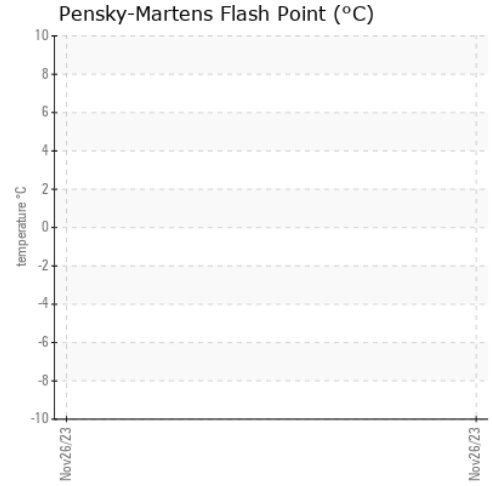

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0812914 **Recieved** : 24 Nov 2023
Lab Number : 06017656 **Diagnosed** : 22 Dec 2023
Unique Number : 10756800 **Diagnostician** : Doug Bogart
Test Package : DF-5 (Additional Tests: BACTERIA, Screen)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

NATIONAL POWER CORP
 4541 PRESLYN DR
 RALEIGH, NC
 US 27616
 Contact: BRANDON RICE
 brandon.rice@natpow.com
 T:
 F: (919)790-9714