


PROBLEM SUMMARY

I73362414] Machine Id 7018737 (S/N 1159) Component

Compressor

KAESER SIGMA (OEM) FG-460 (--- GAL)

COMPONENT CONDITION SUMMARY

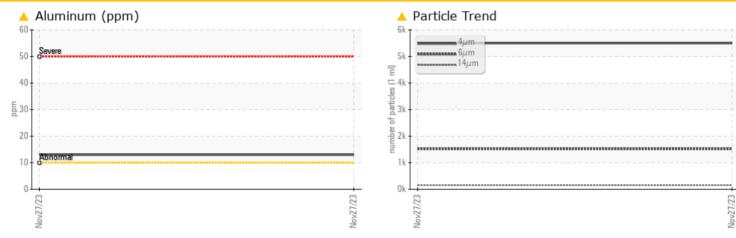

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

| Sample Status | | | | ABNORMAL | | | | | |
|-----------------|-----|--------------|---------|-------------------|--|--|--|--|--|
| Aluminum | ppm | ASTM D5185m | >10 | <u> </u> | | | | | |
| Particles >6µm | | ASTM D7647 | >1300 | 🔺 1521 | | | | | |
| Particles >14µm | | ASTM D7647 | >80 | 🔺 157 | | | | | |
| Particles >21µm | | ASTM D7647 | >20 | <mark>/</mark> 48 | | | | | |
| Oil Cleanliness | | ISO 4406 (c) | >/17/13 | <u> </u> | | | | | |

Customer Id: OCECAS Sample No.: KCPA011817 Lab Number: 06025737 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Don Baldridge +1 <u>don.b505@comcast.net</u>

To change component or sample information: Customer Service +1 1-800-237-1369 <u>customerservice@wearcheck.com</u>



There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

I73362414] Machine Id 7018737 (S/N 1159) Component

Compressor Fluid

KAESER SIGMA (OEM) FG-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

🔺 Wear


The aluminum level is abnormal. All other component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





| | | | | Nov2023 | | |
|------------------------------------|-------------|--------------------------|---------------|-----------------------|----------|----------|
| SAMPLE INFORM | MATION | method | limit/base | current | history1 | history2 |
| Sample Number | | Client Info | | KCPA011817 | | |
| Sample Date | | Client Info | | 27 Nov 2023 | | |
| Machine Age | hrs | Client Info | | 23615 | | |
| Oil Age | hrs | Client Info | | 0 | | |
| Oil Changed | | Client Info | | N/A | | |
| Sample Status | | | | ABNORMAL | | |
| WEAR METALS | | method | limit/base | current | history1 | history2 |
| Iron | ppm | ASTM D5185m | >50 | 0 | | |
| Chromium | ppm | ASTM D5185m | >10 | 0 | | |
| Nickel | ppm | ASTM D5185m | >3 | 0 | | |
| Titanium | ppm | ASTM D5185m | >3 | 0 | | |
| Silver | ppm | ASTM D5185m | >2 | 0 | | |
| Aluminum | ppm | ASTM D5185m | >10 | <u> </u> | | |
| Lead | ppm | ASTM D5185m | >10 | 0 | | |
| Copper | ppm | ASTM D5185m | >50 | 1 | | |
| Tin | ppm | ASTM D5185m | >10 | 0 | | |
| Vanadium | ppm | ASTM D5185m | | 0 | | |
| Cadmium | ppm | ASTM D5185m | | 0 | | |
| ADDITIVES | | method | limit/base | current | history1 | history2 |
| Boron | ppm | ASTM D5185m | | 0 | | |
| Barium | ppm | ASTM D5185m | | 0 | | |
| Molybdenum | ppm | ASTM D5185m | | 0 | | |
| Manganese | ppm | ASTM D5185m | | <1 | | |
| Magnesium | ppm | ASTM D5185m | | 0 | | |
| Calcium | ppm | ASTM D5185m | | 0 | | |
| Phosphorus | ppm | ASTM D5185m | 500 | 23 | | |
| Zinc | ppm | ASTM D5185m | | 0 | | |
| Sulfur | ppm | ASTM D5185m | | 242 | | |
| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
| | | | | | | |
| Silicon | ppm | ASTM D5185m | >25 | 0 | | |
| Sodium | ppm | ASTM D5185m | × 20 | 1 | | |
| Potassium | ppm | ASTM D5185m | >20 >0.05 | 0 | | |
| Water ppm Water | % ppm | ASTM D6304 ASTM D6304 | | 0.004 48 | | |
| FLUID CLEANLIN | | method | limit/base | | history1 | history2 |
| Particles >4µm | | ASTM D7647 | -111100030 | 5502 | | |
| Particles >6µm | | ASTM D7647 ASTM D7647 | >1300 | ▲ 1521 | | |
| Particles >14µm | | ASTM D7647 ASTM D7647 | >80 | ▲ 1521 ▲ 157 | | |
| Particles >21µm | | ASTM D7647 ASTM D7647 | | ▲ 157 ▲ 48 | | |
| Particles >38µm | | ASTM D7647 ASTM D7647 | >20 | 3 | | |
| | | ASTM D7647 ASTM D7647 | | 0 | | |
| Particles >71µm Oil Cleanliness | | ISO 4406 (c) | >3 >/17/13 | 0 <u> 20/18/14</u> | | |
| FLUID DEGRADA | | method | limit/base | current | history1 | history2 |
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 1.5 | 0.83 | | |
| | ing itoring | , 10 1 11 00040 | 1.0 | 0.00 | | |




OIL ANALYSIS REPORT





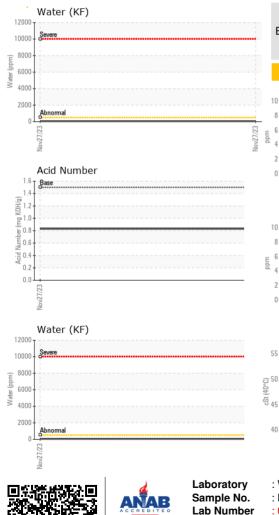

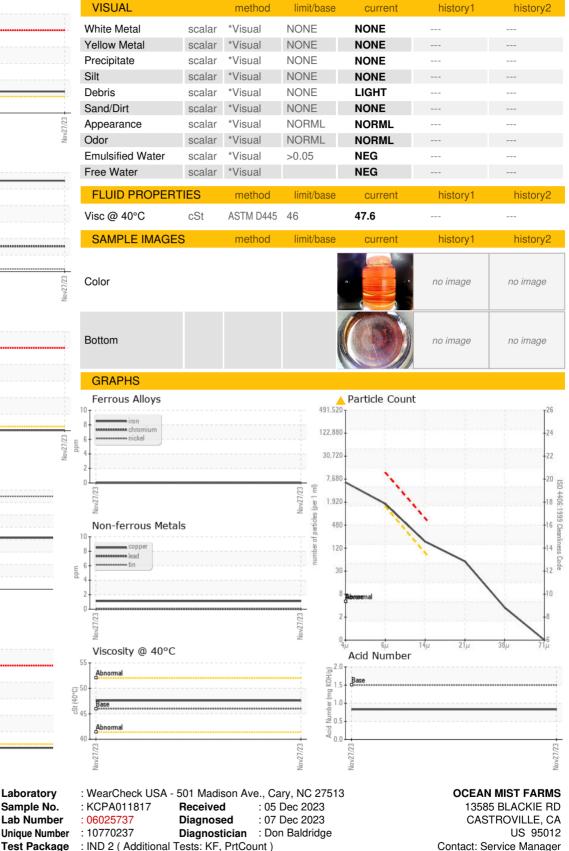

Test Package : IND 2 (Additional Tests: KF, PrtCount) abem@oceanmist.com To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate L2367

T:

F: