


PROBLEM SUMMARY


KAESER AIR TOWER 7.5C 5406104 (S/N 1062)

Compressor

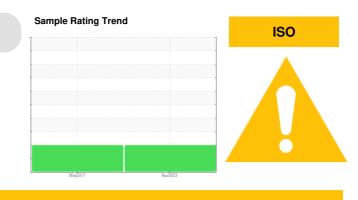

KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

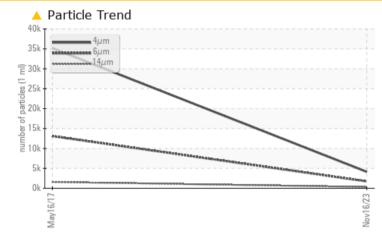

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status		ABNORMA	ABNORMAL			
Particles >6µm	ASTM D7647 >	>1300 🔺 1729	1 3096			
Particles >14µm	ASTM D7647	>80 ^ 328	1 575			
Particles >21µm	ASTM D7647 >	>20 🔺 107	A 375			
Particles >38µm	ASTM D7647 >	>4 🔺 6	<u> </u>			
Oil Cleanliness	ISO 4406 (c)	>/17/13 🔺 19/18/16	1 /18			

Customer Id: REPCAV Sample No.: KCPA010278 Lab Number: 06025741 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 <u>customerservice@wearcheck.com</u> There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

16 May 2017 Diag: Doug Bogart



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Machine Id KAESER AIR TOWER 7.5C 5406104 (S/N 1062) Component

Compressor Fluid

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

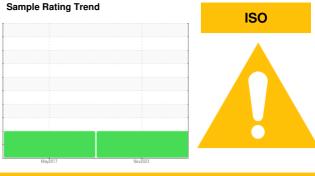

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA010278	KC62661	
Sample Date		Client Info		16 Nov 2023	16 May 2017	
Machine Age	hrs	Client Info		2650	536	
Oil Age	hrs	Client Info		0	536	
Oil Changed		Client Info		N/A	Changed	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	<1	
Lead	ppm	ASTM D5185m		0	0	
Copper	ppm	ASTM D5185m		15	3	
Tin	ppm	ASTM D5185m		0	0	
Antimony	ppm	ASTM D5185m	-		<1	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
	ρρπ		Pres 16.0			
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m		0	<1	
Manganese	ppm	ASTM D5185m		<1	<1	
Magnesium	ppm	ASTM D5185m	90	10	59	
Calcium	ppm	ASTM D5185m	2	0	2	
Phosphorus	ppm	ASTM D5185m		2	7	
Zinc	ppm	ASTM D5185m		0	10	
Sulfur	ppm	ASTM D5185m		18501	18192	
CONTAMINANTS	5	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	4	2	
Sodium	ppm	ASTM D5185m		2	12	
Potassium	ppm	ASTM D5185m	>20	0	12	
Water	%	ASTM D6304		0.005	0.026	
ppm Water	ppm	ASTM D6304		54	260	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		4137	35169	
Particles >6µm		ASTM D7647	>1300	<u> </u>	1 3096	
Particles >14µm		ASTM D7647	>80	A 328	▲ 1575	
Particles >21µm		ASTM D7647		<u> </u>	▲ 375	
Particles >38µm		ASTM D7647	>4	▲ 6	▲ 18	
Particles >71µm		ASTM D7647		0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	▲ 19/18/16	▲ 21/18	
		(-)				
		method	limit/baco	current	history	history?
FLUID DEGRADA Acid Number (AN)	ATION mg KOH/g	method ASTM D8045	limit/base	current 0.36	history1 0.379	history2

Report Id: REPCAV [WUSCAR] 06025741 (Generated: 12/07/2023 15:04:03) Rev: 1

Contact/Location: ? ? - REPCAV



OIL ANALYSIS REPORT

Received

Diagnosed

: KCPA010278

Test Package : IND 2 (Additional Tests: KF, PrtCount)

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)


: 06025741


To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.


: 05 Dec 2023


: 07 Dec 2023

Diagnostician : Don Baldridge





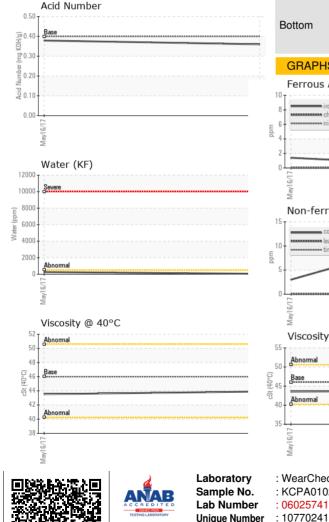

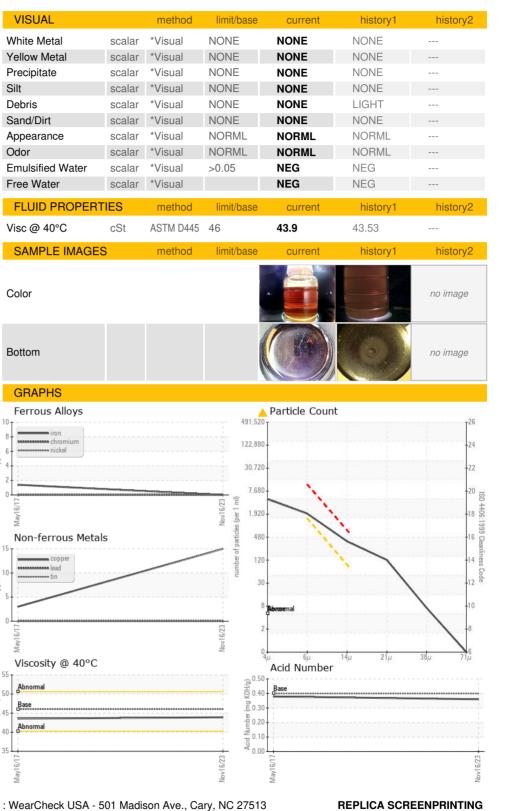

Certificate L2367

201 BROADWAY ST

CAVE CITY, KY

US 42127

Contact:

T: F: