

# **PROBLEM SUMMARY**

## Sample Rating Trend




# VILTER TYSCON 5 VILT (S/N 14450)

**Refrigeration Compressor** 

USPI 1009-68 SC (--- GAL)

# **COMPONENT CONDITION SUMMARY**

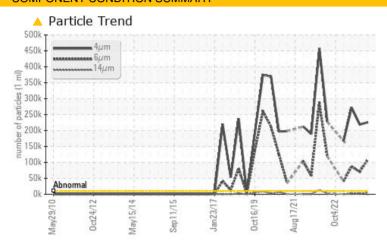

## RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS					
Sample Status		ABNORM <i>A</i>	AL ABNORMAL	ABNORMAL	
Particles >4µm	ASTM D7647 >1	0000 <b>225761</b>	<u>^</u> 218611	<u>▲</u> 272268	
Particles >6µm	ASTM D7647 >2	2500 🔺 108113	▲ 70492	▲ 87315	
Particles >14μm	ASTM D7647 >3	320 <b>A 5271</b>	<u> </u>	<b>2</b> 096	
Particles >21μm	ASTM D7647 >8	30 <b>A 743</b>	<u> </u>	<u>▲</u> 272	
Oil Cleanliness	ISO 4406 (c) >2	25/24/20	25/23/17	<b>25/24/18</b>	

**Customer Id: TYSCON** Sample No.: USP0003959 Lab Number: 06025753 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 dougb@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

#### **RECOMMENDED ACTIONS**

Action	Status	Date	Done By	Description
Change Filter			?	We recommend you service the filters on this component.

# HISTORICAL DIAGNOSIS

# 07 Sep 2023 Diag: Doug Bogart





We recommend you service the filters on this component. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. There is a trace of moisture present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



## 13 Jun 2023 Diag: Doug Bogart

ISO



We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



#### 01 Apr 2023 Diag: Doug Bogart

150



Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





# **OIL ANALYSIS REPORT**

SAMPLE INFO

## **Sample Rating Trend**



history2

nistory1

VILTER TYSCON 5 VILT (S/N 14450)

Component

**Refrigeration Compressor** 

USPI 1009-68 SC (--- GAL)

# DIAGNOSIS

### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

# Contamination

There is a high amount of particulates present in the oil.

#### **Fluid Condition**


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

ORMATION	method	limit/base	current	h
	y2010 Oct2012	May2014 Sep2015 .	Jan 2017 Oct2019 Aug2021	Oct2022
				1.11
<i>)</i>				
))				
OILI				

Sample Number		Client Info		USP0003959	USP248531	USP248530
Sample Date		Client Info		28 Nov 2023	07 Sep 2023	13 Jun 2023
Machine Age	hrs	Client Info		221	221	220
Oil Age	hrs	Client Info		0	221	0
Oil Changed		Client Info		N/A	Not Changd	Not Changd
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	<1	2	3
Chromium	ppm	ASTM D5185m	>2	0	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	0	0	<1
Lead	ppm	ASTM D5185m	>2	0	0	0
Copper	ppm	ASTM D5185m	>8	0	0	0
Tin	ppm	ASTM D5185m	>4	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m		0	0	0
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m		0	0	0
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m	50	29	0	6
CONTAMINANTS	5	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	0	<1	0
Sodium	ppm	ASTM D5185m		<1	<1	0
Potassium	ppm	ASTM D5185m	>20	0	0	<1
Water	%	ASTM D6304	>0.01	0.006	0.011	0.009
ppm Water	ppm	ASTM D6304	>100	65	119.9	97.0
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	<u>225761</u>	<u>^</u> 218611	<u>▲</u> 272268
Particles >6µm		ASTM D7647	>2500	<u> </u>	<u> </u>	<u>▲</u> 87315
Particles >14µm		ASTM D7647	>320	<u>▲</u> 5271	<u>1238</u>	<u>^</u> 2096
Particles >21µm		ASTM D7647	>80	<b>^</b> 743	▲ 102	▲ 272
Particles >38µm		ASTM D7647	>20	5	1	1
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	<b>25/24/20</b>	<u>△</u> 25/23/17	<u>△</u> 25/24/18
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.013	0.015	0.015



# **OIL ANALYSIS REPORT**

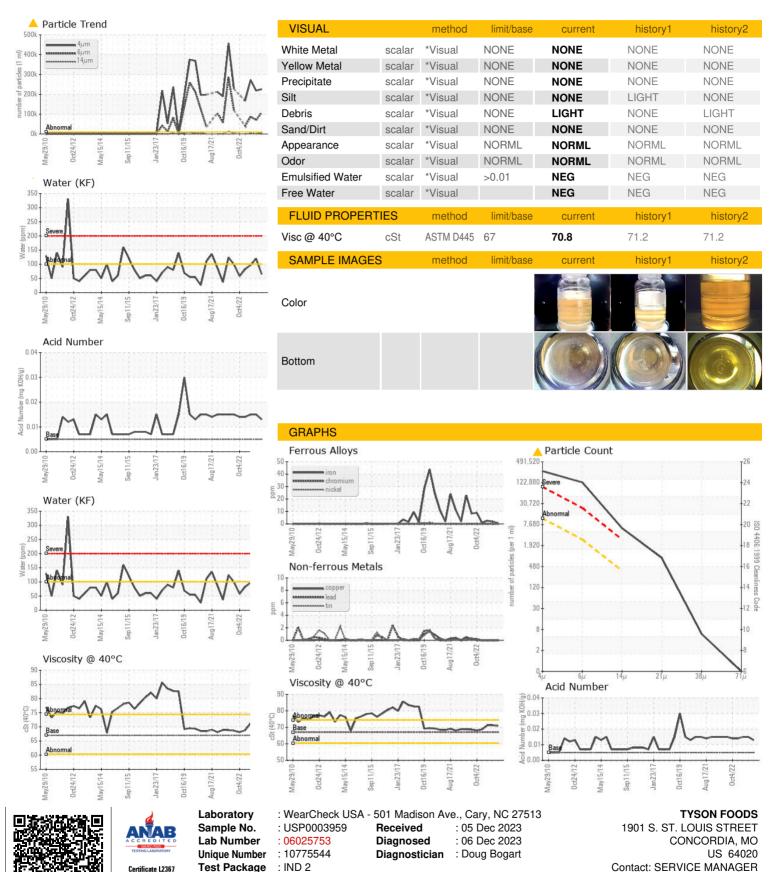

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate L2367

T: F: