




# PROBLEM SUMMARY


Area  
**BLEACH O2**  
 Machine Id  
**BX025 PRE02 PRESS NW (S/N 0661-03-02-040-040-090)**  
 Component  
**Bearing**  
 Fluid  
**Bearing Oil (4 GAL)**

Sample Rating Trend

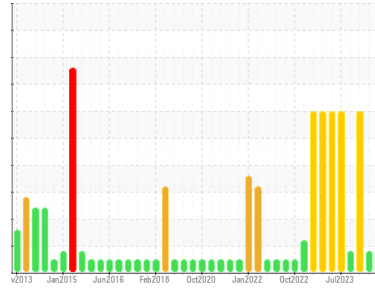

## COMPONENT CONDITION SUMMARY

### ▲ Ferrous Alloys

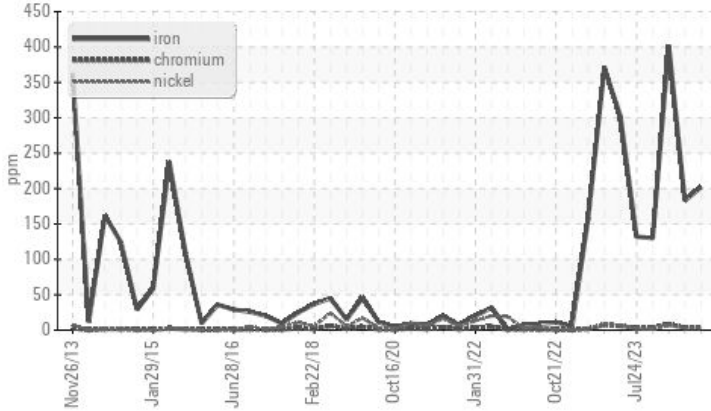

## RECOMMENDATION

We recommend an early resample to monitor this condition.

## PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	ABNORMAL	SEVERE
Iron	ppm	ASTM D5185m	>20	▲ 202	▲ 183	◆ 402

Customer Id: INTRIERP  
 Sample No.: WC0851724  
 Lab Number: 06025756  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Resample	---	---	?	We recommend an early resample to monitor this condition.

## HISTORICAL DIAGNOSIS

### 15 Nov 2023 Diag: Doug Bogart

#### WEAR



We recommend an early resample to monitor this condition. The iron level is abnormal. All other component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid.

[view report](#)



### 09 Oct 2023 Diag: Doug Bogart

#### WEAR



We advise that you inspect for the source(s) of wear. We recommend an early resample to monitor this condition. The iron level is severe. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid.

[view report](#)



### 17 Aug 2023 Diag: Don Baldrige

#### WEAR



We advise that you inspect for the source(s) of wear. We recommend an early resample to monitor this condition. The iron level is severe. All other component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid.


[view report](#)





# OIL ANALYSIS REPORT

Sample Rating Trend

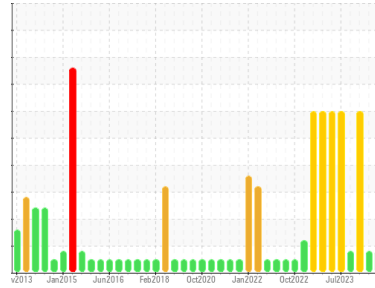

**WEAR**



Area  
**BLEACH O2**  
 Machine Id  
**BX025 PRE02 PRESS NW (S/N 0661-03-02-040-040-090)**  
 Component  
**Bearing**  
 Fluid  
**Bearing Oil (4 GAL)**

## DIAGNOSIS

### Recommendation

We recommend an early resample to monitor this condition.

### Wear

The iron level is abnormal. All other component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>WC0851724</b>	WC0851758	WC0851721
Sample Date	Client Info	<b>01 Dec 2023</b>	15 Nov 2023	09 Oct 2023
Machine Age	mls	Client Info	0	0
Oil Age	mls	Client Info	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>ABNORMAL</b>	ABNORMAL	SEVERE

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >20	<b>▲ 202</b>	▲ 183	◆ 402
Chromium	ppm	ASTM D5185m >20	<b>3</b>	4	8
Nickel	ppm	ASTM D5185m >20	<b>3</b>	2	7
Titanium	ppm	ASTM D5185m	<b>0</b>	<1	0
Silver	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Aluminum	ppm	ASTM D5185m >20	<b>&lt;1</b>	1	4
Lead	ppm	ASTM D5185m >20	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >20	<b>&lt;1</b>	1	2
Tin	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	<b>0</b>	0	3
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	<1	<1
Manganese	ppm	ASTM D5185m	<b>2</b>	2	2
Magnesium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Calcium	ppm	ASTM D5185m	<b>3</b>	0	1
Phosphorus	ppm	ASTM D5185m	<b>498</b>	388	429
Zinc	ppm	ASTM D5185m	<b>0</b>	0	2
Sulfur	ppm	ASTM D5185m	<b>16536</b>	15704	16137

## CONTAMINANTS





method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >15	<b>10</b>	8	12
Sodium	ppm	ASTM D5185m	<b>21</b>	8	29
Potassium	ppm	ASTM D5185m >20	<b>1</b>	2	2
Water	%	ASTM D6304 >2	<b>1.09</b>	0.095	1.11
ppm Water	ppm	ASTM D6304	<b>10900</b>	950	11100

## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.70</b>	0.57	0.68




# OIL ANALYSIS REPORT

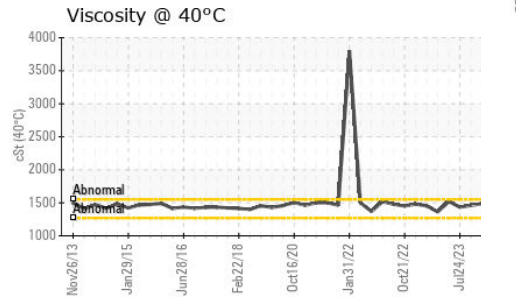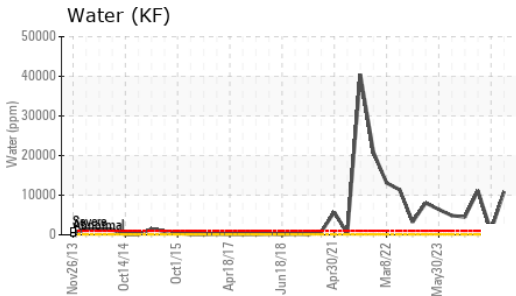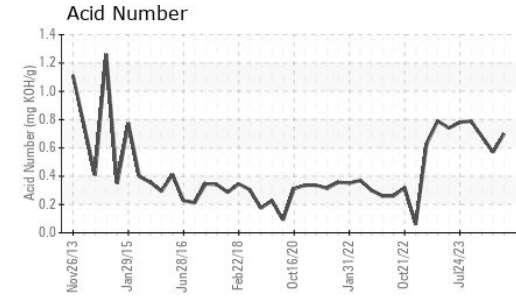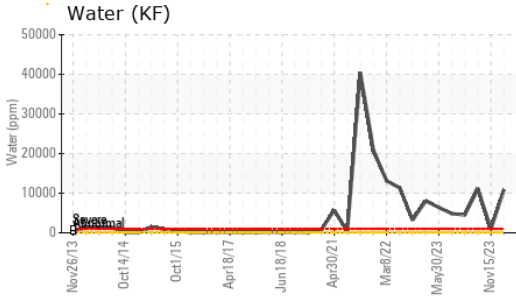





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>2	0.2%	▲ 0.2%
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	1531	1400	1489

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

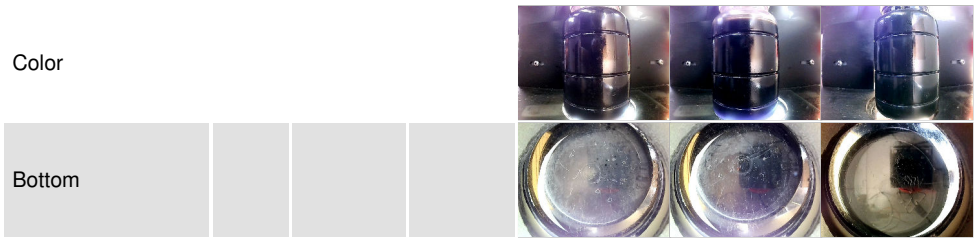

## GRAPHS

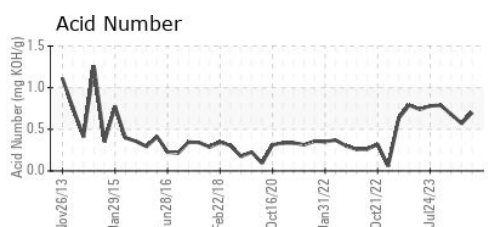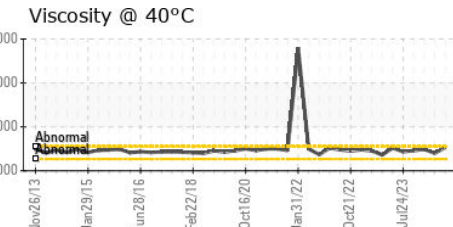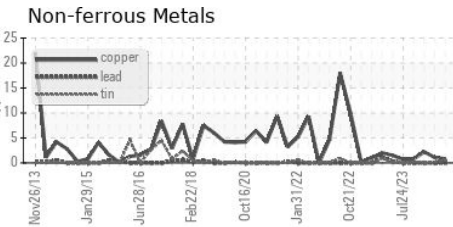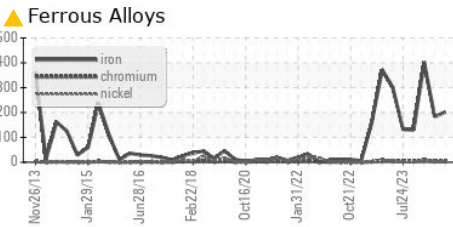

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0851724 **Received** : 05 Dec 2023  
**Lab Number** : 06025756 **Diagnosed** : 07 Dec 2023  
**Unique Number** : 10775547 **Diagnostician** : Don Baldridge  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**INTERNATIONAL PAPER**  
 865 JOHN L REGEL RD  
 RIEGELWOOD, NC  
 US 28456  
 Contact: Zach Lizana  
 zachary.lizana@ipaper.com  
 T: (910)362-4775  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)