


PROBLEM SUMMARY

Sample Rating Trend

ISO




Area
Extrusion
 Machine Id
Press 6 Press Hydraulic Unit (S/N 3080-2010)
 Component
Hydraulic System
 Fluid
AW HYDRAULIC OIL ISO 46 (3778 GAL)

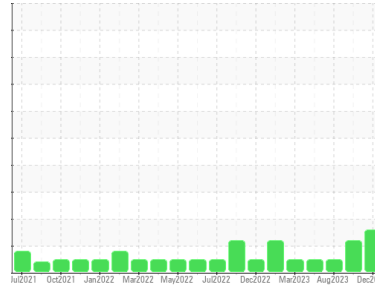

COMPONENT CONDITION SUMMARY

▲ Particle Trend

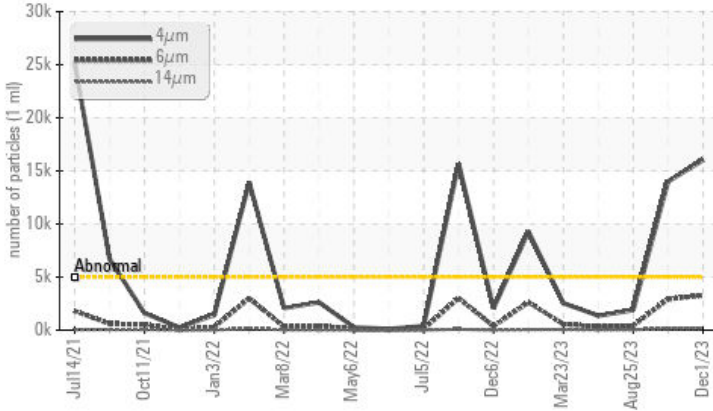

RECOMMENDATION

We recommend you service the filters on this component. We recommend an early resample to monitor this condition. Please specify the brand, type, and viscosity of the oil on your next sample.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	NORMAL
Particles >4µm	ASTM D7647	>5000	▲ 16025	▲ 14001	1888
Particles >6µm	ASTM D7647	>1300	▲ 3279	▲ 2924	422
Particles >14µm	ASTM D7647	>160	▲ 169	136	40
Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ 21/19/15	▲ 21/19/14	18/16/12

Customer Id: WESCARTEX
 Sample No.: RP0038265
 Lab Number: 06026382
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Wes Davis +1 905-569-8600 x223
wesd@wearcheck.ca

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.
Resample	---	---	?	We recommend an early resample to monitor this condition.
Information Required	---	---	?	Please specify the brand, type, and viscosity of the oil on your next sample.

HISTORICAL DIAGNOSIS

13 Oct 2023 Diag: Angela Borella

ISO



We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

view report



25 Aug 2023 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



30 Jun 2023 Diag: Wes Davis

NORMAL



Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample. All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report




OIL ANALYSIS REPORT

Sample Rating Trend

ISO

Area
Extrusion
 Machine Id
Press 6 Press Hydraulic Unit (S/N 3080-2010)
 Component
Hydraulic System
 Fluid
AW HYDRAULIC OIL ISO 46 (3778 GAL)

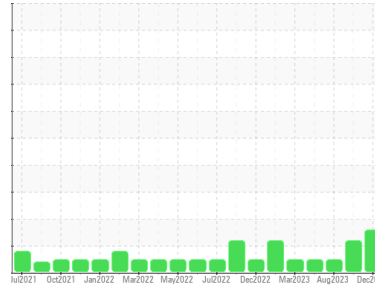

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. We recommend an early resample to monitor this condition. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible. The system cleanliness is above the acceptable limit for the target ISO 4406 cleanliness code.

Fluid Condition

The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	RP0038265	RP0038257	RP0024729
Sample Date	Client Info	01 Dec 2023	13 Oct 2023	25 Aug 2023
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ABNORMAL	ABNORMAL	NORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >20	0	0	<1
Chromium	ppm	ASTM D5185m >20	0	0	0
Nickel	ppm	ASTM D5185m >20	0	0	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >20	0	0	<1
Lead	ppm	ASTM D5185m >20	0	0	0
Copper	ppm	ASTM D5185m >20	1	2	4
Tin	ppm	ASTM D5185m >20	0	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 5	9	22	20
Barium	ppm	ASTM D5185m 5	0	0	2
Molybdenum	ppm	ASTM D5185m 5	10	27	26
Manganese	ppm	ASTM D5185m	<1	0	0
Magnesium	ppm	ASTM D5185m 25	23	53	42
Calcium	ppm	ASTM D5185m 200	87	191	178
Phosphorus	ppm	ASTM D5185m 300	308	383	358
Zinc	ppm	ASTM D5185m 370	365	459	440

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >15	<1	1	<1
Sodium	ppm	ASTM D5185m	1	<1	0
Potassium	ppm	ASTM D5185m >20	<1	3	4
Water	%	ASTM D6304 >0.05	0.004	0.005	0.005
ppm Water	ppm	ASTM D6304 >500	49	51.5	53.3

FLUID CLEANLINESS


method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >5000	▲ 16025	▲ 14001	1888
Particles >6µm	ASTM D7647 >1300	▲ 3279	▲ 2924	422
Particles >14µm	ASTM D7647 >160	▲ 169	136	40
Particles >21µm	ASTM D7647 >40	42	32	14
Particles >38µm	ASTM D7647 >10	2	2	1
Particles >71µm	ASTM D7647 >3	0	0	0
Oil Cleanliness	ISO 4406 (c) >19/17/14	▲ 21/19/15	▲ 21/19/14	18/16/12

FLUID DEGRADATION


method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.57	0.42	0.50	0.49

OIL ANALYSIS REPORT


▲ Particle Trend

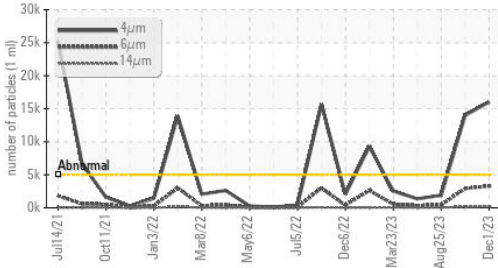


Water (KF)

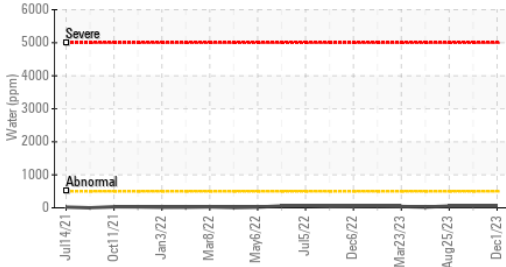


Acid Number

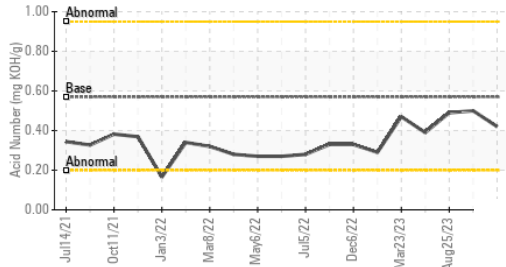

Water (KF)

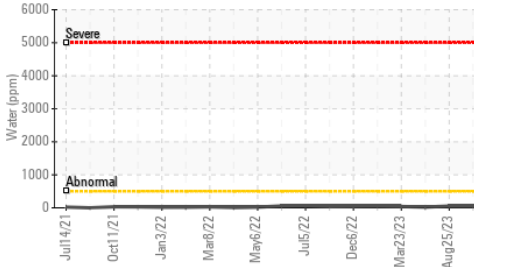

Viscosity @ 40°C

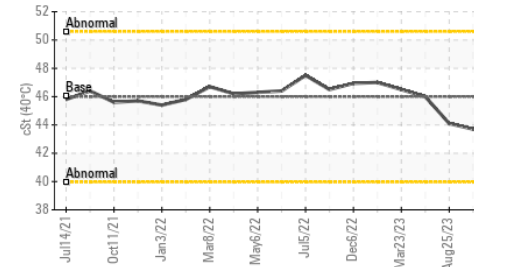

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.5	43.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color




Bottom




GRAPHS


Ferrous Alloys

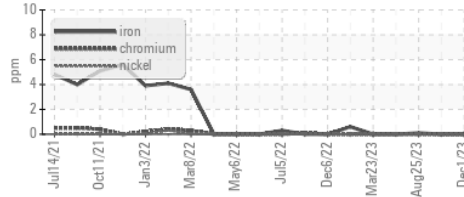


Non-ferrous Metals

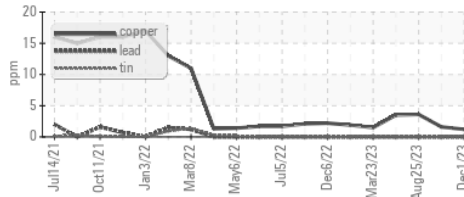


Viscosity @ 40°C

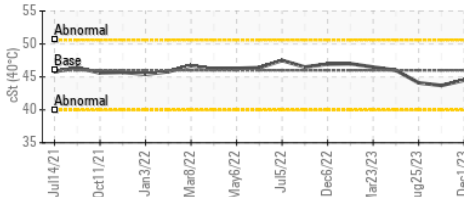

▲ Particle Count

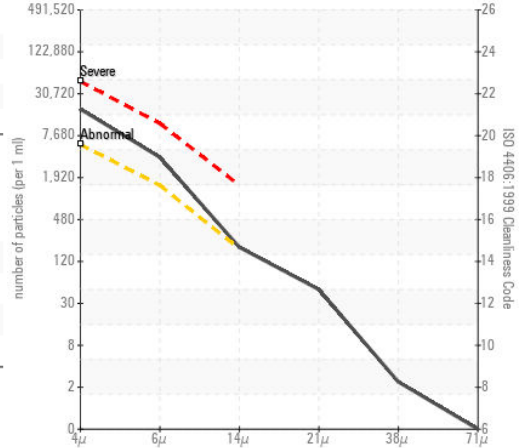

Acid Number

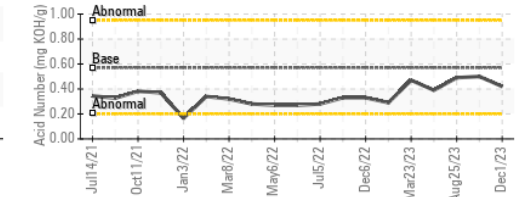

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0038265 **Received** : 06 Dec 2023
Lab Number : 06026382 **Diagnosed** : 07 Dec 2023
Unique Number : 10776173 **Diagnostician** : Wes Davis
Test Package : IND 2

WESTERN EXTRUSIONS CORPORATION
 1735 SANDY LAKE RD
 CARROLLTON, TX
 US 75006
 Contact: WESTERN EXTRUSIONS
 SHAYLEY@WESTERNEXTRUSIONS.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: