

PROBLEM SUMMARY

Sample Rating Trend

ISO

Machine Id


KAESER ASD 40T 6008069 (S/N 1279)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

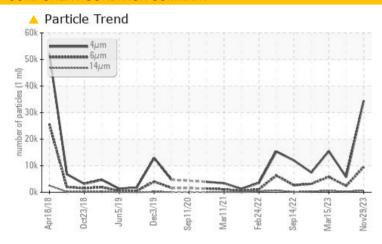

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL				
Particles >6µm	ASTM D7647	>1300	4 9475	<u>\$\text{2384}\$</u>	<u></u> 5792				
Particles >14µm	ASTM D7647	>80	▲ 662	<u>^</u> 263	<u></u> 566				
Particles >21µm	ASTM D7647	>20	<u> </u>	△ 59	<u>▲</u> 173				
Oil Cleanliness	ISO 4406 (c)	>/17/13	22/20/17	2 0/18/15	21/20/16				

Customer Id: AMAEDI Sample No.: KC125889 Lab Number: 06026417 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

26 Sep 2023 Diag: Don Baldridge

ISO



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



15 Mar 2023 Diag: Don Baldridge

ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



17 Nov 2022 Diag: Don Baldridge

ISO



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Sample Rating Trend



KAESER ASD 40T 6008069 (S/N 1279)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

gr2016 Ord2018 Jun2019 Der2018 Sep2020 Mar2021 Feb2022 Sep2022 Mer2021 Ner202								
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2		
Sample Number		Client Info		KC125889	KC125904	KC101725		
Sample Date		Client Info		29 Nov 2023	26 Sep 2023	15 Mar 2023		
Machine Age	hrs	Client Info		26499	25577	22744		
Oil Age	hrs	Client Info		0	0	5900		
Oil Changed		Client Info		N/A	N/A	Changed		
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2		
Iron	ppm	ASTM D5185m	>50	0	<1	<1		
Chromium	ppm	ASTM D5185m	>10	0	0	0		
Nickel	ppm	ASTM D5185m	>3	0	0	0		
Titanium	ppm	ASTM D5185m	>3	0	0	0		
Silver	ppm	ASTM D5185m	>2	0	0	0		
Aluminum	ppm	ASTM D5185m	>10	0	0	<1		
Lead	ppm	ASTM D5185m	>10	0	0	0		
Copper	ppm	ASTM D5185m	>50	6	6	10		
Tin	ppm	ASTM D5185m	>10	0	0	0		
Vanadium	ppm	ASTM D5185m		0	0	0		
Cadmium	ppm	ASTM D5185m		0	0	0		
ADDITIVES		method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m		0	0	0		
Barium	ppm	ASTM D5185m	90	0	3	0		
Molybdenum	ppm	ASTM D5185m		0	0	0		
Manganese	ppm	ASTM D5185m		<1	0	0		
Magnesium	ppm	ASTM D5185m	90	44	48	37		
Calcium	ppm	ASTM D5185m	2	<1	0	<1		
Phosphorus	ppm	ASTM D5185m		2	3	2		
Zinc	ppm	ASTM D5185m		0	14	22		
CONTAMINANTS	3	method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	>25	<1	1	1		
Sodium	ppm	ASTM D5185m		24	20	14		
Potassium	ppm	ASTM D5185m	>20	4	4	2		
Water	%	ASTM D6304	>0.05	0.014	0.023	0.015		
ppm Water	ppm	ASTM D6304	>500	143	235.5	155.5		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2		
Particles >4µm		ASTM D7647		34492	5689	15512		
Particles >6µm		ASTM D7647	>1300	<u>4</u> 9475	<u>^</u> 2384	<u></u> 5792		
Particles >14μm		ASTM D7647	>80	▲ 662	△ 263	△ 566		
Particles >21µm		ASTM D7647	>20	<u> </u>	△ 59	▲ 173		
Particles >38μm		ASTM D7647	>4	2	2	<u>^</u> 6		
Particles >71μm		ASTM D7647	>3	0	0	1		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>22/20/17</u>	2 0/18/15	1 21/20/16		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2		
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.28	0.31	0.34		



OIL ANALYSIS REPORT







Sample No. Lab Number **Unique Number**

: KC125889 : 06026417 : 10776208 : IND 2

: 06 Dec 2023 Received : 07 Dec 2023 Diagnosed

Diagnostician : Don Baldridge

Test Package Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

EDISON, NJ

Contact: Service Manager

US 08817

T: F: