




PROBLEM SUMMARY

Sample Rating Trend

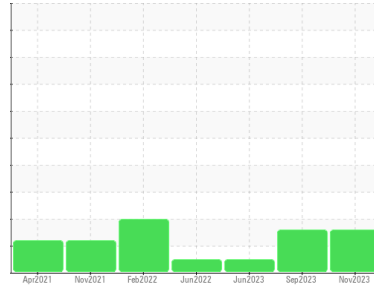


Machine Id
KAESER 7499598

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

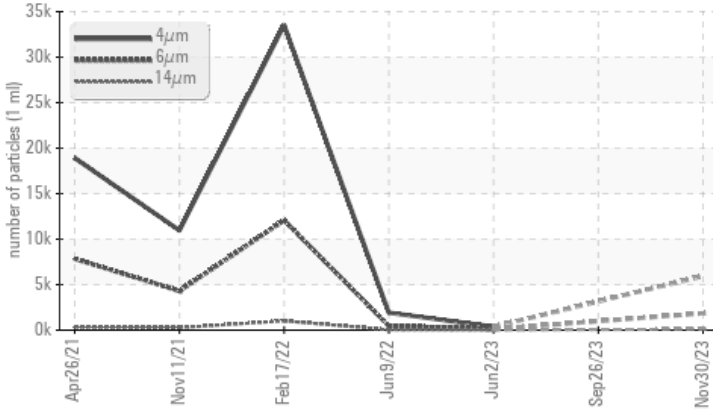

RECOMMENDATION

No corrective action is recommended at this time.
Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ATTENTION	ABNORMAL	NORMAL
Particles >6µm	ASTM D7647	>1300	▲ 1850	---	116
Particles >14µm	ASTM D7647	>80	▲ 106	---	7
Particles >21µm	ASTM D7647	>20	▲ 22	---	1
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 20/18/14	---	16/14/10

Customer Id: AMACARNJ
Sample No.: KC127418
Lab Number: 06026418
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

26 Sep 2023 Diag: Don Baldrige

WATER



There is too much water present in this sample to perform a particle count. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition. All component wear rates are normal. There is a moderate concentration of water present in the oil. The AN level is acceptable for this fluid.

view report



02 Jun 2023 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



09 Jun 2022 Diag: Jonathan Hester

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

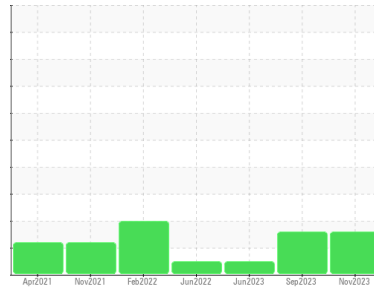

ISO



Machine Id
KAESER 7499598
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		KC127418	KC125900	KC101879
Sample Date	Client Info		30 Nov 2023	26 Sep 2023	02 Jun 2023
Machine Age	hrs	Client Info	11588	11153	10569
Oil Age	hrs	Client Info	0	0	1500
Oil Changed	Client Info		N/A	N/A	Not Changd
Sample Status			ATTENTION	ABNORMAL	NORMAL

WEAR METALS	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	0	0
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	<1
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	0	4	0
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	<1	<1	<1
Tin	ppm	ASTM D5185m >10	0	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0






ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	<1	0	30
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	<1	0	<1
Magnesium	ppm	ASTM D5185m 90	70	25	35
Calcium	ppm	ASTM D5185m 2	<1	0	0
Phosphorus	ppm	ASTM D5185m	2	4	2
Zinc	ppm	ASTM D5185m	0	0	0

CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	0	0	<1
Sodium	ppm	ASTM D5185m	11	2	5
Potassium	ppm	ASTM D5185m >20	2	<1	4
Water	%	ASTM D6304 >0.05	0.011	▲ 0.416	0.024
ppm Water	ppm	ASTM D6304 >500	117	▲ 4160	246.7

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		5942	---	376
Particles >6µm	ASTM D7647	>1300	▲ 1850	---	116
Particles >14µm	ASTM D7647	>80	▲ 106	---	7
Particles >21µm	ASTM D7647	>20	▲ 22	---	1
Particles >38µm	ASTM D7647	>4	2	---	0
Particles >71µm	ASTM D7647	>3	0	---	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 20/18/14	---	16/14/10

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.31	0.28	0.25

OIL ANALYSIS REPORT

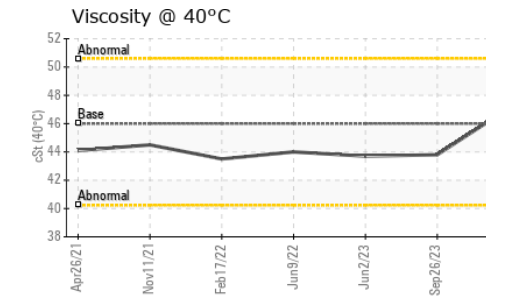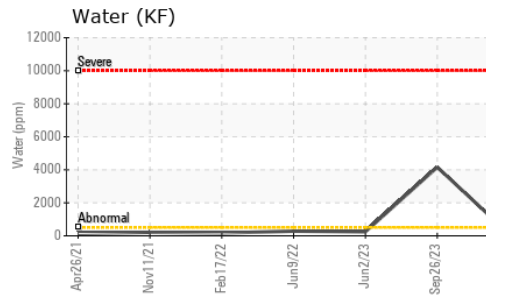
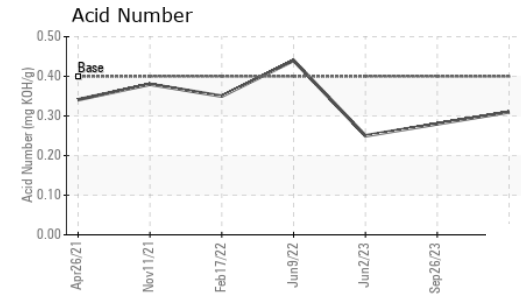
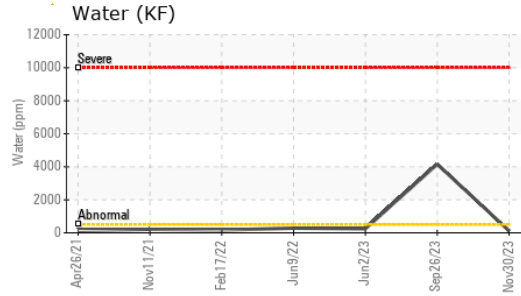
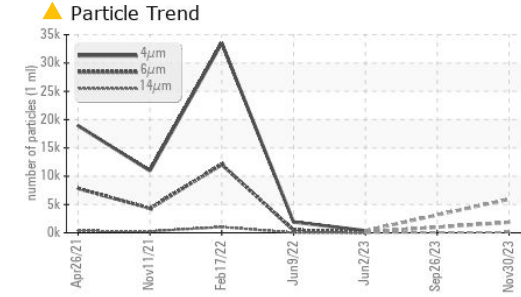


PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	▲ 0.2%
Free Water	scalar	*Visual		NEG	NEG

PARAMETER	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	47.1	43.8

PARAMETER	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

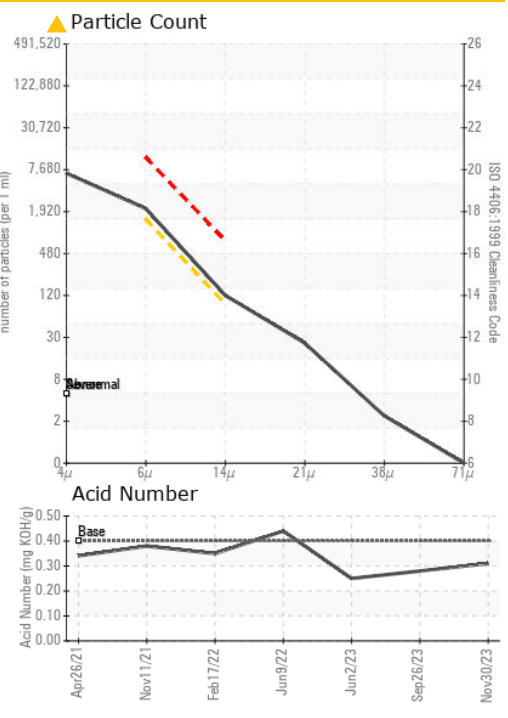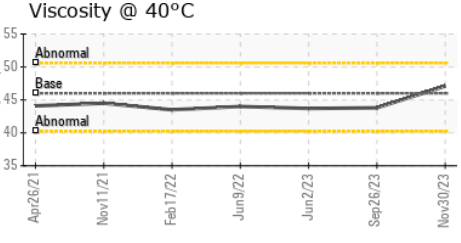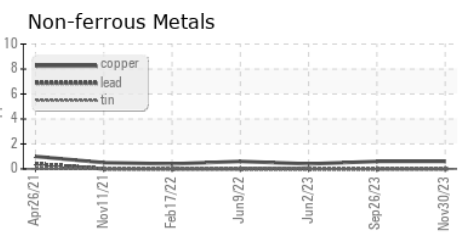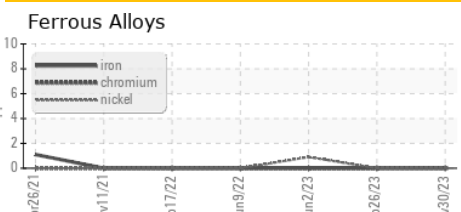

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC127418 **Received** : 06 Dec 2023
Lab Number : 06026418 **Diagnosed** : 07 Dec 2023
Unique Number : 10776209 **Diagnostician** : Don Baldrige
Test Package : IND 2

AMAZON CDW5
 380 MIDDLESEX AVE
 CARTERET, NJ
 US 07088
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)