




PROBLEM SUMMARY

Sample Rating Trend

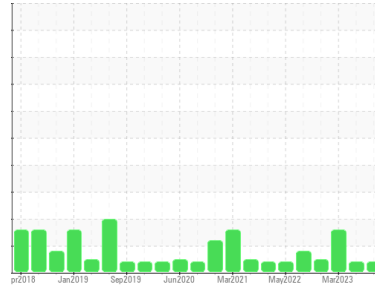

VIS DEBRIS



Machine Id
KAESER ASD 40T 6025209 (S/N 1281)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

No relevant graphs to display

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

PROBLEMATIC TEST RESULTS

| Sample Status | | ABNORMAL | ABNORMAL | ABNORMAL |
|---------------|----------------|----------|----------|----------|
| Debris | scalar *Visual | ▲ MODER | ▲ MODER | LIGHT |

Customer Id: AMAEDI
 Sample No.: KC127412
 Lab Number: 06026419
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

| Action | Status | Date | Done By | Description |
|--------|--------|------|---------|---|
| Alert | --- | --- | ? | We were unable to perform a particle count due to a high concentration of particles present in this sample. |

HISTORICAL DIAGNOSIS

26 Sep 2023 Diag: Don Baldrige

VIS DEBRIS



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



15 Mar 2023 Diag: Don Baldrige

ISO



Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



17 Nov 2022 Diag: Don Baldrige

NORMAL




Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

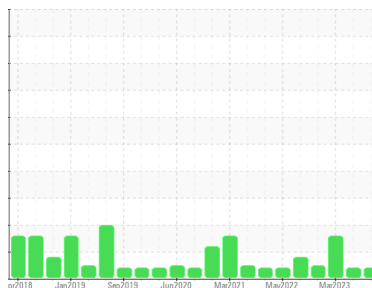

VIS DEBRIS



Machine Id
KAESER ASD 40T 6025209 (S/N 1281)

Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

Wear

All component wear rates are normal.

▲ Contamination

Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

| method | limit/base | current | history1 | history2 |
|---------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info | KC127412 | KC125909 | KC112275 |
| Sample Date | Client Info | 29 Nov 2023 | 26 Sep 2023 | 15 Mar 2023 |
| Machine Age | hrs | 28660 | 27741 | 25019 |
| Oil Age | hrs | 0 | 0 | 6236 |
| Oil Changed | Client Info | N/A | N/A | Changed |
| Sample Status | | ABNORMAL | ABNORMAL | ABNORMAL |

WEAR METALS

| method | limit/base | current | history1 | history2 | |
|----------|------------|-----------------|-----------|----------|----|
| Iron | ppm | ASTM D5185m >50 | 0 | <1 | <1 |
| Chromium | ppm | ASTM D5185m >10 | 0 | 0 | 0 |
| Nickel | ppm | ASTM D5185m >3 | 0 | 0 | 0 |
| Titanium | ppm | ASTM D5185m >3 | 0 | 0 | 0 |
| Silver | ppm | ASTM D5185m >2 | 0 | 0 | 0 |
| Aluminum | ppm | ASTM D5185m >10 | 0 | 0 | <1 |
| Lead | ppm | ASTM D5185m >10 | 0 | 0 | 0 |
| Copper | ppm | ASTM D5185m >50 | 10 | 7 | 9 |
| Tin | ppm | ASTM D5185m >10 | 0 | 0 | 0 |
| Vanadium | ppm | ASTM D5185m | 0 | 0 | 0 |
| Cadmium | ppm | ASTM D5185m | 0 | 0 | 0 |

ADDITIVES

| method | limit/base | current | history1 | history2 | |
|------------|------------|----------------|--------------|----------|----|
| Boron | ppm | ASTM D5185m | 0 | 0 | 0 |
| Barium | ppm | ASTM D5185m 90 | 0 | 8 | 2 |
| Molybdenum | ppm | ASTM D5185m | 0 | 0 | 0 |
| Manganese | ppm | ASTM D5185m | <1 | 0 | <1 |
| Magnesium | ppm | ASTM D5185m 90 | 43 | 48 | 38 |
| Calcium | ppm | ASTM D5185m 2 | <1 | <1 | <1 |
| Phosphorus | ppm | ASTM D5185m | 2 | 2 | 2 |
| Zinc | ppm | ASTM D5185m | 0 | 13 | 25 |

CONTAMINANTS

| method | limit/base | current | history1 | history2 | |
|-----------|------------|------------------|--------------|----------|-------|
| Silicon | ppm | ASTM D5185m >25 | <1 | 1 | <1 |
| Sodium | ppm | ASTM D5185m | 28 | 24 | 17 |
| Potassium | ppm | ASTM D5185m >20 | 4 | 5 | 4 |
| Water | % | ASTM D6304 >0.05 | 0.017 | 0.015 | 0.013 |
| ppm Water | ppm | ASTM D6304 >500 | 171 | 151.5 | 135.1 |




FLUID CLEANLINESS

| method | limit/base | current | history1 | history2 |
|-----------------|------------------------|---------|----------|------------|
| Particles >4µm | ASTM D7647 | --- | --- | 5905 |
| Particles >6µm | ASTM D7647 >1300 | --- | --- | ▲ 2383 |
| Particles >14µm | ASTM D7647 >80 | --- | --- | ▲ 239 |
| Particles >21µm | ASTM D7647 >20 | --- | --- | ▲ 70 |
| Particles >38µm | ASTM D7647 >4 | --- | --- | 1 |
| Particles >71µm | ASTM D7647 >3 | --- | --- | 0 |
| Oil Cleanliness | ISO 4406 (c) >--/17/13 | --- | --- | ▲ 20/18/15 |

FLUID DEGRADATION

| method | limit/base | current | history1 | history2 | |
|------------------|------------|----------------|-------------|----------|------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 0.4 | 0.28 | 0.31 | 0.32 |


OIL ANALYSIS REPORT

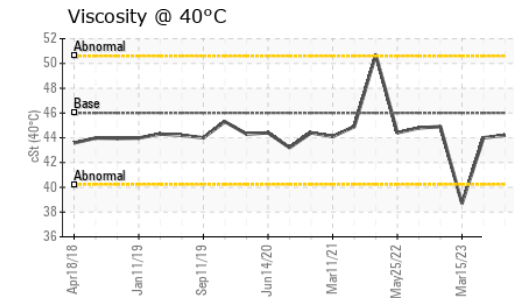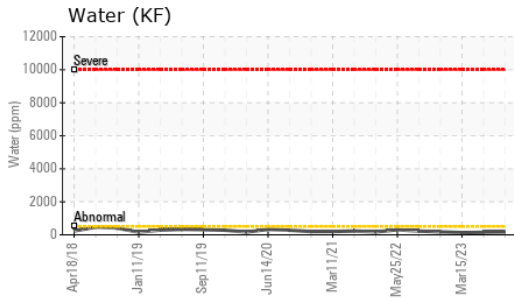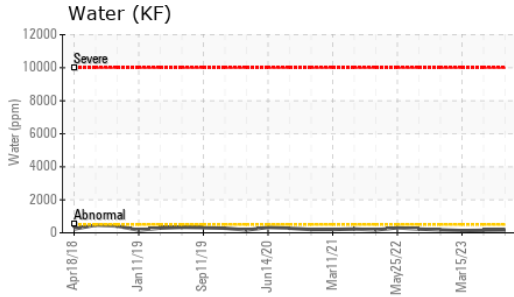





| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE |
| Debris | scalar | *Visual | ▲ MODER | ▲ MODER | LIGHT |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.05 | NEG | NEG |
| Free Water | scalar | *Visual | NEG | NEG | NEG |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|--------------|---------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 46 | 44.2 | 44.0 | 38.7 |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

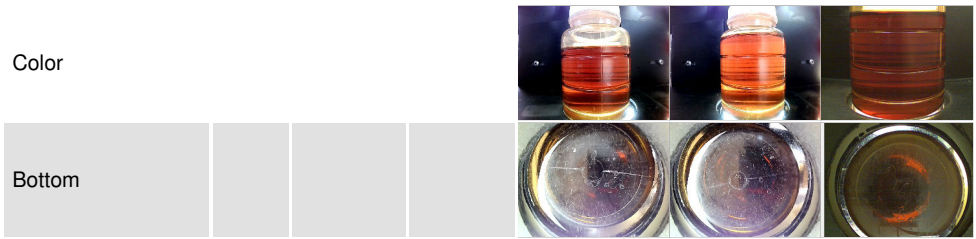

GRAPHS

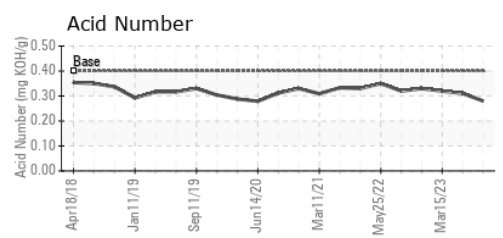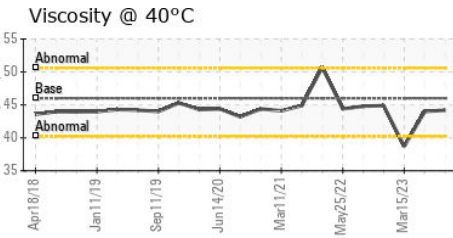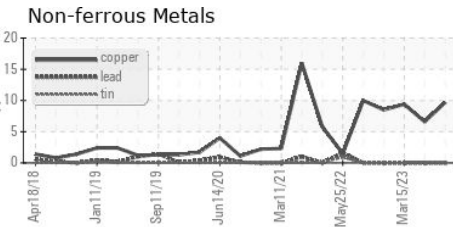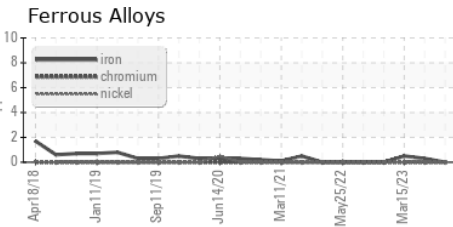

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC127412 **Received** : 06 Dec 2023
Lab Number : 06026419 **Diagnosed** : 07 Dec 2023
Unique Number : 10776210 **Diagnostician** : Don Baldrige
Test Package : IND 2

AMAZON EDISON LGA-9
 2170 ROUTE 27
 EDISON, NJ
 US 08817
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: