

PROBLEM SUMMARY

Sample Rating Trend

ISO


Machine Id

KAESER DSD 175 6577272 (S/N 1133)


Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)



COMPONENT CONDITION SUMMARY

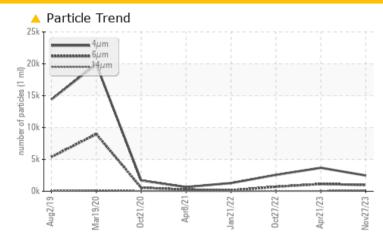

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC T	PROBLEMATIC TEST RESULTS								
Sample Status			ATTENTION	NORMAL	NORMAL				
Particles >14µm	ASTM D7647	>80	<u> </u>	50	53				
Oil Cleanliness	ISO 4406 (c)	>/17/13	18/17/14	19/17/13	19/17/13				

Customer Id: CURKEE Sample No.: KCPA007281 Lab Number: 06026437 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

21 Apr 2023 Diag: Don Baldridge

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



27 Oct 2022 Diag: Don Baldridge

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



21 Jan 2022 Diag: Angela Borella

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

KAESER DSD 175 6577272 (S/N 1133)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Αωμά2019 Ματά2020 Οστά2020 Αφτά2021 Jancá2022 Οστά2022 Αφτά2023 Νοντά2023								
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2		
Sample Number		Client Info		KCPA007281	KCP53530	KCP46444		
Sample Date		Client Info		27 Nov 2023	21 Apr 2023	27 Oct 2022		
Machine Age	hrs	Client Info		25907	22977	18748		
Oil Age	hrs	Client Info		0	3000	2927		
Oil Changed		Client Info		N/A	Changed	Not Changd		
Sample Status				ATTENTION	NORMAL	NORMAL		
WEAR METALS		method	limit/base	current	history1	history2		
Iron	ppm	ASTM D5185m	>50	0	0	0		
Chromium	ppm	ASTM D5185m	>10	0	0	0		
Nickel	ppm	ASTM D5185m	>3	0	0	0		
Titanium	ppm	ASTM D5185m	>3	0	0	0		
Silver	ppm	ASTM D5185m	>2	0	0	0		
Aluminum	ppm	ASTM D5185m	>10	0	0	<1		
Lead	ppm	ASTM D5185m	>10	0	0	0		
Copper	ppm	ASTM D5185m	>50	4	5	3		
Tin	ppm	ASTM D5185m	>10	0	0	0		
Antimony	ppm	ASTM D5185m						
Vanadium	ppm	ASTM D5185m		0	0	0		
Cadmium	ppm	ASTM D5185m		0	0	0		
ADDITIVES		method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m	0	0	0	0		
Barium	ppm	ASTM D5185m	90	0	0	1		
Molybdenum	ppm	ASTM D5185m	0	0	0	0		
Manganese	ppm	ASTM D5185m		<1	0	0		
Magnesium	ppm	ASTM D5185m	100	0	<1	17		
Calcium	ppm	ASTM D5185m	0	0	0	0		
Phosphorus	ppm	ASTM D5185m	0	2	0	2		
Zinc	ppm	ASTM D5185m	0	0	0	10		
Sulfur	ppm	ASTM D5185m	23500	17557	21217	21886		
CONTAMINANTS	3	method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	>25	0	0	0		
Sodium	ppm	ASTM D5185m		<1	0	4		
Potassium	ppm	ASTM D5185m	>20	0	<1	0		
Water	%	ASTM D6304		0.015	0.016	0.008		
ppm Water	ppm	ASTM D6304	>500	151	162.4	89.5		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2		
Particles >4μm		ASTM D7647		2478	3685	2565		
Particles >6µm		ASTM D7647	>1300	989	1139	711		
Particles >14μm		ASTM D7647	>80	<u> </u>	50	53		
Particles >21µm		ASTM D7647	>20	20	9	13		
Particles >38µm		ASTM D7647	>4	0	1	0		
Particles >71μm		ASTM D7647	>3	0	0	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/17/14	19/17/13	19/17/13		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2		



OIL ANALYSIS REPORT







Certificate L2367

Sample No. Lab Number **Unique Number**

: 06026437 : 10776228

Received : KCPA007281 Diagnosed

: 07 Dec 2023 Diagnostician : Don Baldridge

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

US 80643

T: F:

KEENESBURG, CO

Contact: Service Manager