


# PROBLEM SUMMARY

Sample Rating Trend




**WATER**

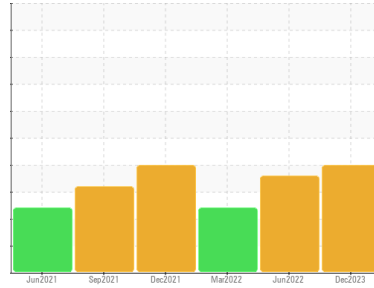


Area  
**Jackson County 1 Plant/Cryogenic/Compressor**  
 Machine Id  
**C-1162 (S/N 10241N10655622)**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**SUMMIT PGS-100 (250 GAL)**

## COMPONENT CONDITION SUMMARY

▲ Particle Trend

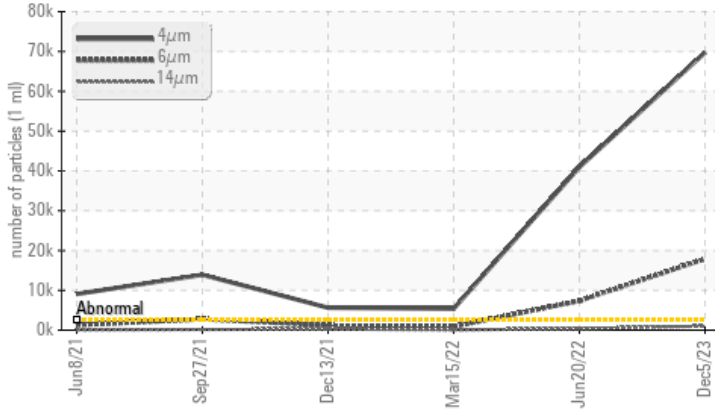

▲ Water (KF)

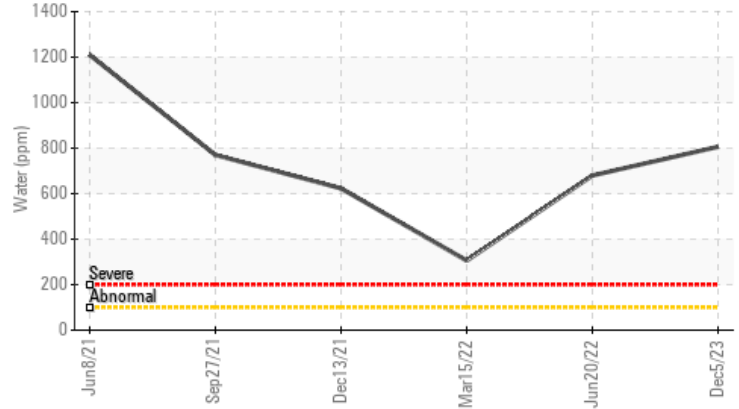

## RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status	%	ASTM D6304	>0.01	<b>ABNORMAL</b>	ABNORMAL	ABNORMAL
Water	%	ASTM D6304	>0.01	▲ <b>0.080</b>	▲ 0.067	▲ 0.030
ppm Water	ppm	ASTM D6304	>100	▲ <b>806</b>	▲ 679.8	▲ 305.8
Particles >4µm		ASTM D7647	>2500	▲ <b>69731</b>	▲ 40960	▲ 5411
Particles >6µm		ASTM D7647	>320	▲ <b>17889</b>	▲ 7348	▲ 875
Particles >14µm		ASTM D7647	>80	▲ <b>1009</b>	▲ 374	▲ 51
Particles >21µm		ASTM D7647	>20	▲ <b>270</b>	▲ 66	▲ 17
Particles >38µm		ASTM D7647	>4	▲ <b>14</b>	▲ 4	▲ 0
Oil Cleanliness		ISO 4406 (c)	>18/15/13	▲ <b>23/21/17</b>	▲ 23/20/16	▲ 20/17/13

Customer Id: ETCJCTY  
 Sample No.: TO90002478  
 Lab Number: 06026525  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Jonathan Hester +1 919-379-4092 x4092  
[jhester@wearcheckusa.com](mailto:jhester@wearcheckusa.com)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.

## HISTORICAL DIAGNOSIS

### 20 Jun 2022 Diag: Don Baldrige

#### WATER



We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. There is a light concentration of water present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



### 15 Mar 2022 Diag: Angela Borella

#### WATER



We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. There is a light concentration of water present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



### 13 Dec 2021 Diag: Doug Bogart

#### WATER




We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. There is a light concentration of water present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



# OIL ANALYSIS REPORT

Sample Rating Trend

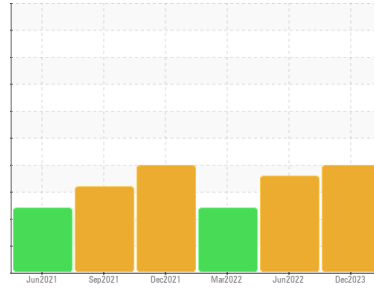

**WATER**



Area  
**Jackson County 1 Plant/Cryogenic/Compressor**  
 Machine Id  
**C-1162 (S/N 10241N10655622)**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**SUMMIT PGS-100 (250 GAL)**

**DIAGNOSIS**

**Recommendation**  
 We recommend you service the filters on this component. Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 There is a high amount of particulates present in the oil. There is a light concentration of water present in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>TO90002478</b>	TO90001751	TO90001744
Sample Date	Client Info		<b>05 Dec 2023</b>	20 Jun 2022	15 Mar 2022
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

WEAR METALS	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<b>3</b>	4	2
Chromium	ppm	ASTM D5185m >2	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	2
Aluminum	ppm	ASTM D5185m >3	<b>&lt;1</b>	<1	<1
Lead	ppm	ASTM D5185m >2	<b>0</b>	0	1
Copper	ppm	ASTM D5185m >8	<b>0</b>	0	<1
Tin	ppm	ASTM D5185m >4	<b>2</b>	2	3
Antimony	ppm	ASTM D5185m	<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 2	<b>0</b>	2	2
Barium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	<1
Manganese	ppm	ASTM D5185m 0	<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m 0	<b>4</b>	11	8
Phosphorus	ppm	ASTM D5185m 0	<b>229</b>	18	7
Zinc	ppm	ASTM D5185m 0	<b>39</b>	43	12
Sulfur	ppm	ASTM D5185m 5	<b>0</b>	<1	22


CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>2</b>	3	2
Sodium	ppm	ASTM D5185m	<b>9</b>	4	3
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	0
Water	%	ASTM D6304 >0.01	<b>▲ 0.080</b>	▲ 0.067	▲ 0.030
ppm Water	ppm	ASTM D6304 >100	<b>▲ 806</b>	▲ 679.8	▲ 305.8

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	<b>▲ 69731</b>	▲ 40960	▲ 5411
Particles >6µm	ASTM D7647	>320	<b>▲ 17889</b>	▲ 7348	▲ 875
Particles >14µm	ASTM D7647	>80	<b>▲ 1009</b>	▲ 374	51
Particles >21µm	ASTM D7647	>20	<b>▲ 270</b>	▲ 66	17
Particles >38µm	ASTM D7647	>4	<b>▲ 14</b>	4	0
Particles >71µm	ASTM D7647	>3	<b>1</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>18/15/13	<b>▲ 23/21/17</b>	▲ 23/20/16	▲ 20/17/13


FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974 0.1	<b>0.034</b>	0.04	0.062

# OIL ANALYSIS REPORT


### ▲ Particle Trend

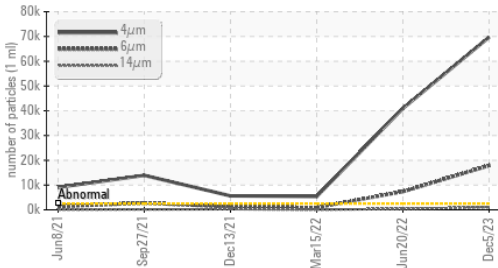


### ▲ Water (KF)

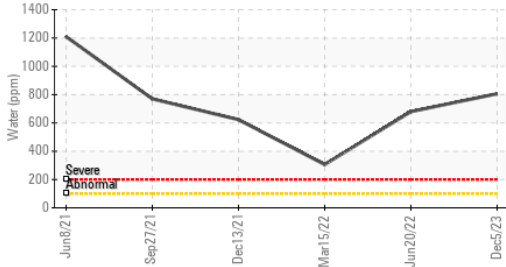


### ▲ Viscosity @ 100°C

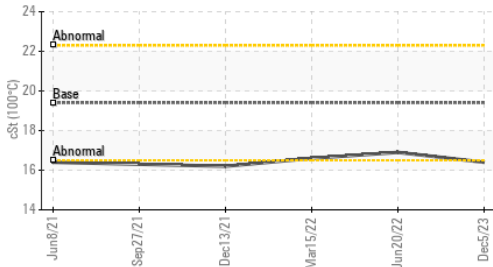

### ▲ Acid Number

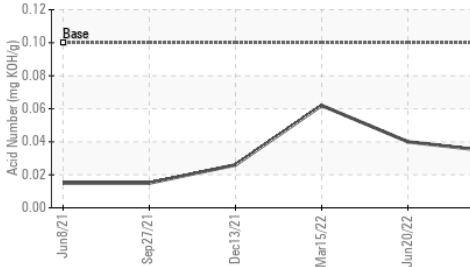

### ▲ Viscosity @ 100°C

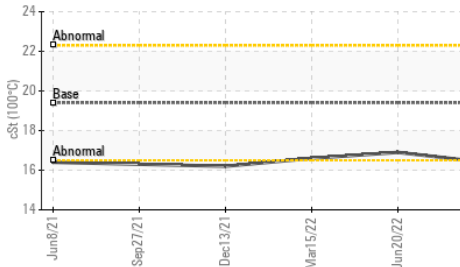


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	VLITE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	100	93.0	99.7
Visc @ 100°C	cSt	ASTM D445	19.4	16.4	16.9
Viscosity Index (VI)	Scale	ASTM D2270	218	190	184

### SAMPLE IMAGES


Color

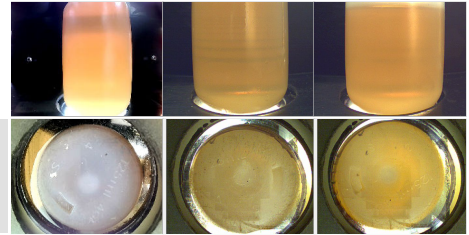


Bottom

### GRAPHS


#### Ferrous Alloys

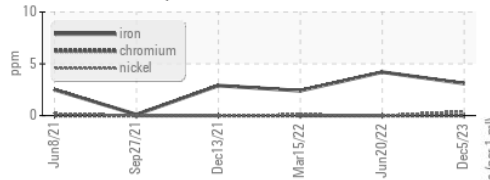


#### Non-ferrous Metals

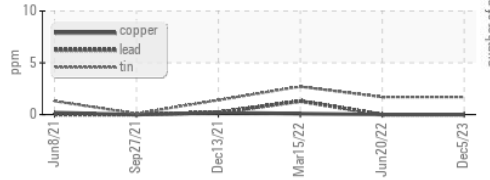


#### Viscosity @ 40°C

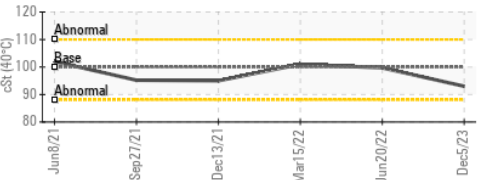

#### ▲ Particle Count

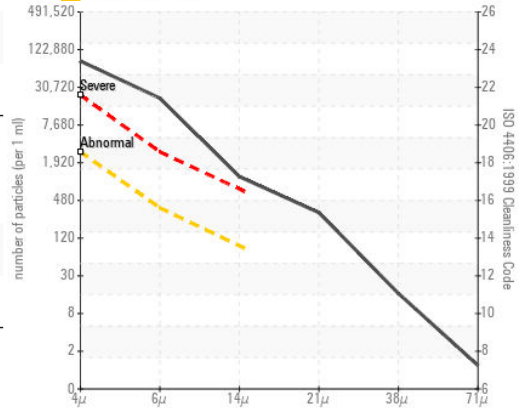

#### Acid Number

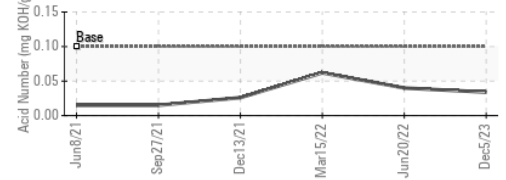

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : TO90002478 **Received** : 06 Dec 2023  
**Lab Number** : 06026525 **Diagnosed** : 07 Dec 2023  
**Unique Number** : 10776316 **Diagnostician** : Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: KV100, PrtCount, VI )

**ETC - JACKSON COUNTY**

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

US  
Contact: Service Manager

T:  
F: